

STANDARD DETAIL

FIGURE NOS.	TITLE	FIGURE NOS.	TITLE
GENERAL DETAILS		237	TYPE 3 PRIVATE FIRE PROTECTION 2" DIAMETER CONNECTION
101	UTILITY LOCATES	252	MANUAL BLOW OFF
104	UTILITY LOCATIONS	253	AUTOMATIC BLOW OFF PROFILE
105	WATER MAIN SEPARATION	254	AUTOMATIC BLOW OFF PLAN
106	STANDARD UTILITY CROSSING	255	CANNON FLUSHING
107	SPECIAL UTILITY CROSSING	SANITARY SEWER DETAILS	
109	RESTRAINED JOINT REQUIREMENTS SINGLE FITTING	311	SHALLOW MAINTENANCE ACCESS STRUCTURE
112	RESTRAINED JOINT REQUIREMENTS REDUCING FITTINGS	312	PRECAST MAINTENANCE ACCESS STRUCTURE
121	VALVE COLLAR AND IDENTIFICATION MARKER	313	PRECAST MAINTENANCE ACCESS STRUCTURE DROP CONNECTION TYPE 1
123	VALVE BOX DETAIL	313A	PRECAST MAINTENANCE ACCESS STRUCTURE DROP CONNECTION TYPE 2
127	AIR RELEASE VALVE WITH MAINTENANCE ACCESS STRUCTURE	314	DOGHOUSE MAINTENANCE ACCESS STRUCTURE DETAIL
131	TYPICAL CONNECTION TO EXISTING MAIN	315	GRAVITY SEWER MAINTENANCE ACCESS STRUCTURE COVER
141	PIPE TO BE ABANDONED (LIVE LINE LESS THAN 4")	318	INVERT CHANNEL FLOW DIRECTIONS
142	PIPE TO BE ABANDONED	322	MAINTENANCE ACCESS STRUCTURE CONNECTION DETAIL
143	PIPE TO BE ABANDONED (LIVE LINE 4" AND LARGER)	331	WYE SEWER SERVICE CONNECTION
153	JACK AND BORE PROFILE	341	SEWER SERVICE CONNECTION AT PROPERTY LINE OR EASEMENT LINE PROFILE
154	CASING PIPE DETAIL JACK AND BORE	342	SEWER SERVICE CONNECTION AT PROPERTY LINE OR EASEMENT LINE PLAN
155	JACK AND BORE PIPE DETAILS	353	SERVICE CONNECTION ON LINED GRAVITY SEWER
167	CONFLICT MAINTENANCE ACCESS STRUCTURE	FORCE MAIN DETAILS	
180	TYPICAL TRENCH BACKFILL	411	FORCE MAIN CONNECTION TO GRAVITY SEWER
182	RESTORATION OF ROADWAY CUT FOR PARALLEL UTILITY INSTALLATION	RECLAIMED WATER DETAILS	
183	RESTORATION OF ROADWAY CUT FOR PERPENDICULAR UTILITY INSTALLATION	505	TYPE 1 RECLAIMED WATER SIGN
192	TYPICAL SECTION THROUGH SWALE	506	TYPE 2 RECLAIMED WATER SIGN
194	BOLLARD	510	RECLAIMED MAIN INSTALLATION
195	CONCRETE SLAB OVER SHALLOW PIPELINES	521	RECLAIMED WATER SERVICE CONNECTION
196	TAPPING SLEEVE AND VALVE INSTALLATION	525	RECLAIMED METER BOX COVER
WATER SYSTEM DETAILS		526	RECLAIMED METER BOX INSTALLATION FOR ¾" OR 1" METERS
205	FILLING AND FLUSHING JUMPER CONNECTION	527	RECLAIMED METER BOX INSTALLATION FOR 1 ½" OR 2" METERS
206	SAMPLING POINT	528	RECLAIMED WATER MASTER METER ASSEMBLY (4" AND LARGER)
221	TYPE 1 WATER SERVICE CONNECTION	552	RECLAIMED WATER MANUAL BLOW OFF
222	TYPE 2 WATER SERVICE CONNECTION		
224	METER INSTALLATION FOR TWO 2" METERS		
225	POTABLE WATER METER BOX COVER		
226	WATER METER INSTALLATION FOR ¾" AND 1" METERS		
227	DOUBLE METER INSTALLATION FOR TWO ¾" METERS		
228	METER INSTALLATION FOR 1 ½" OR 2" METERS		
231	FIRE HYDRANT INSTALLATION		
234	3" OR 4" DOMESTIC WATER SERVICE		
235	TYPE 1 PRIVATE FIRE PROTECTION 4", 6" AND 8" DIAMETER CONNECTION		
236	TYPE 2 PRIVATE FIRE PROTECTION 4", 6" AND 8" DIAMETER CONNECTION		

REVISED

7/7/2021

DETAIL INDEX

FIGURE
1



**Know what's below.
Call before you dig.**


1. PRIOR TO BEGINNING ANY WORK, CONTRACTOR SHALL CONTACT ALL UTILITY COMPANIES THAT HAVE FACILITIES WITHIN THE PROJECT AREA.
2. THE ABOVE NOTICE SHALL APPEAR ON THE COVER SHEET OF ALL CONSTRUCTION PLANS SUBMITTED TO THE COUNTY.

REVISED

7/7/2021

UTILITY LOCATES

FIGURE
101

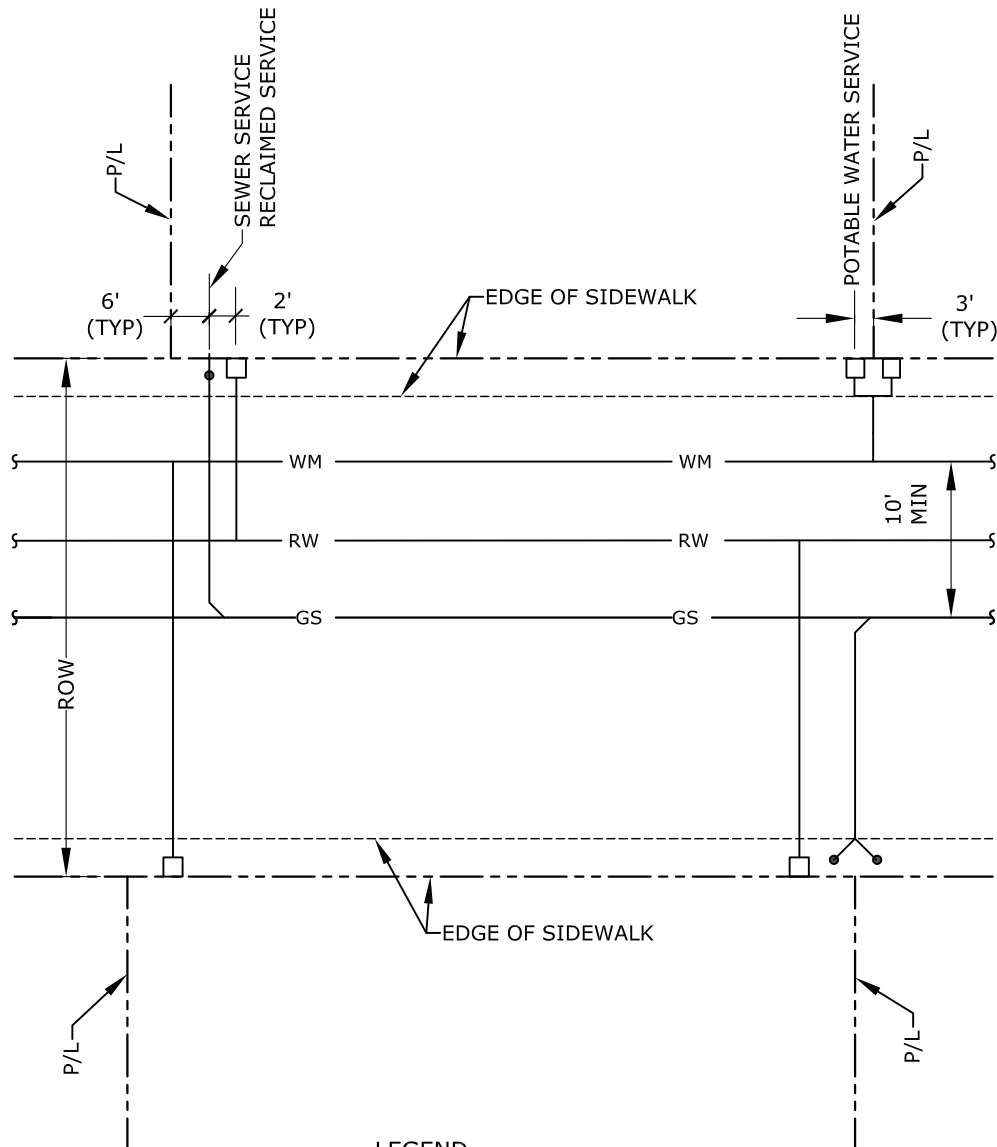

LEGEND

GS - GRAVITY SEWER
RW - RECLAIMED WATER
WM - POTABLE WATER MAIN

NOTE: LOCATION OF SERVICES CAN BE MODIFIED WITH WWS APPROVAL.










REVISED

7/7/2021


UTILITY LOCATIONS

FIGURE
104

WATER MAIN SEPARATION IN ACCORDANCE WITH F.A.C. RULE 62-555.314

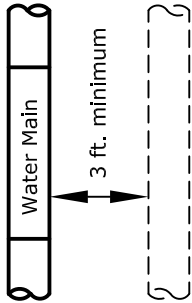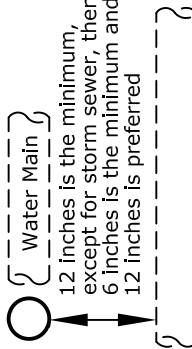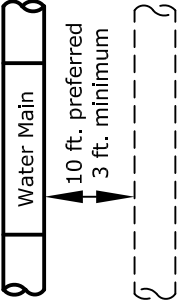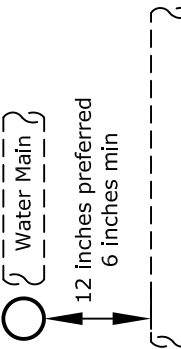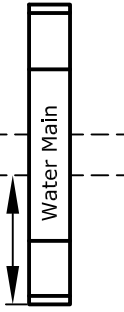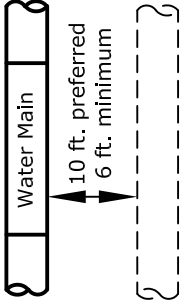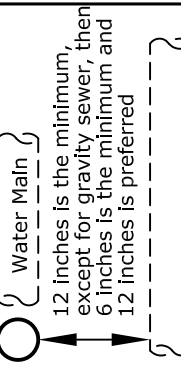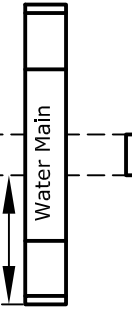OTHER PIPE	HORIZONTAL SEPARATION	CROSSINGS (1) (4)	JOINT SPACING @ CROSSINGS (FULL JOINT CENTERED)
STORM SEWER, STORM WATER FORCE MAIN, RECLAIMED WATER (2)			Alternate 3 ft. minimum 
VACUUM SANITARY SEWER			Alternate 3 ft. minimum 
GRAVITY SANITARY SEWER, (3) SANITARY SEWER FORCE MAIN, RECLAIMED WATER			Alternate 6 ft. minimum 
ON-SITE SEWAGE TREATMENT & DISPOSAL SYSTEM	10 ft. minimum	—	—

(1) WATER MAIN SHOULD CROSS ABOVE OTHER PIPE. WHEN WATER MAIN MUST BE BELOW OTHER PIPE, THE MINIMUM SEPARATION IS 12 INCHES.
 (2) RECLAIMED WATER REGULATED UNDER PART III OF CHAPTER 62-610, F.A.C.
 (3) 3 FT. FOR GRAVITY SANITARY SEWER WHERE THE BOTTOM OF THE WATER MAIN IS LAID AT LEAST 6 INCHES ABOVE THE TOP OF THE GRAVITY SANITARY SEWER.
(4) 18" VERTICAL MINIMUM SEPARATION REQUIRED BY WWS, UNLESS OTHERWISE APPROVED.

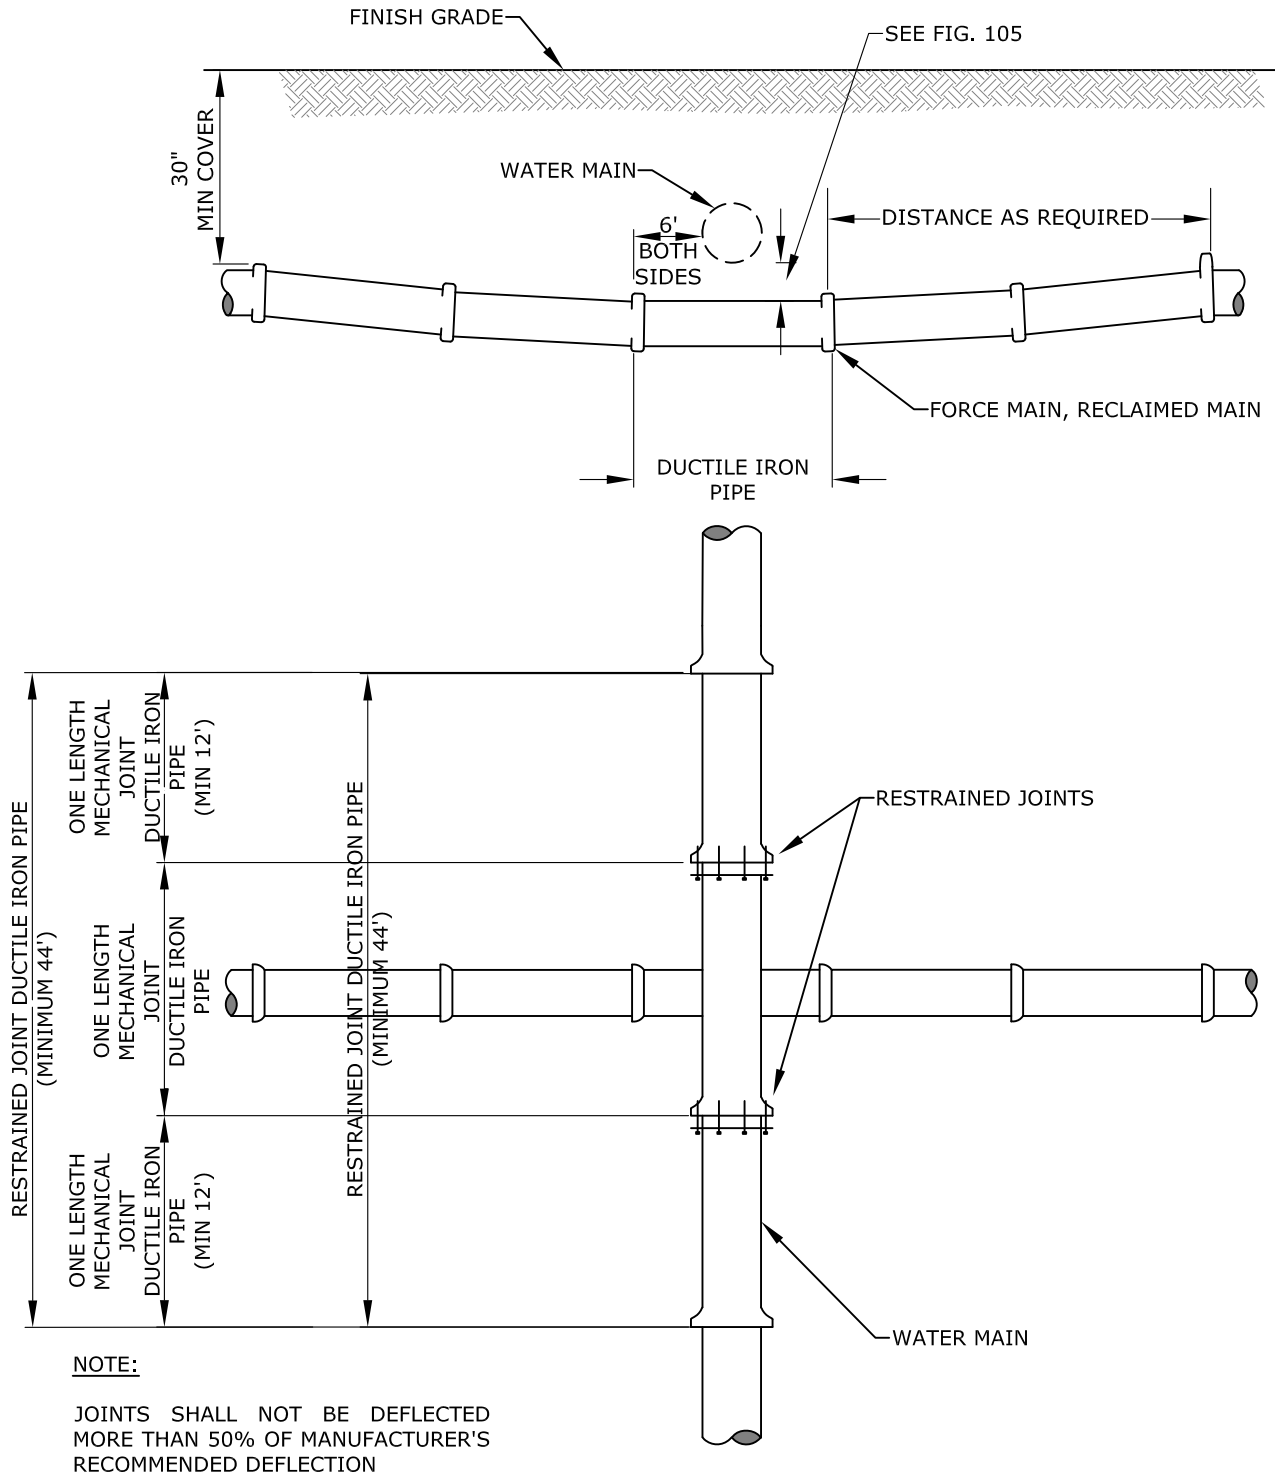


REVISED

7/7/2021

STANDARD UTILITY CROSSING

FIGURE
106

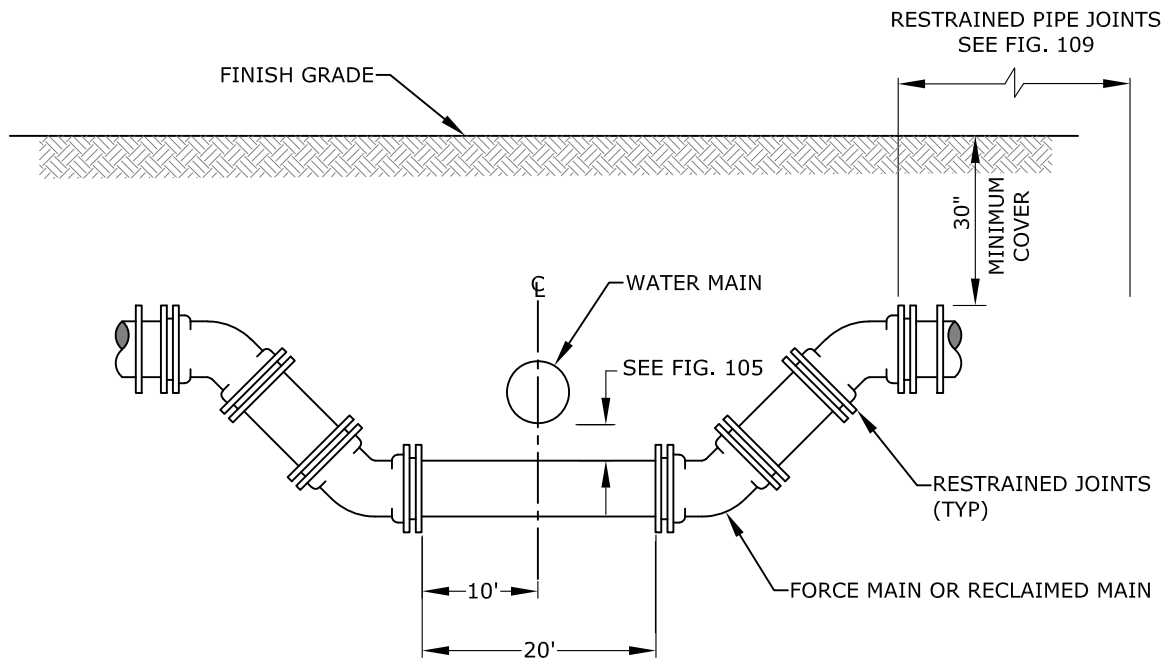


WHEREVER POSSIBLE DEFLECTION OF THE PIPE WILL BE USED TO AVOID EXISTING OBSTRUCTIONS. THIS CROSSING SHALL BE USED ONLY WHEN APPROVED BY WWS.

REVISED

7/7/2021

SPECIAL UTILITY CROSSING

FIGURE
107

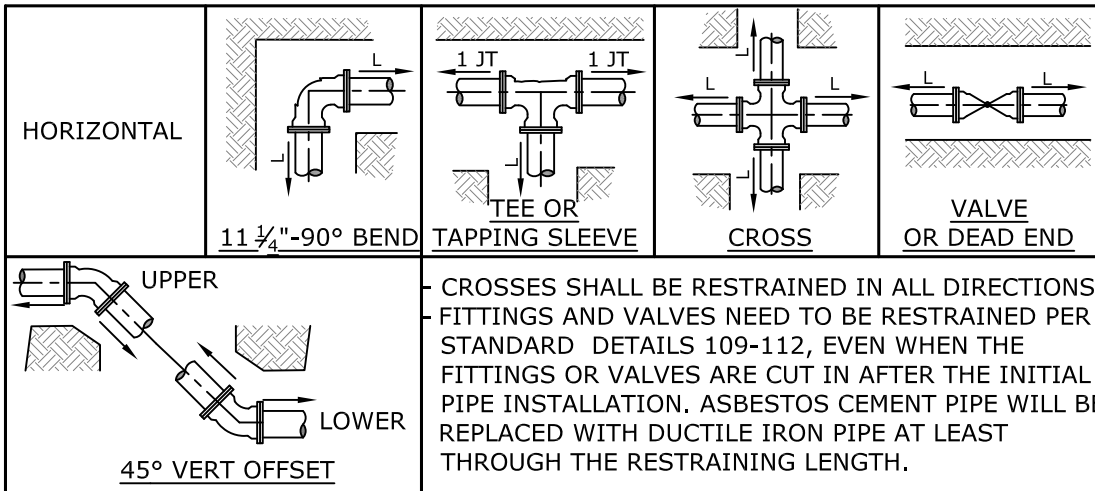

DUCTILE IRON PIPE

HORIZONTAL, L (FEET)							45° VERTICAL OFFSET (FEET)	
Diameter	11 1/4°	22 1/2°	45°	90°	Tee or Cross	Valves and Dead End	UPPER	LOWER
4	1	2	4	10	7	20	9	4
6	2	3	6	14	15	28	12	5
8	2	4	8	17	23	37	16	7
10	2	5	9	21	30	44	19	8
12	3	5	10	24	38	52	22	9

PVC PIPE

HORIZONTAL, L (FEET)							45° VERTICAL OFFSET (FEET)	
Diameter	11 1/4°	22 1/2°	45°	90°	Tee or Cross	Valves and Dead End	UPPER	LOWER
4	2	3	5	12	11	32	14	5
6	2	4	7	16	23	45	19	6
8	3	5	9	21	37	59	25	8
10	3	5	11	25	48	71	30	9
12	3	6	12	29	61	83	35	11

THE NOTED REQUIREMENTS WERE CALCULATED IN ACCORDANCE WITH THRUST RESTRAINT CALCULATOR V7.2 BY EBAA IRON WITH THE FOLLOWING ASSUMPTIONS:

SOIL CONDITIONS: SW OR GW; NOMINAL SIZE EQUALS BRANCH SIZE; LENGTH ALONG RUN EQUALS 4 FEET

LAYING CONDITION: 4, SAND BEDDING, BACKFILL COMPACTED > 80%; VERTICAL LOW SIDE DEPTH EQUALS 3.5 FEET

MINIMUM COVER: 3.0 FT SAFETY FACTOR: 1.5 BARE PIPE (NO POLY WRAP)

IF FIELD CONDITIONS DIFFER FROM THE ABOVE, CONTRACTOR SHALL NOTIFY WWS.

FOR PIPE LARGER THAN INCLUDED IN THE ABOVE TABLES, ENGINEER OF RECORD SHALL SUBMIT CALCULATIONS FOR EACH JOINT REQUIRING RESTRAINT.


SINGLE FITTING RESTRAINED JOINT
150 PSI TEST PRESSURE

REVISED


7/7/2021

RESTRAINED JOINT
REQUIREMENTS SINGLE FITTING

FIGURE
109

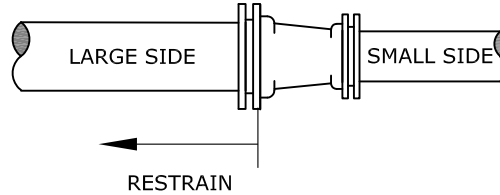

STRAIGHT REDUCER

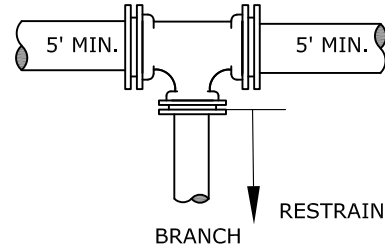

TEE REDUCER

SMALL SIDE

DUCTILE IRON PIPE				
DIAMETER	6"	8"	10"	12"
4"	15'	27'	36'	45'
6"		16'	27'	38'
8"			15'	28'
10"				16'
PVC PIPE				
	6"	8"	10"	12"
4"	24'	43'	58'	72'
6"		25'	44'	61'
8"			24'	44'
10"				25'

BRANCH SIZE

DUCTILE IRON PIPE				
DIAMETER	6"	8"	10"	12"
4"	1'	1'	1'	1'
6"		6'	1'	1'
8"			15'	10'
10"				23'
PVC PIPE				
	6"	8"	10"	12"
4"	1'	1'	1'	1'
6"		16'	8'	1'
8"			31'	25'
10"				44'

THE NOTED REQUIREMENTS WERE CALCULATED IN ACCORDANCE WITH THRUST RESTRAINT CALCULATOR V7.2 BY EBAA IRON WITH THE FOLLOWING ASSUMPTIONS:
SOIL CONDITIONS: SW OR GW; LENGTH ALONG RUN EQUALS 4 FEET
LAYING CONDITION: 4, SAND BEDDING, BACKFILL COMPACTED > 80%
MINIMUM COVER: 3.0 FT; SAFETY FACTOR: 1.5; BARE PIPE (NO POLY WRAP)
IF FIELD CONDITIONS DIFFER FROM THE ABOVE, CONTRACTOR SHALL NOTIFY WWS.
FOR PIPE LARGER THAN INCLUDED IN THE ABOVE TABLES, ENGINEER OF RECORD SHALL SUBMIT CALCULATIONS FOR EACH JOINT REQUIRING RESTRAINT.



RESTRAINED REDUCING FITTING
150 PSI TEST PRESSURE

REVISED

7/7/2021

RESTRAINED JOINT
REQUIREMENTS REDUCING FITTINGS

FIGURE
112

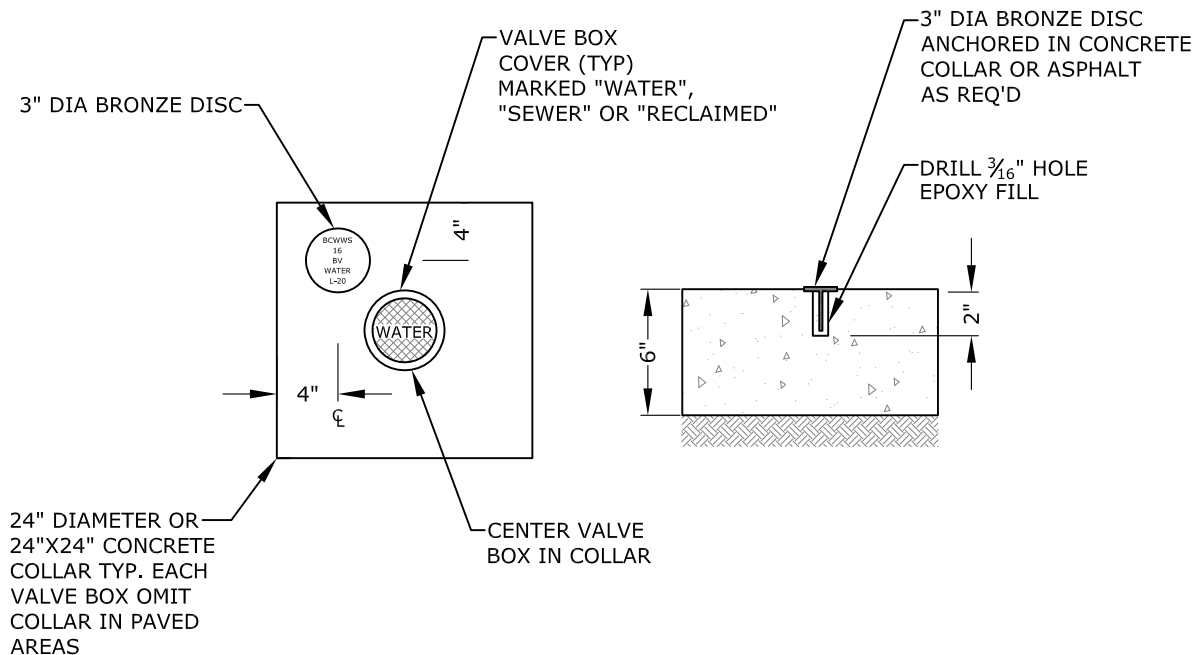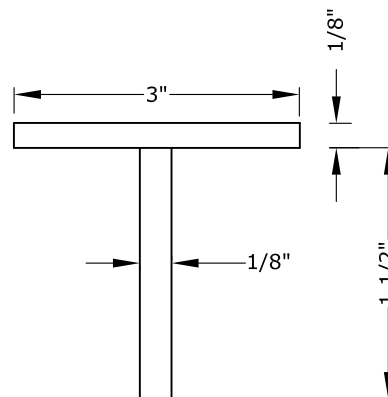


REVISÉD

7/7/2021

VALVE COLLAR AND IDENTIFICATION MARKER

FIGURE
121

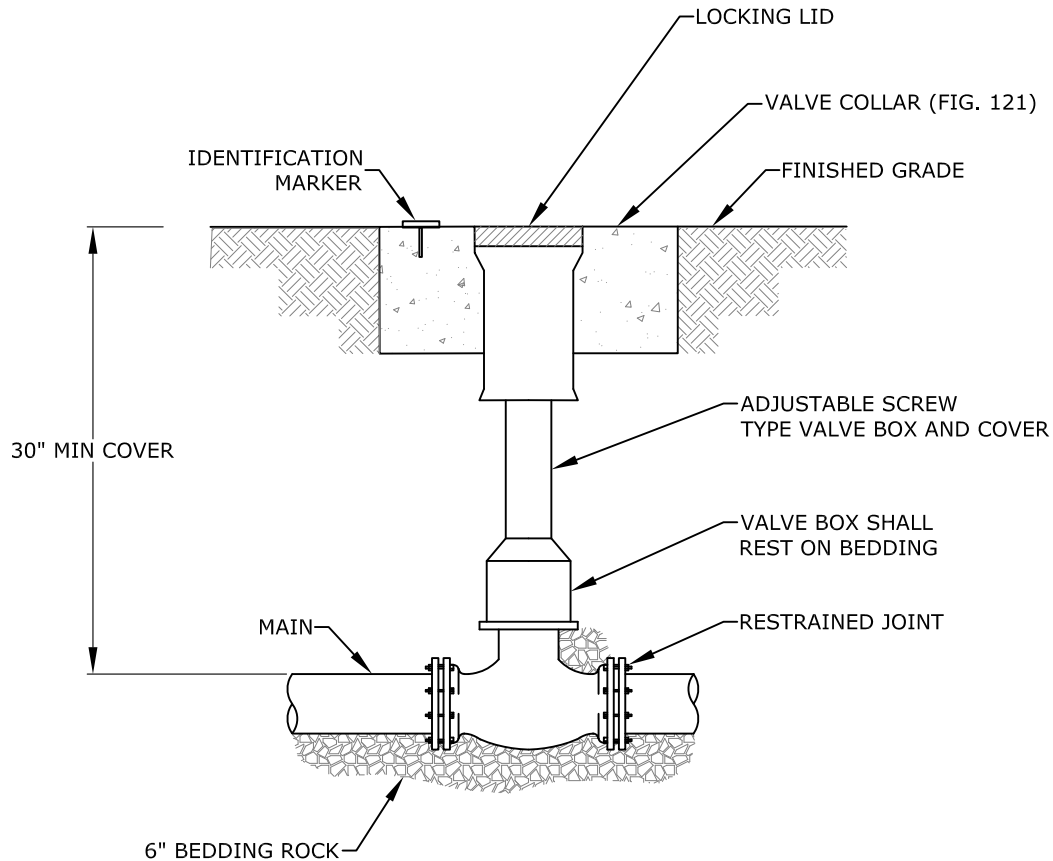


1. WHEN VALVE IS NOT LOCATED IN PAVEMENT, PLACE A WHITE REFLECTIVE RAISED PAVEMENT MARKER IN THE DRIVE LANE, ADJACENT TO THE VALVE.
2. OPERATOR EXTENSION SHAFT SHALL BE PROVIDED WHEN OPERATING NUT IS MORE THAN 24" BELOW TOP OF VALVE BOX.
3. PVC PIPE OR DUCTILE IRON PIPE IS NOT ACCEPTABLE FOR VALVE BOX RISER.

REVISED

7/7/2021

VALVE BOX DETAIL

FIGURE
123

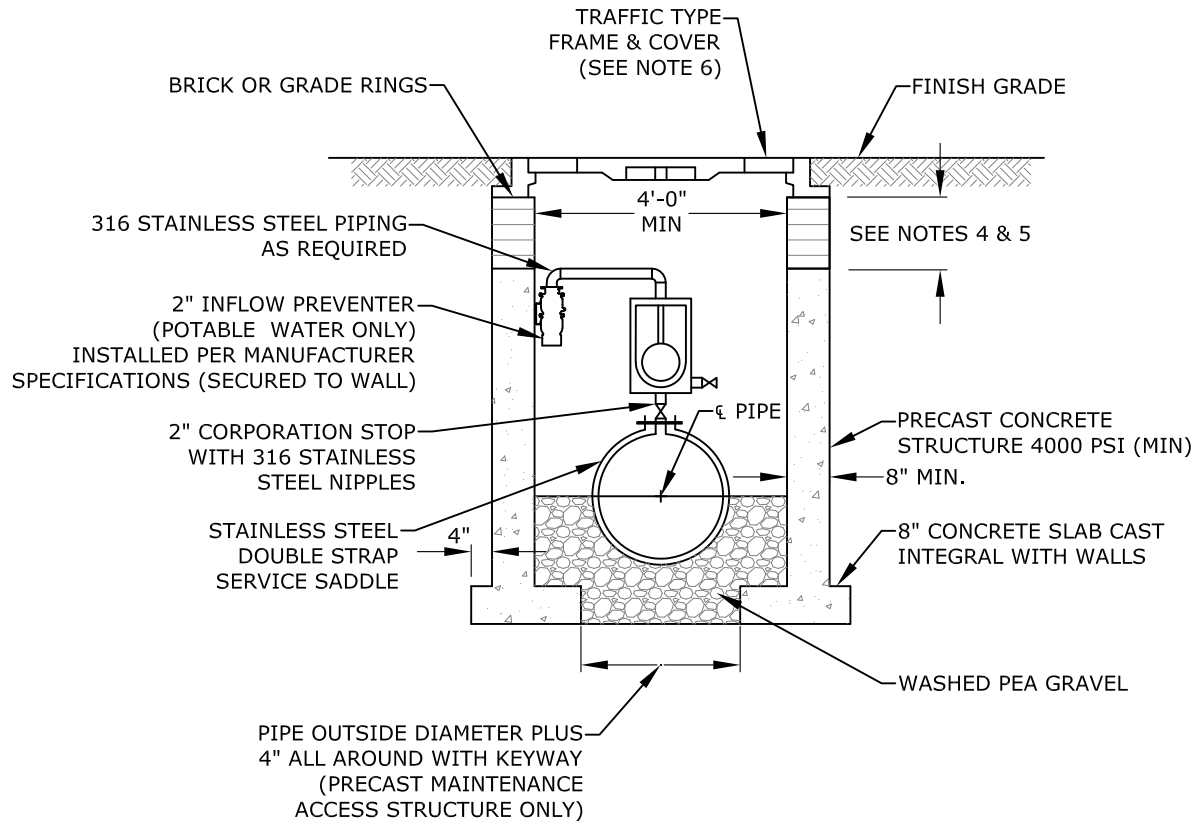


1. LIFT HOLES ARE TO BE SEALED WITH MORTAR INSIDE AND OUTSIDE AFTER INSTALLATION.
2. MAINTENANCE ACCESS STRUCTURE WALLS TO BE COATED INSIDE AND OUTSIDE WITH 16 MIL. THICKNESS COAL TAR EPOXY. SEE NOTES 9. AND 10., DETAIL NO. 312.
3. ALL OPENINGS SHALL BE SEALED WITH A WATERPROOF, EXPANDING GROUT. ACTUAL LOCATION AND MAINTENANCE ACCESS STRUCTURE FRAME ELEVATION SHALL BE DETERMINED BY ENGINEER BASED ON AS-BUILT SURVEY DATA.
4. THE CHIMNEY AREA SHALL BE MINIMUM OF 4" AND A MAXIMUM OF 12" IN HEIGHT. A MINIMUM OF 3 COURSES OF BRICK SHALL BE INSTALLED.
5. GRADE RINGS ARE AN ACCEPTABLE ALTERNATIVE TO BRICK. A MINIMUM OF 3 GRADE RINGS SHALL BE INSTALLED. SET IN TWO STRIPS OF SEALANT/ADHESIVE COMPOUND ON EACH SEALING FACE.
6. SET MAINTENANCE ACCESS STRUCTURE FRAME ON A BED OF PORTLAND CEMENT AND SILICA SAND. BRING MORTAR UP OVER FRAME.

REVISED

7/7/2021

**AIR RELEASE VALVE WITH
MAINTENANCE ACCESS STRUCTURE**

**FIGURE
127**

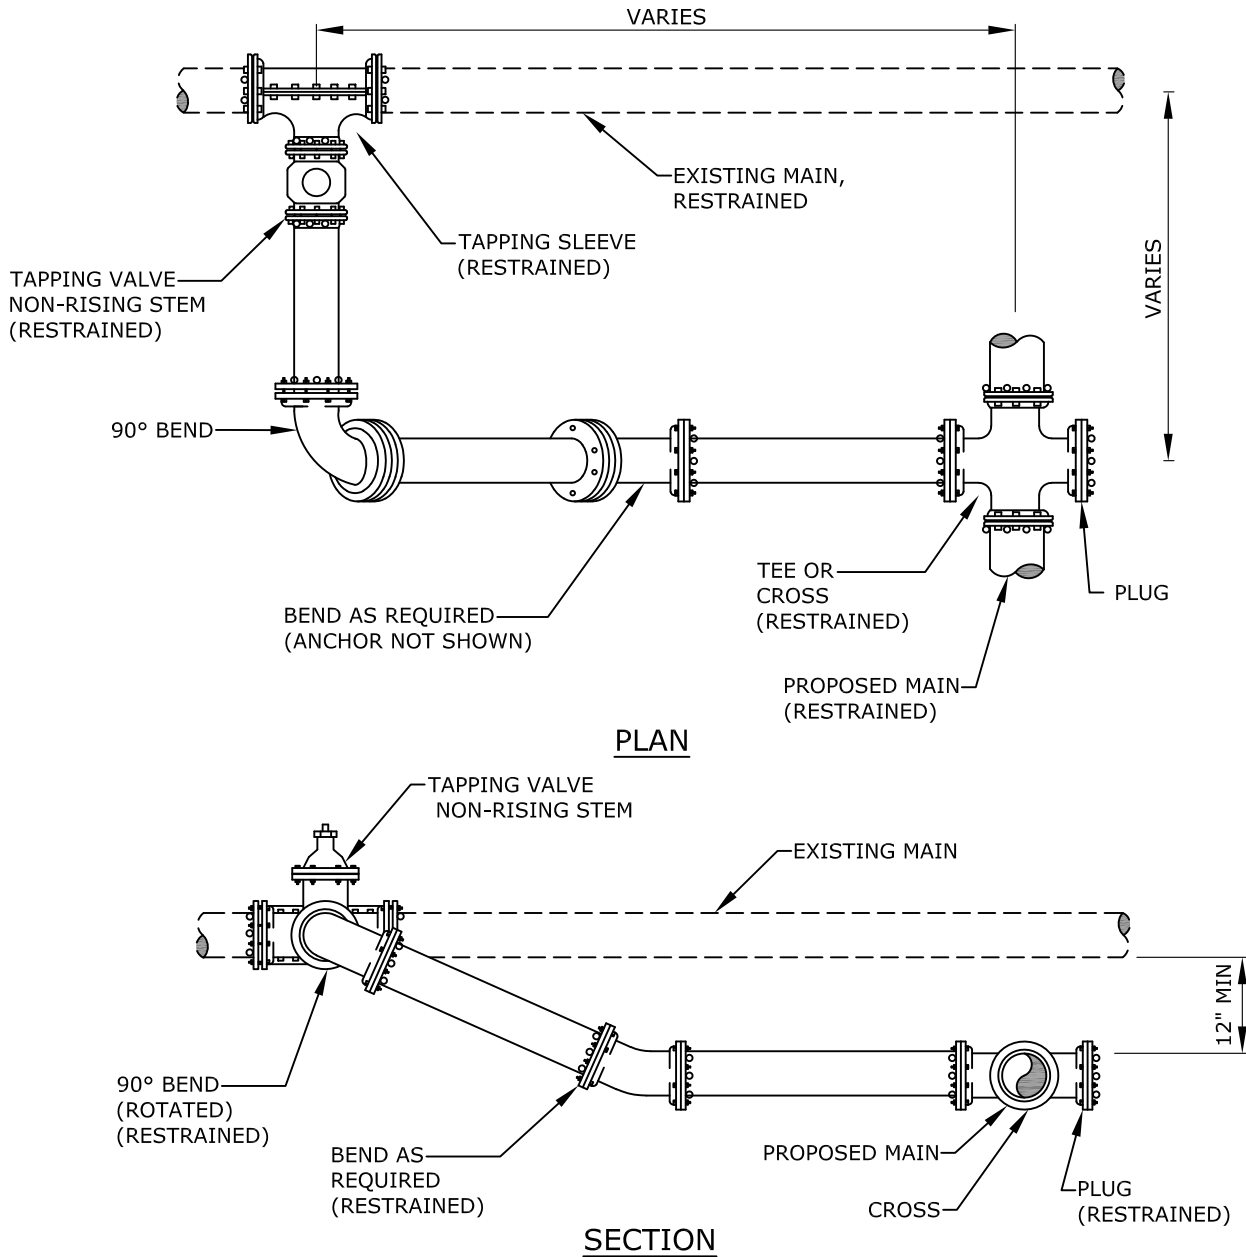

NOTES:


1. ALL JOINTS TO BE RESTRAINED BY APPROVED METHODS.
2. IF CONNECTION IS PRIOR TO FDEP CLEARANCE THEN A SECOND VALVE WITH VENT IS REQUIRED.

REVISED

7/7/2021

**TYPICAL CONNECTION
TO EXISTING MAIN**

**FIGURE
131**

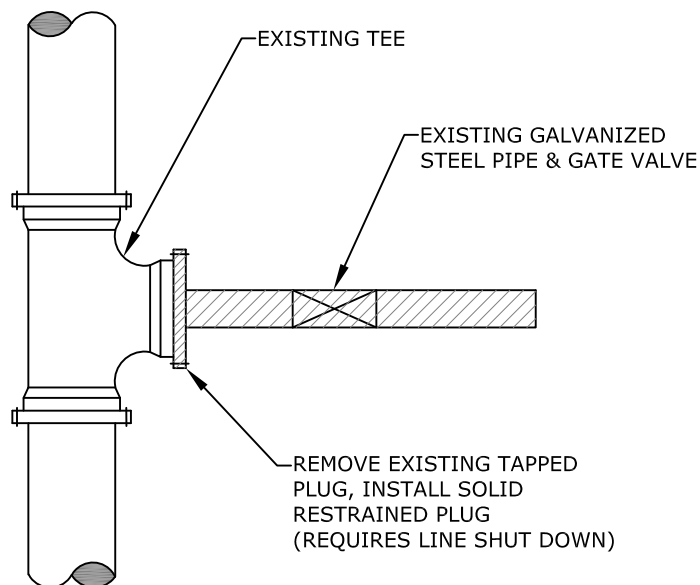


LIVE LINE SEALING
2" AND 3" GALVANIZED STEEL PIPE

REVISED


7/7/2021

PIPE TO BE ABANDONED
(LIVE LINE LESS THAN 4" DIAMETER)

FIGURE
141

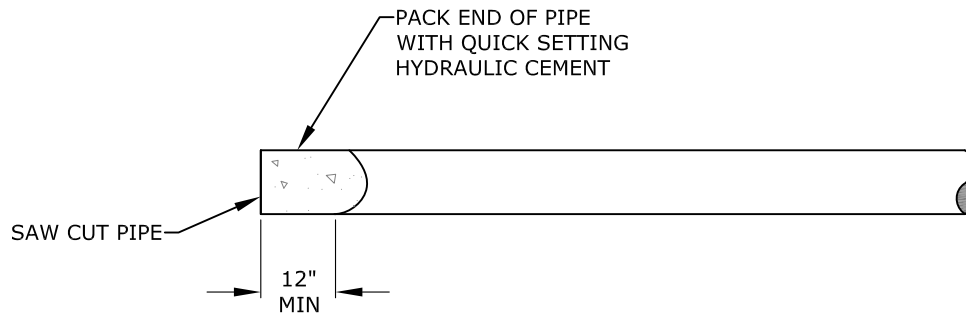

2" AND 3" PIPE

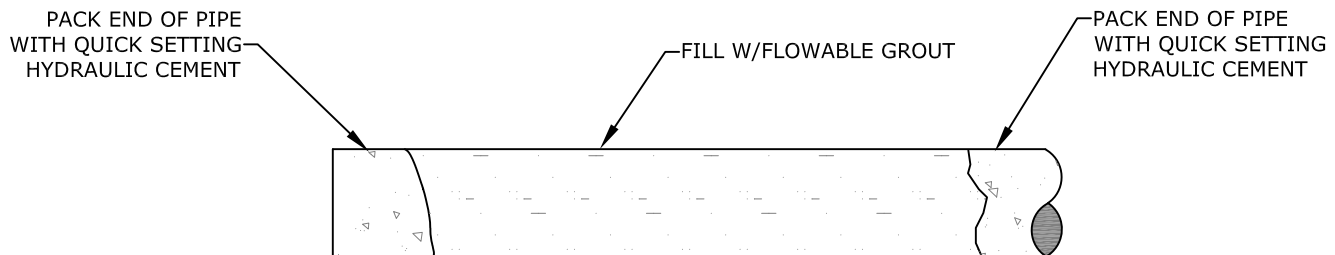

4" AND LARGER PIPE

NOTES:


1. GROUT IN PLACE WITH QUICK SETTING HYDRAULIC CEMENT.
2. PUMP FLOWABLE GROUT FROM ONE END, OR INTERMEDIATE POINTS ALONG THE PIPELINE, UNTIL PIPE IS FILLED AS WITNESSED BY THE DISCHARGE.
3. 600 FEET MAX LENGTH FOR EACH ABANDONMENT.

REVISED


7/7/2021

PIPE TO BE ABANDONED

FIGURE
142

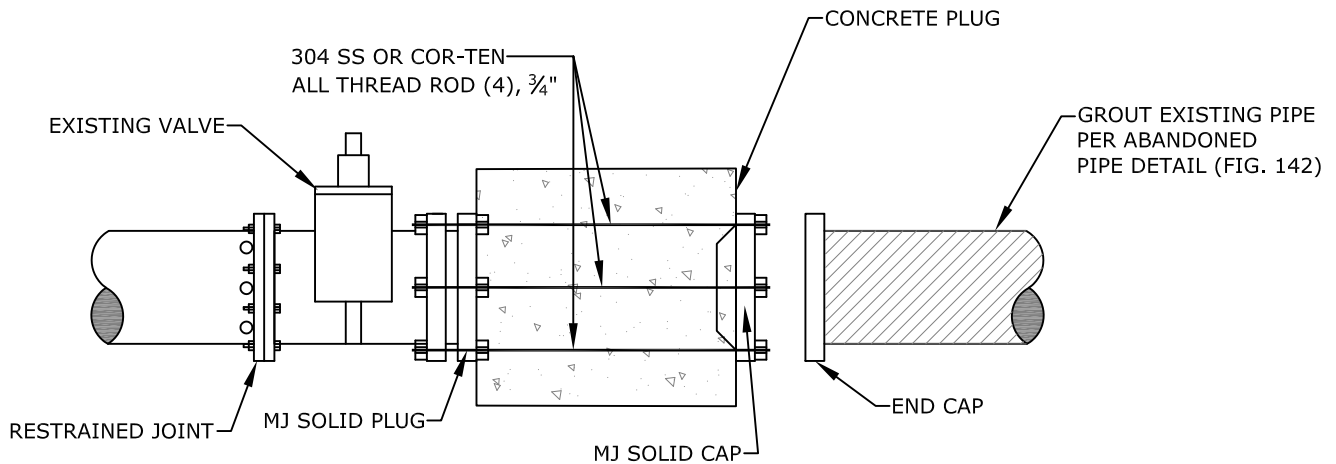

PROFILE

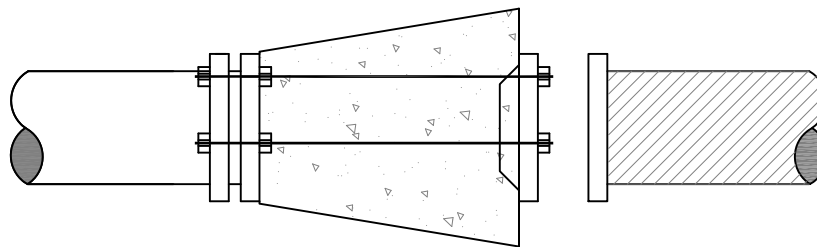

PLAN

AT EXISTING VALVE OR FITTING

SEQUENCE OF CONSTRUCTION


1. RESTRAIN VALVE OR FITTING. CONTRACTOR TO PROVIDE TEMPORARY RESTRAINT AS REQUIRED. (REQUIRES LINE SHUT DOWN)
2. REMOVE EXISTING PIPE FOR NEW CONCRETE PLUG.
3. INSTALL PLUG INTO BELL OF VALVE OR FITTING AND CAP ON END OF EXISTING PIPE TO BE ABANDONED.
4. INSTALL ALL THREAD RODS (3/4" DIA., MIN) AND POUR CONCRETE PLUG.

REVISED

7/7/2021

**PIPE TO BE ABANDONED
(LIVE LINE 4" AND LARGER)**

**FIGURE
143**

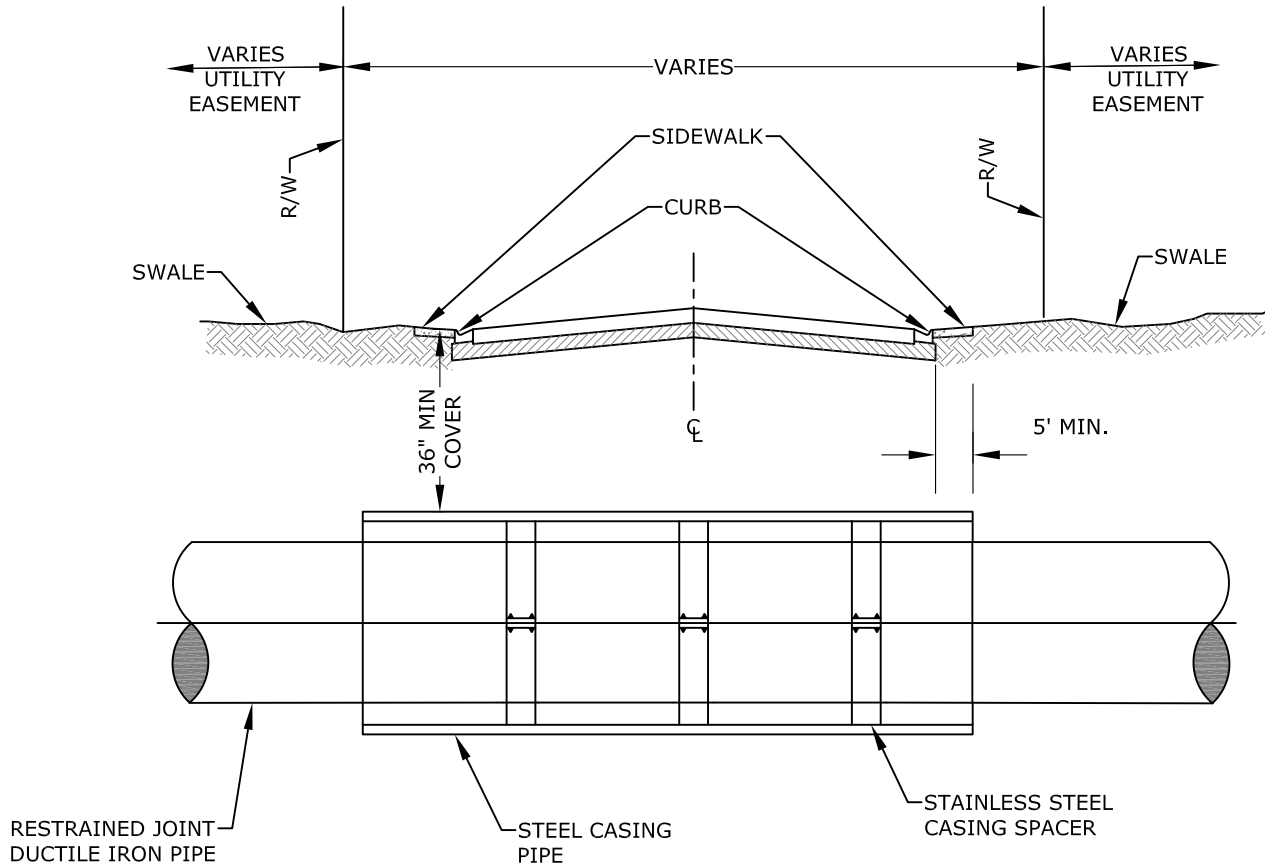

NOTES:


1. THE END OF THE CASING PIPE SHALL EXTEND BEYOND THE EDGE OF PAVEMENT A MINIMUM OF 5'.
2. WHEN CONSTRUCTION IS WITHIN FDOT OR RAILROAD JURISDICTION, ADDITIONAL REQUIREMENTS OF THE UTILITY ACCOMMODATION MANUAL SHALL BE MET.

REVISED

7/7/2021

**JACK AND BORE
PROFILE**

**FIGURE
153**

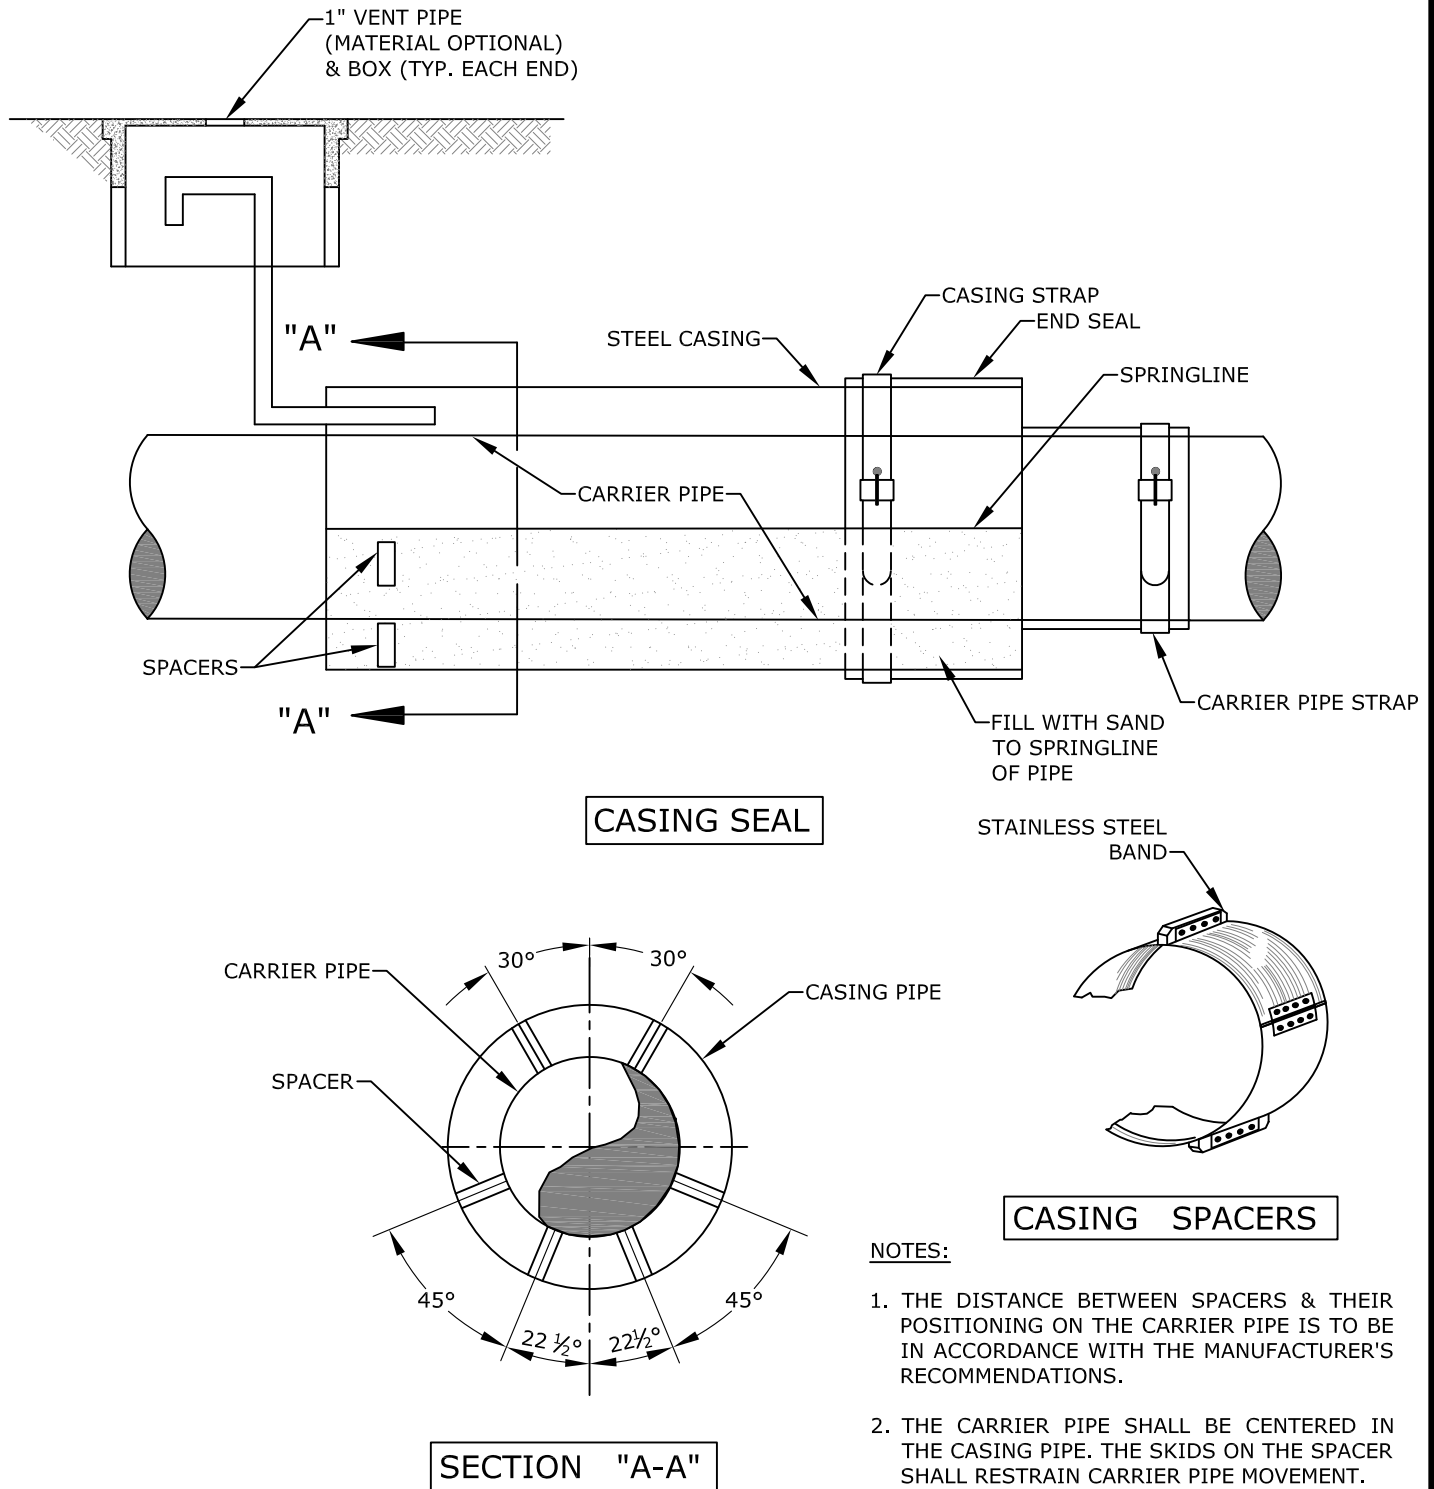

REVISED

7/7/2021

CASING PIPE DETAIL
JACK AND BORE

FIGURE
154

SPECIFICATIONS FOR CARRIER AND CASING PIPES

	CARRIER PIPE	CASING PIPE
CONTENTS TO BE HANDLED	WATER/WASTEWATER	NONE
OUTSIDE DIAMETER	DETERMINED BY PROJECT	SEE TABLE
PIPE MATERIAL	DIP	STEEL
SPECIFICATION AND GRADE	ANSI/AWWA C151/A21.51	ASTM A139, GRADE"B"
PRESSURE CLASS/WALL THICKNESS	350	0.500"
ACTUAL WORKING PRESSURE	150 PSI	NONE
TYPE OF JOINT	RESTRAINED	WELDED
COATING	BLACK BITUMINOUS	BLACK BITUMINOUS
METHOD OF INSTALLATION	CASING SPACERS	JACK AND BORE
PROTECTION AT ENDS OF CASING	N/A	CASING END SEAL

NOTES:

1. CASING PIPE TO BE INSTALLED UNDER ROAD BY JACKING AND BORING.
2. ALL WORK DONE WITHIN FDOT OR RAILROAD RIGHT OF WAY IS SUBJECT TO INSPECTION AND DIRECTION OF THEIR ENGINEER.
3. ALL WORK SHALL BE DONE IN ACCORDANCE WITH CURRENT AWWA STANDARDS FOR PIPE LINES CONVEYING NONFLAMMABLE SUBSTANCES AND FDOT REQUIREMENTS AS PER UTILITY ACCOMMODATION GUIDE, LATEST VERSION.
4. FIELD AND SHOP WELDS OF THE CASING PIPES SHALL CONFORM WITH AWS STANDARD SPECIFICATIONS. FIELD WELDS SHALL BE COMPLETE PENETRATIONS, SINGLE-BEVEL GROOVE TYPE JOINTS.
5. STEEL CASING SHALL CONFORM TO THE REQUIREMENTS OF ASTM DESIGNATION A139. THE CASING PIPES SHALL HAVE THE MINIMUM NOMINAL DIAMETER AND MINIMUM WALL THICKNESS AS SHOWN.
6. CONTRACTOR SHALL VERIFY LOCATION AND DEPTH OF ALL EXISTING UTILITIES PRIOR TO STARTING JACKING AND BORING.
7. MINIMUM VERTICAL CLEARANCE BETWEEN PROPOSED CASING PIPE AND OTHER EXISTING UTILITIES SHALL BE 12" MINIMUM.
8. STAINLESS STEEL CASING SPACERS WITH POLYMER RUNNERS SUBJECT TO APPROVAL OF WWS.

CARRIER PIPE SIZE	NOMINAL DIA OF STEEL CASING PIPE
6"	14"
8"	16"
10"	20"
12"	24"
14"	24"
16"	30"
18"	34"
20"	36"
24"	42"
30"	42"
36"	48"
42"	54"
48"	72"


REVISED

7/7/2021

**JACK AND BORE
PIPE DETAILS**

**FIGURE
155**

FIGURE
167

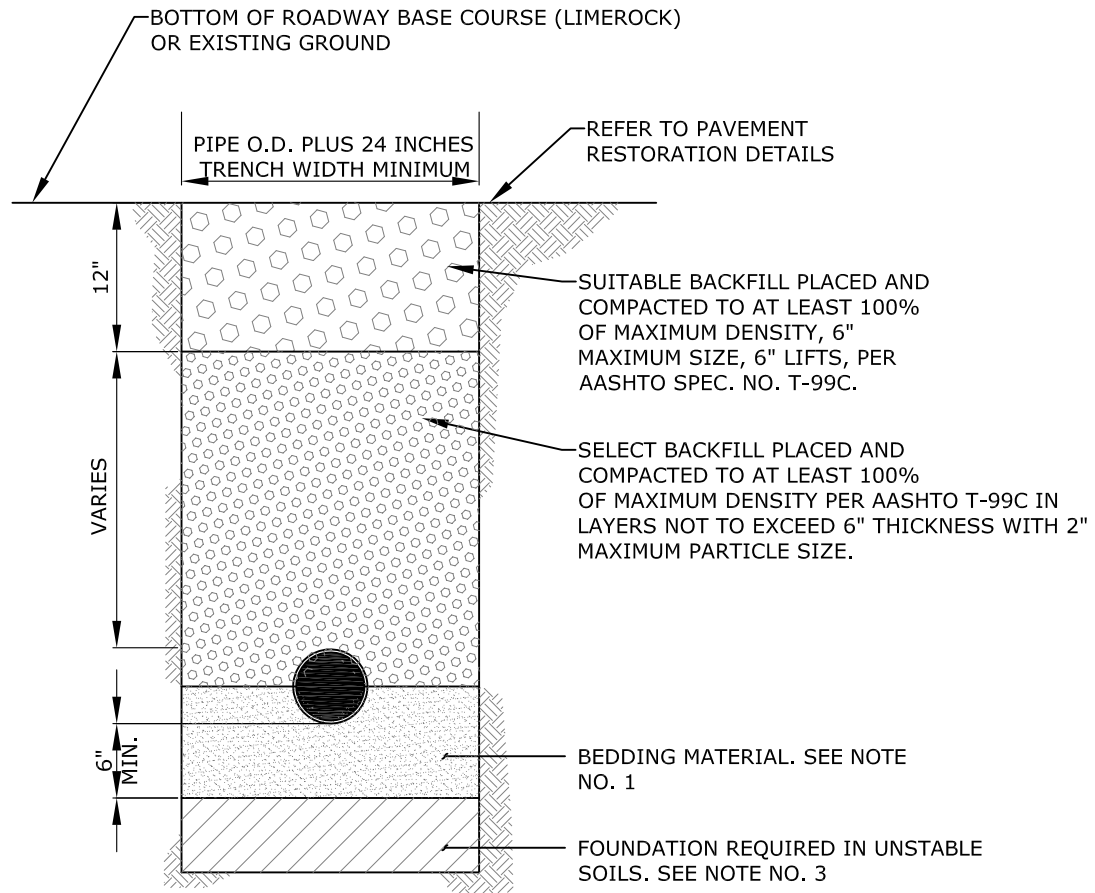

NOTES:



1. UNLESS OTHERWISE SPECIFIED, BEDDING MATERIAL SHALL CONSIST OF SELECT BACKFILL MATERIAL 2" MAXIMUM PARTICLE SIZE, COMPACTED TO AT LEAST 100% OF MAX. DENSITY, 6" LIFTS, PER AASHTO SPEC. NO. T-99C.
2. WHERE REQUIRED, SHEETING AND SHORING SHALL BE IN ACCORDANCE WITH OSHA REQUIREMENTS.
3. WHERE UNSTABLE SOILS ARE ENCOUNTERED, INCLUDING PEAT, MUCK OR OTHER ORGANIC SOILS, ELASTIC SILT AND CLAYS, A FOUNDATION IS REQUIRED AS DETERMINED BY THE ENGINEER OF RECORD.

REVISED

7/7/2021

TYPICAL TRENCH BACKFILL

FIGURE
180

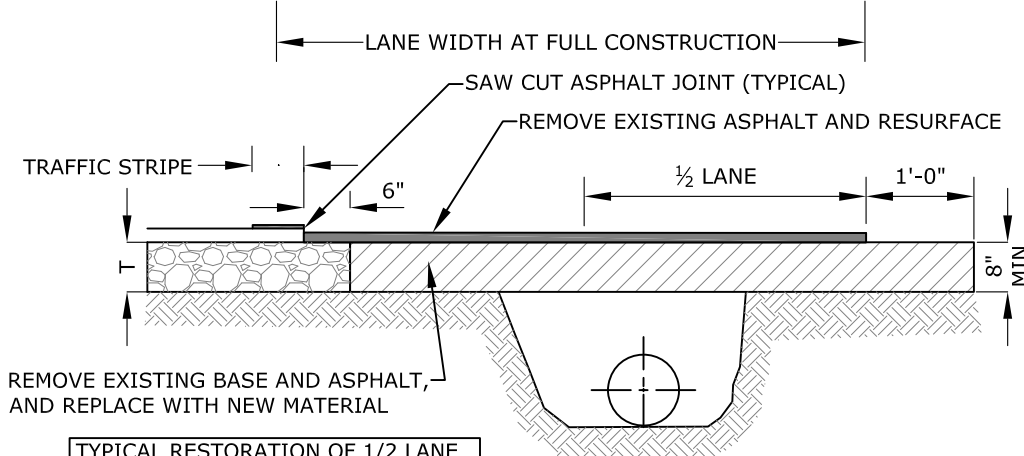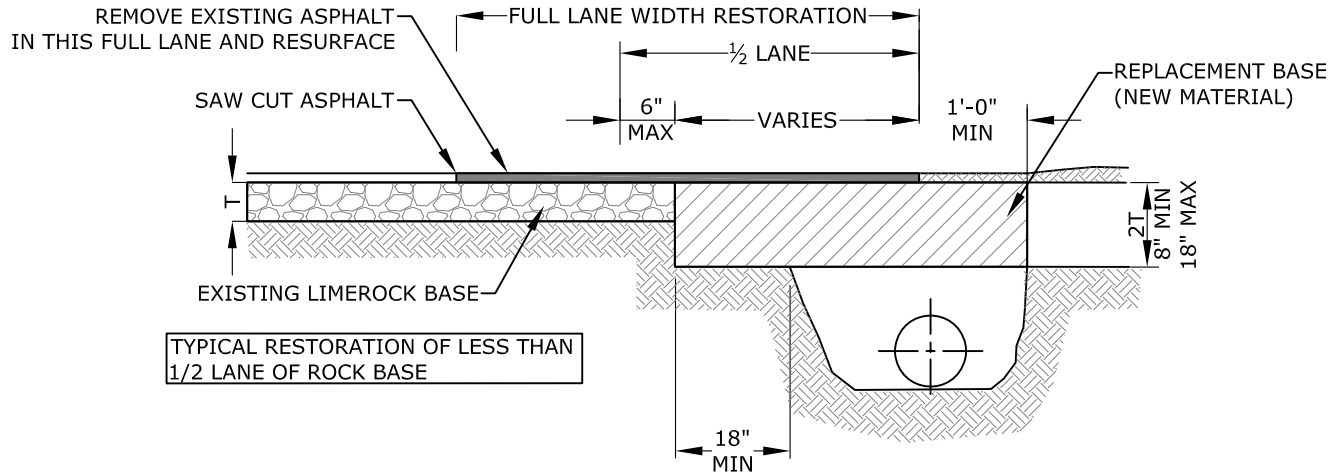

NOTES:

1. BASE MATERIAL SHALL HAVE A MINIMUM LBR OF 100 AND A MINIMUM CARBONATE CONTENT OF 70%.
2. BASE SHALL BE PLACED IN 6" MAXIMUM THICKNESS LAYERS WITH EACH LAYER COMPACTED AS REQUIRED AND TESTED PRIOR TO THE PLACEMENT OF THE SUCCEEDING LAYERS.
3. SUBGRADE MATERIAL SHALL BE GRANULAR AND ANGULAR AND SHALL HAVE A MINIMUM LBR OF 40.
4. BACKFILL SHALL BE PLACED AND COMPACTED IN 6" LAYERS, BUT TESTING WILL BEGIN 12" ABOVE THE INSTALLED UTILITY.
5. ALL EDGES OF EXISTING ASPHALT PAVEMENT THAT ABUT RESURFACING SHALL BE SAW CUT IN STRAIGHT LINES PARALLEL TO OR PERPENDICULAR TO THE ROADWAY, PRIOR TO RESURFACING.
6. RESURFACING MATERIAL SHALL BE CONSISTENT WITH SURROUNDING SURFACE, AND SHALL BE APPLIED IN 2 LIFTS, A MINIMUM OF $\frac{3}{4}$ INCH.
7. TRAFFIC STRIPES SHALL NOT BE PLACED DIRECTLY ON TOP OF THE JOINT
8. FOR STATE ROADS REFER TO FDOT SPECIFICATIONS AND REQUIREMENTS.


T = EXISTING LIMEROCK BASE THICKNESS.

REVISED

7/7/2021

**RESTORATION OF ROADWAY CUT
FOR
PARALLEL UTILITY INSTALLATION**

**FIGURE
182**

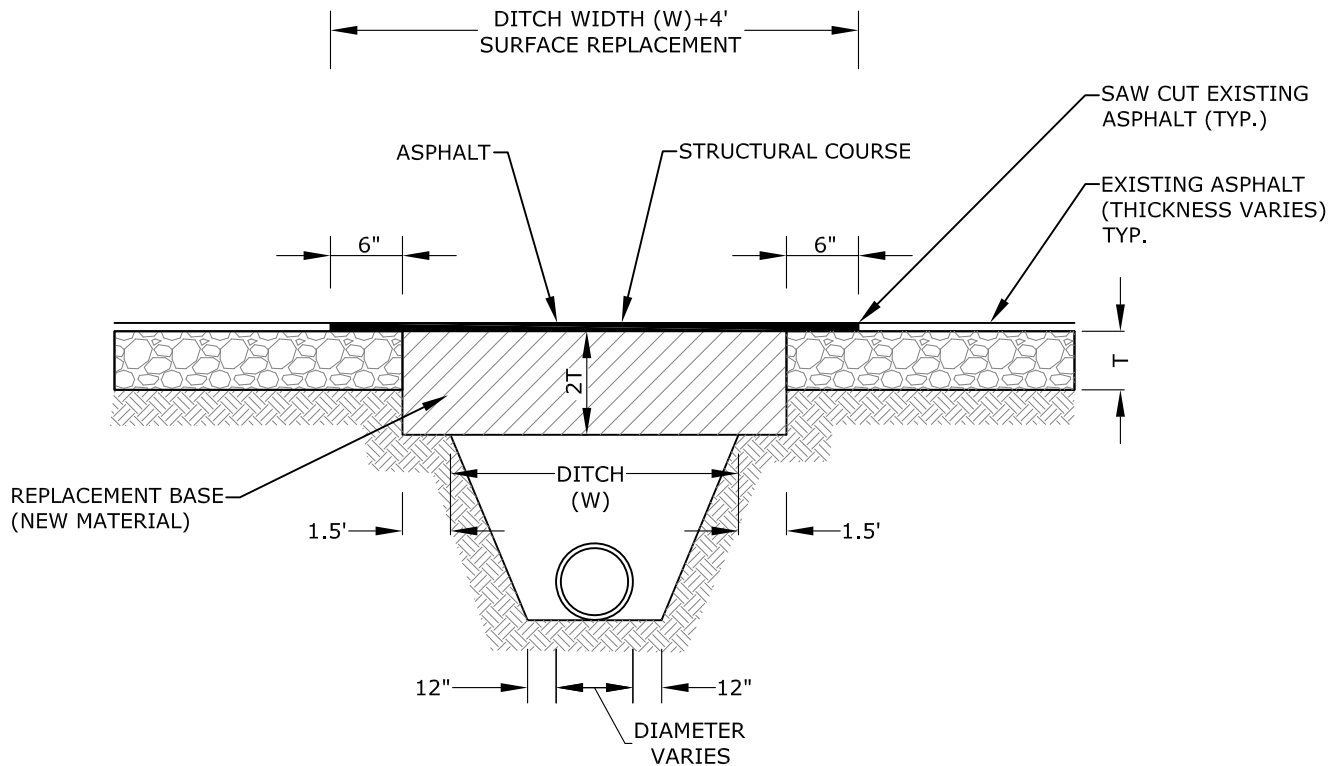

NOTES:

1. BASE MATERIAL OVER DITCH SHALL BE TWICE THE THICKNESS OF THE ORIGINAL.
2. BASE MATERIAL SHALL BE PLACED IN 6" MAXIMUM LAYERS (LOOSE MEASUREMENT) AND EACH LAYER THOROUGHLY ROLLED OR TAMPED TO 98% OF MAXIMUM DENSITY, PER AASHTO T-180.
3. ASPHALT CONCRETE PAVEMENT JOINTS SHALL BE MECHANICALLY SAW CUT.
4. SURFACE MATERIAL SHALL BE CONSISTENT WITH THE SURROUNDING SURFACE MATERIAL.
5. BASE MATERIAL SHALL HAVE A MINIMUM CARBONATE OF 70%.
6. SUB GRADE MATERIAL SHALL BE GRANULAR AND ANGULAR AND SHALL HAVE A MINIMUM LBR OF 40.
7. IF THE DITCH IS FILLED TEMPORARILY, IT SHALL BE COVERED WITH A 2" THICK ASPHALT CONCRETE PATCH TO KEEP THE FILL MATERIAL FROM RAVELING, UNTIL REPLACED WITH A PERMANENT PATCH.
8. FOR STATE ROADS REFER TO FDOT SPECIFICATIONS AND REQUIREMENTS.


T = EXISTING LIMEROCK BASE THICKNESS.

REVISED

7/7/2021

**RESTORATION OF ROADWAY CUT
FOR
PERPENDICULAR UTILITY INSTALLATION**

**FIGURE
183**

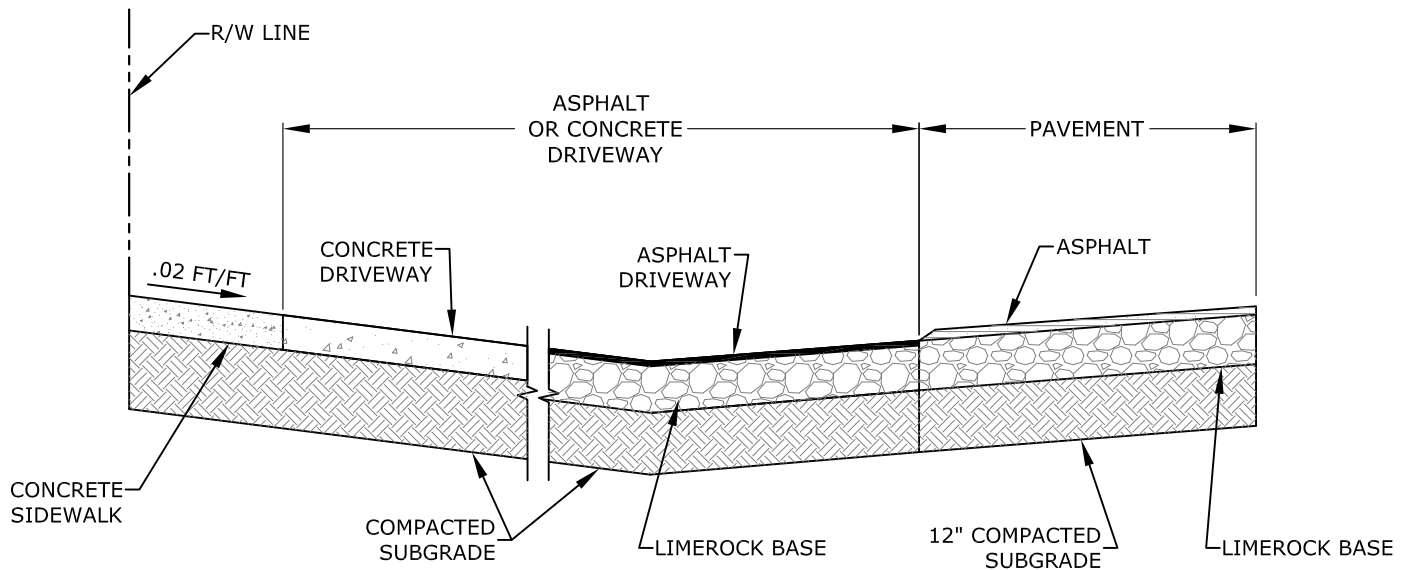

**RESTORATION SPECIFICATION
 SUMMARY TABLE**


TYPE	MATERIAL	SPECIFICATION
TYPE I	SOD, SEED OR MULCH	COMPACTED SUBGRADE (100% PER AASHTO T-99C) BAHIA OR ST. AUGUSTINE SOD TO MATCH EXISTING
TYPE II-A	ASPHALT DRIVEWAY	1-1/2" ASPHALT, 6" LIMEROCK (98% PER AASHTO T-180), COMPACTED SUBGRADE (100% PER AASHTO T-99C)
TYPE III	CONCRETE DRIVEWAY	6" CONCRETE (NO WIRE MESH) COMPACTED SUBGRADE (100% PER AASHTO T-99C)

REVISED

7/7/2021

TYPICAL SECTION THROUGH SWALE

**FIGURE
 192**



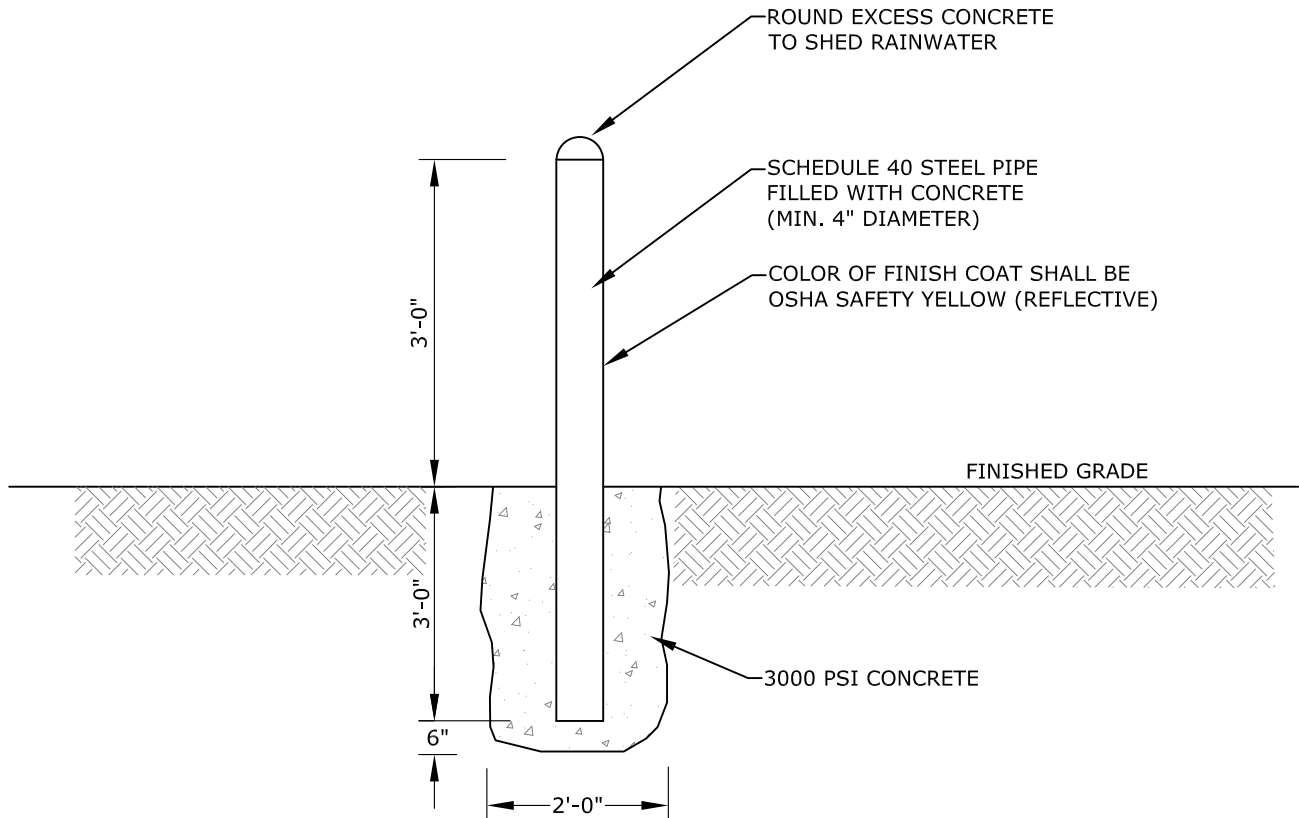


REVISED

7/7/2021

BOLLARD

FIGURE
194

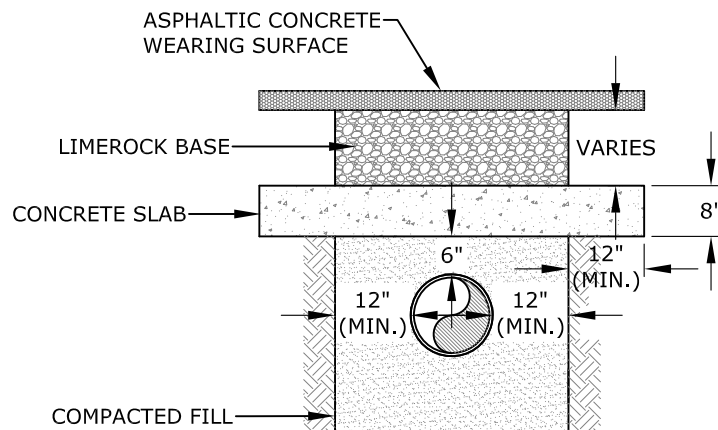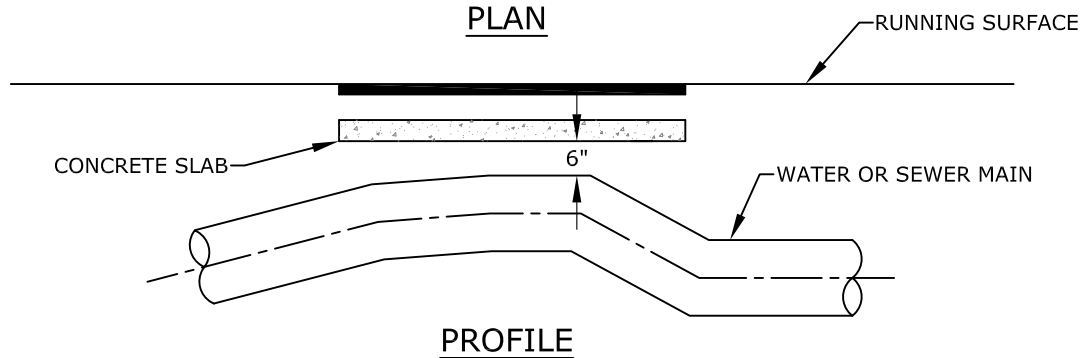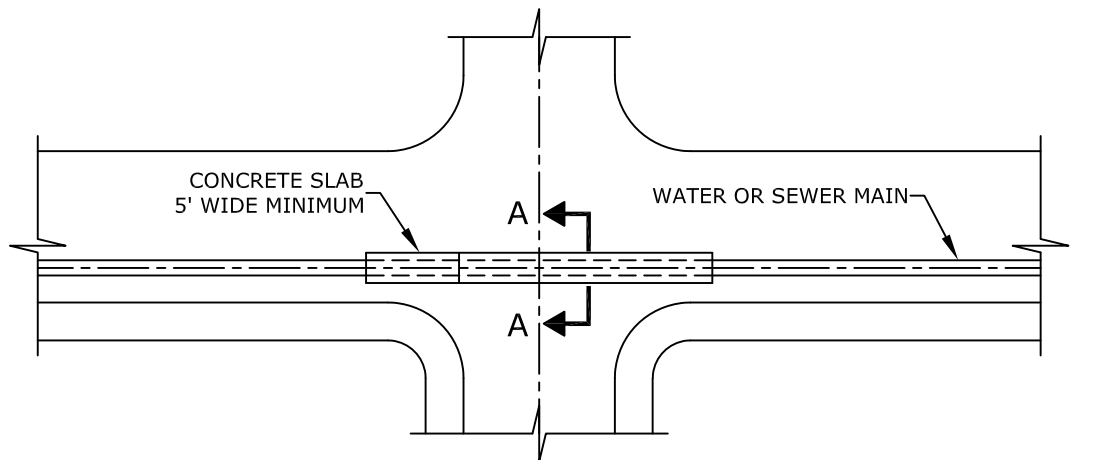

NOTES:


1. CONCRETE SLAB TO BE DESIGNED BY ENGINEER OF RECORD.
2. EXTEND CONCRETE SLAB UNTIL COVER EXCEEDS 30 INCHES FOR DIP OR 36 INCHES FOR PVC.
3. CONCRETE TO BE 3,000 PSI MINIMUM.
4. THIS DETAIL TO BE USED ONLY UPON WRITTEN APPROVAL FROM WWS TECHNICAL STANDARDS COMMITTEE.

REVISED

7/7/2021

**CONCRETE SLAB
OVER SHALLOW PIPELINES**

**FIGURE
195**

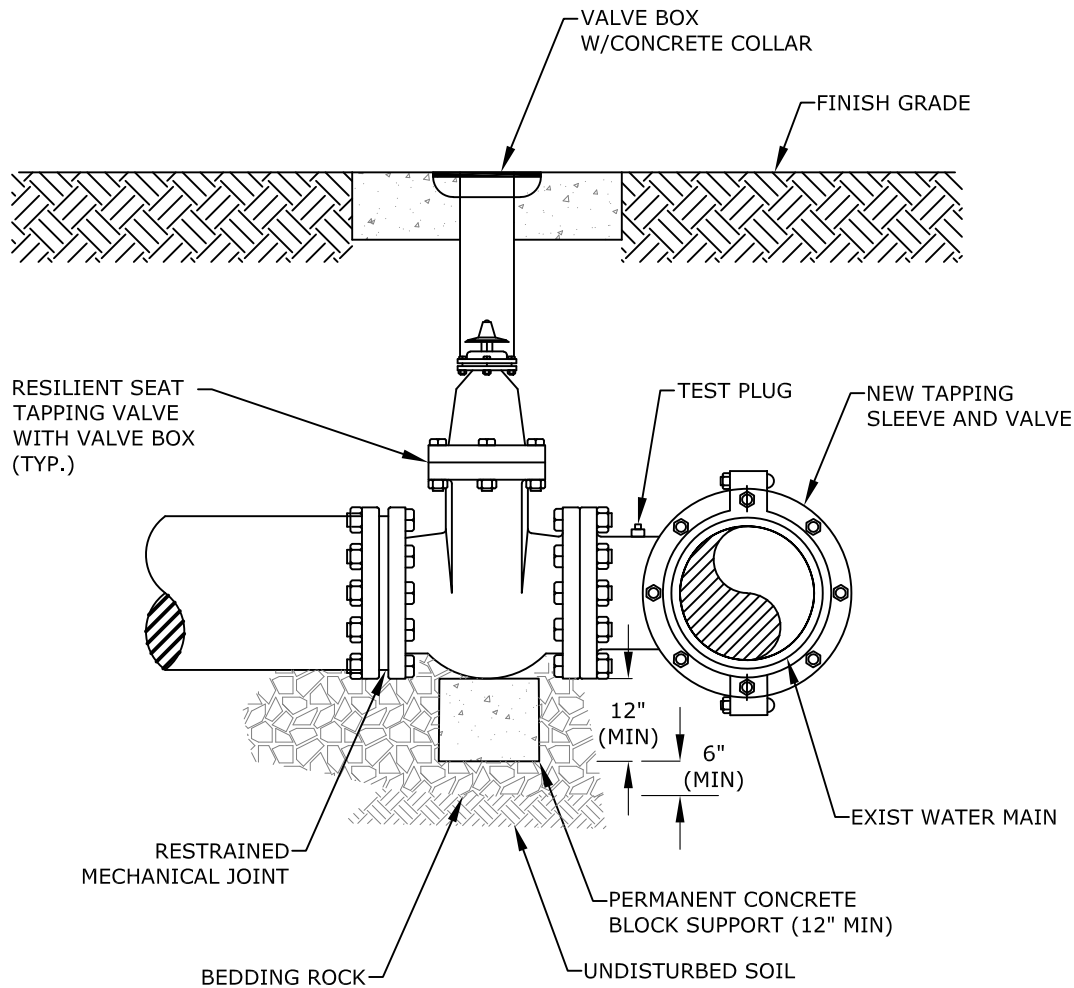

NOTES:

1. REFER TO WWS MINIMUM DESIGN AND CONSTRUCTION STANDARDS FOR MINIMUM REQUIREMENTS AND PRE-APPROVED MANUFACTURERS.
2. MAIN SHALL BE CLEANED BEFORE ATTACHING SLEEVE
3. SLEEVE AND VALVE SHALL BE PRESSURE TESTED BEFORE MAKING TAP. PRESSURE TEST AND TAP SHALL BE MADE IN PRESENCE OF AN AUTHORIZED COUNTY REPRESENTATIVE.
4. TAP SHALL BE MADE NO CLOSER THAN 18" FROM THE NEAREST JOINT.
5. CONCRETE BLOCK SHALL COMPLETELY SUPPORT TAPPING VALVE.
6. RESTRAINT JOINT REQUIREMENTS SHALL BE IN ACCORDANCE WITH WWS MINIMUM DESIGN AND CONSTRUCTION STANDARDS.

REVISED

7/7/2021

**TAPPING SLEEVE AND VALVE
INSTALLATION**



**FIGURE
196**

**BROWARD COUNTY
PUBLIC WORKS DEPARTMENT**

PLOTTED: 10/2024

**WATER & WASTEWATER SERVICES
ENGINEERING DIVISION**
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069
PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL

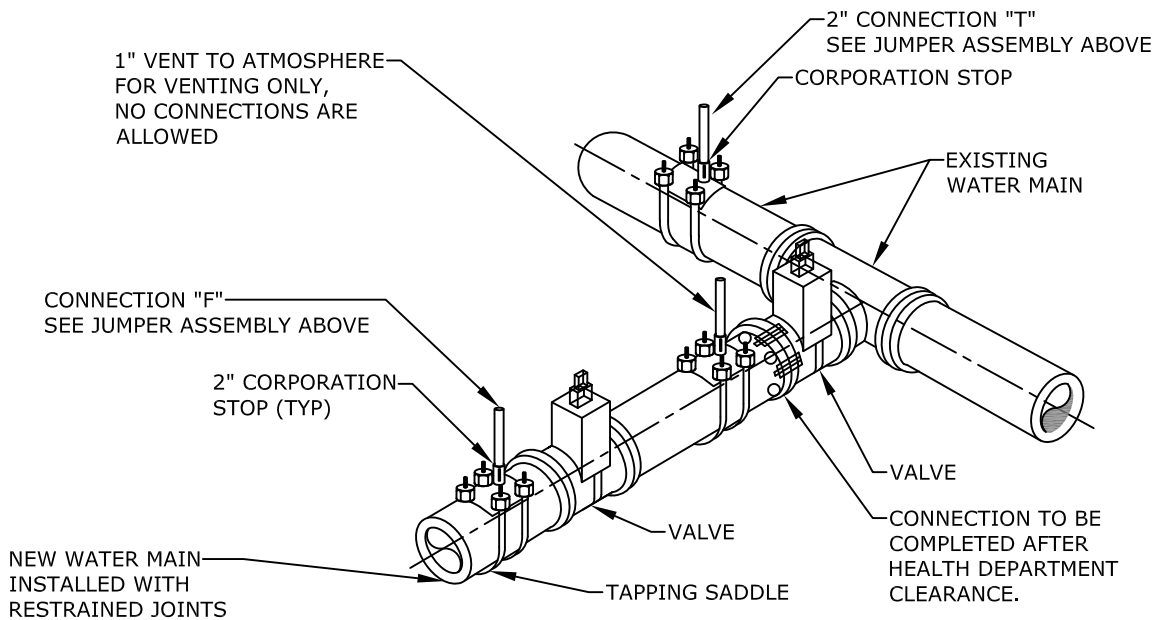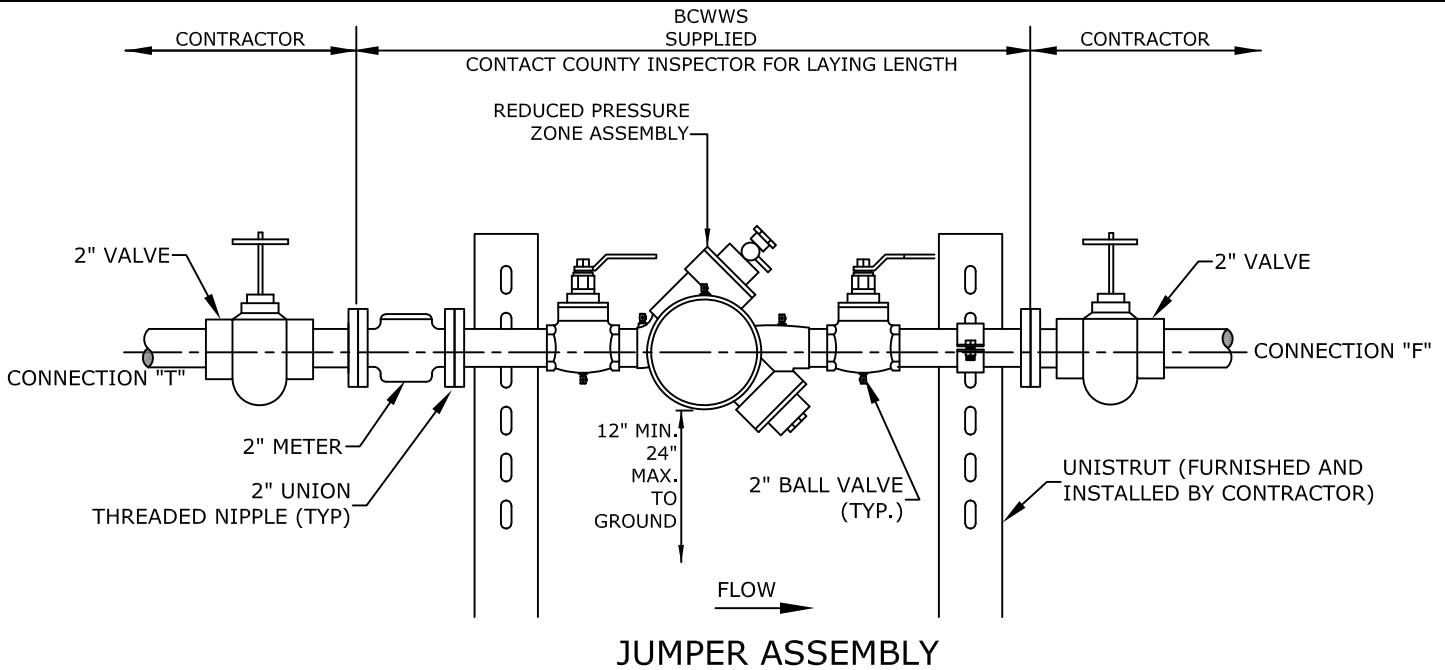

NOTES:

1. A BCWWS SUPPLIED FIRE HYDRANT BACKFLOW METER WITH RPZ MAY BE USED IN LIEU OF THE JUMPER ASSEMBLY.
2. SEE DETAIL 205B FOR ADDITIONAL REQUIREMENTS.

REVISED

7/7/2021

**FILLING AND FLUSHING
JUMPER CONNECTION**

**FIGURE
205A**

**BROWARD COUNTY
PUBLIC WORKS DEPARTMENT**

PLOTTED: 10/2024

**WATER & WASTEWATER SERVICES
ENGINEERING DIVISION
2555 WEST COPANS ROAD
POMPANO BEACH, FL 33069
PHONE NO. 954-831-0745
FAX: 954-831-0925**

STANDARD DETAIL


1. A FILLING AND FLUSHING JUMPER ASSEMBLY CONNECTION IS REQUIRED AT ALL CONNECTIONS BETWEEN EXISTING ACTIVE BCWWS WATER MAINS AND NEW WATER MAINS. THE PROCEDURES ARE APPLICABLE WHEN CONNECTING TO AN EXISTING BCWWS WATER MAIN, WHETHER BY TAPPING TEE AND VALVE OR BY CONTINUATION OF A PLUGGED STUB OUT WITH AN EXISTING GATE VALVE.
2. THE CONTRACTOR SHALL CONTACT BCWWS REGARDING SCHEDULING OF REQUIRED INSPECTIONS RELATING TO THE CONNECTION. BCWWS INSPECTIONS ARE SPECIFICALLY REQUIRED FOR TIE-INS OR WET TAPS TO EXISTING WATER MAINS, JUMPER ASSEMBLY CONNECTION INSTALLATION, FLUSHING, PRESSURE TESTING, DISINFECTION, SAMPLING, PLUGGING OF SAMPLING POINTS AND PERMANENT CONNECTION OF THE NEW WATER MAIN. THE CONTRACTOR SHALL FOLLOW ALL PROCEDURES STRICTLY IN ACCORDANCE WITH BCWWS STANDARDS.
3. THE JUMPER ASSEMBLY (2" DIAMETER FLANGE TO FLANGE) WILL BE SUPPLIED BY BCWWS AND INSTALLED AND TESTED BY THE CONTRACTOR, IN COORDINATION WITH THE ENGINEER OF RECORD (EOR) AND BCWWS. OTHER MATERIALS AND INSTALLATION REQUIRED FOR THE CONNECTION ARE THE RESPONSIBILITY OF THE CONTRACTOR. THE UNDERGROUND FITTINGS SHALL BE RESTRAINED MECHANICAL JOINT TYPE. ALL MATERIALS SHALL BE PER THE BCWWS APPROVED PRODUCT SPECIFICATION SHEETS. THE JUMPER SHALL BE MAINTAINED BY THE CONTRACTOR UNTIL IT IS REMOVED. JUMPER ASSEMBLIES 3" AND LARGER SHALL BE SUPPLIED AND INSTALLED BY THE CONTRACTOR IN COORDINATION WITH BCWWS.
4. ALL NEW WATER MAINS SHALL BE FLUSHED, PRESSURE TESTED AND DISINFECTED. NEW MAINS SHALL NOT BE PLACED INTO SERVICE UNTIL THE BACTERIOLOGICAL TEST RESULTS ARE SATISFACTORY AND A WRITTEN APPROVAL HAS BEEN OBTAINED FROM BCWWS, AS WELL AS CERTIFICATION FROM THE FLORIDA DEPARTMENT OF HEALTH.
5. THE WATER MAINS SHALL BE PRESSURE TESTED AFTER FLUSHING AND PRIOR TO DISINFECTION. ALL VALVES SHALL REMAIN CLOSED DURING THE PRESSURE TEST AND WILL NOT BE OPENED UNTIL THE RESULTS OF PRESSURE TESTING AND BACTERIOLOGICAL TESTING ARE SATISFACTORY AND THE SYSTEM HAS BEEN ACCEPTED FOR OPERATION BY BCWWS, AND HAS RECEIVED CERTIFICATION FROM THE FLORIDA DEPARTMENT OF HEALTH.
6. DISINFECTION SHALL BE CONDUCTED IN ACCORDANCE WITH AWWA C651. A MINIMUM PRESSURE OF 25 PSI SHALL BE MAINTAINED IN THE NEW MAIN AFTER DISINFECTION AT ALL TIMES.
7. PERMANENT CONNECTION TO EXISTING MAINS BY OPENING OF MAIN VALVES SHALL NOT BE MADE PRIOR TO BACTERIOLOGICAL CLEARANCE AND UNTIL APPROVED BY BCWWS AND CERTIFIED BY THE FLORIDA DEPARTMENT OF HEALTH.
8. UPON BACTERIOLOGICAL CLEARANCE, THE SAMPLING POINTS SHALL BE REMOVED AND PLUGGED BY THE CONTRACTOR. THE CONTRACTOR SHALL MAKE THE PERMANENT CONNECTION IN THE PRESENCE OF A BCWWS INSPECTOR. THE PIPE AND FITTINGS FOR CONNECTION SHALL BE DISINFECTED BY SPRAYING AND SWABBING WITH CHLORINE. THE JUMPER ASSEMBLY (FLANGE TO FLANGE) WILL BE REMOVED BY THE CONTRACTOR IN COORDINATION WITH BCWWS. THE CONTRACTOR SHALL REMOVE THE REMAINDER OF THE JUMPER CONNECTION PIPING AND PLUG THE CORPORATION STOP VALVES.

REVISED

7/7/2021

**FILLING AND FLUSHING
JUMPER CONNECTION**

**FIGURE
205B**

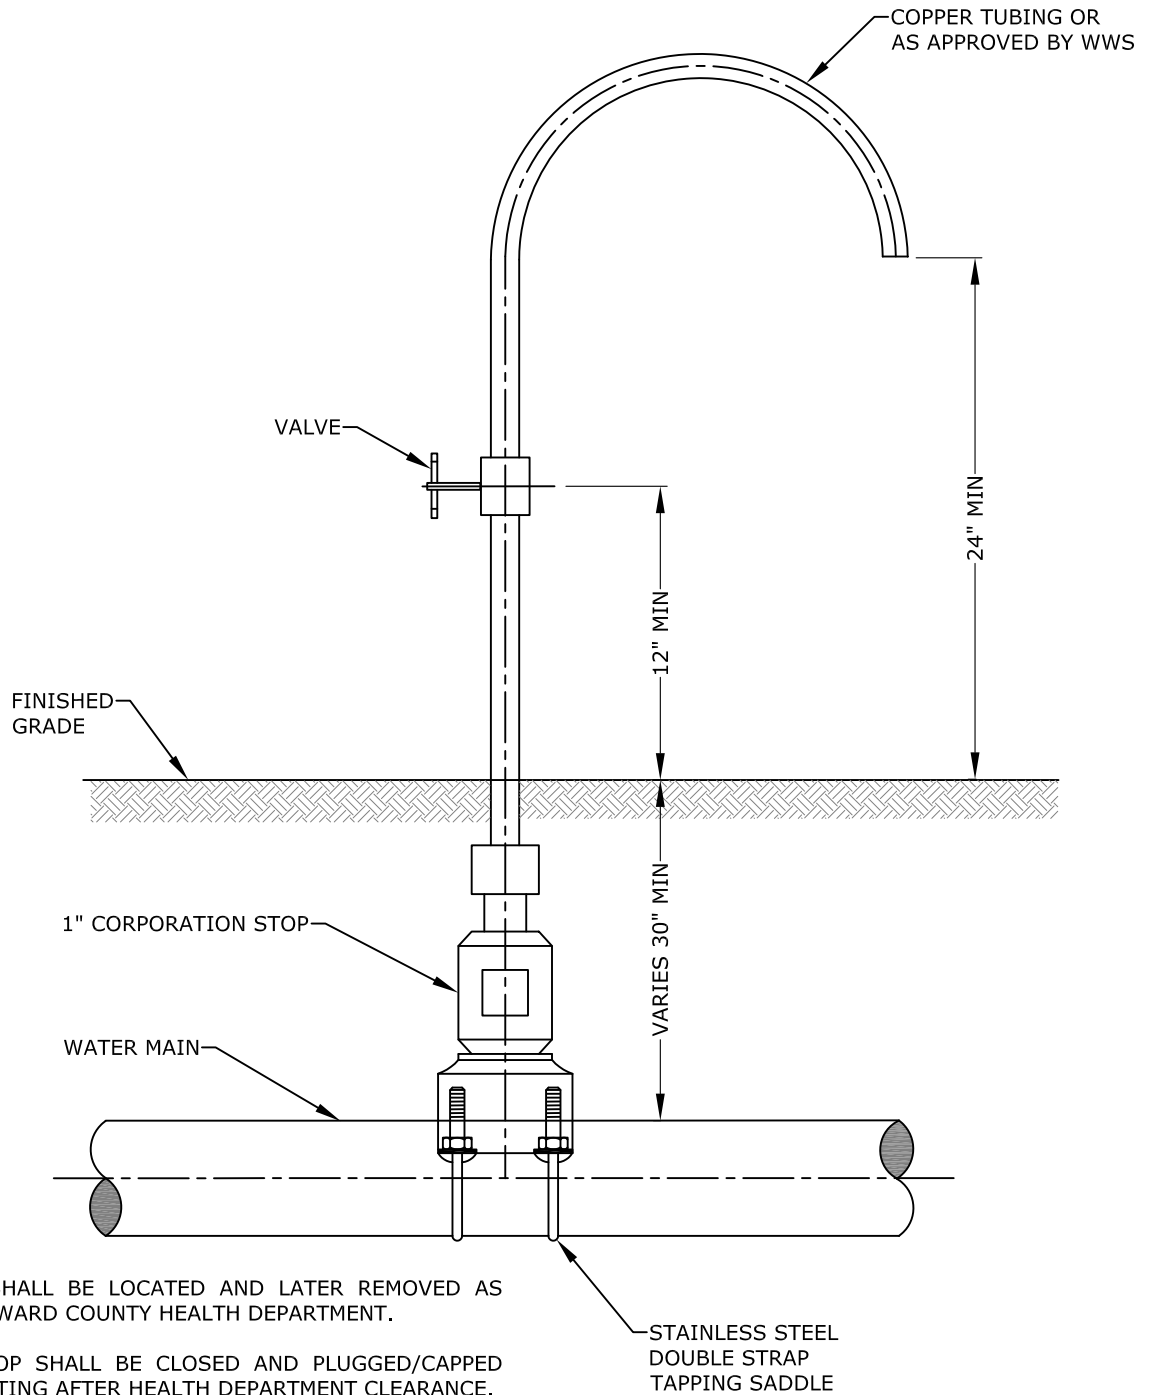

NOTES:

1. SAMPLE POINTS SHALL BE LOCATED AND LATER REMOVED AS REQUIRED BY BROWARD COUNTY HEALTH DEPARTMENT.
2. CORPORATION STOP SHALL BE CLOSED AND PLUGGED/CAPPED WITH A BRASS FITTING AFTER HEALTH DEPARTMENT CLEARANCE.
3. SAMPLING POINTS MAY BE PLACED AT THE ENDS OF WATER SERVICES BEFORE THE METERS AND ON BLOW OFFS FOR TERMINAL WATER MAINS, WHERE SERVICES AND BLOW OFFS ARE REQUIRED BY THE PLANS.


REVISED

7/7/2021

SAMPLING POINT

FIGURE
206

FIGURE
221

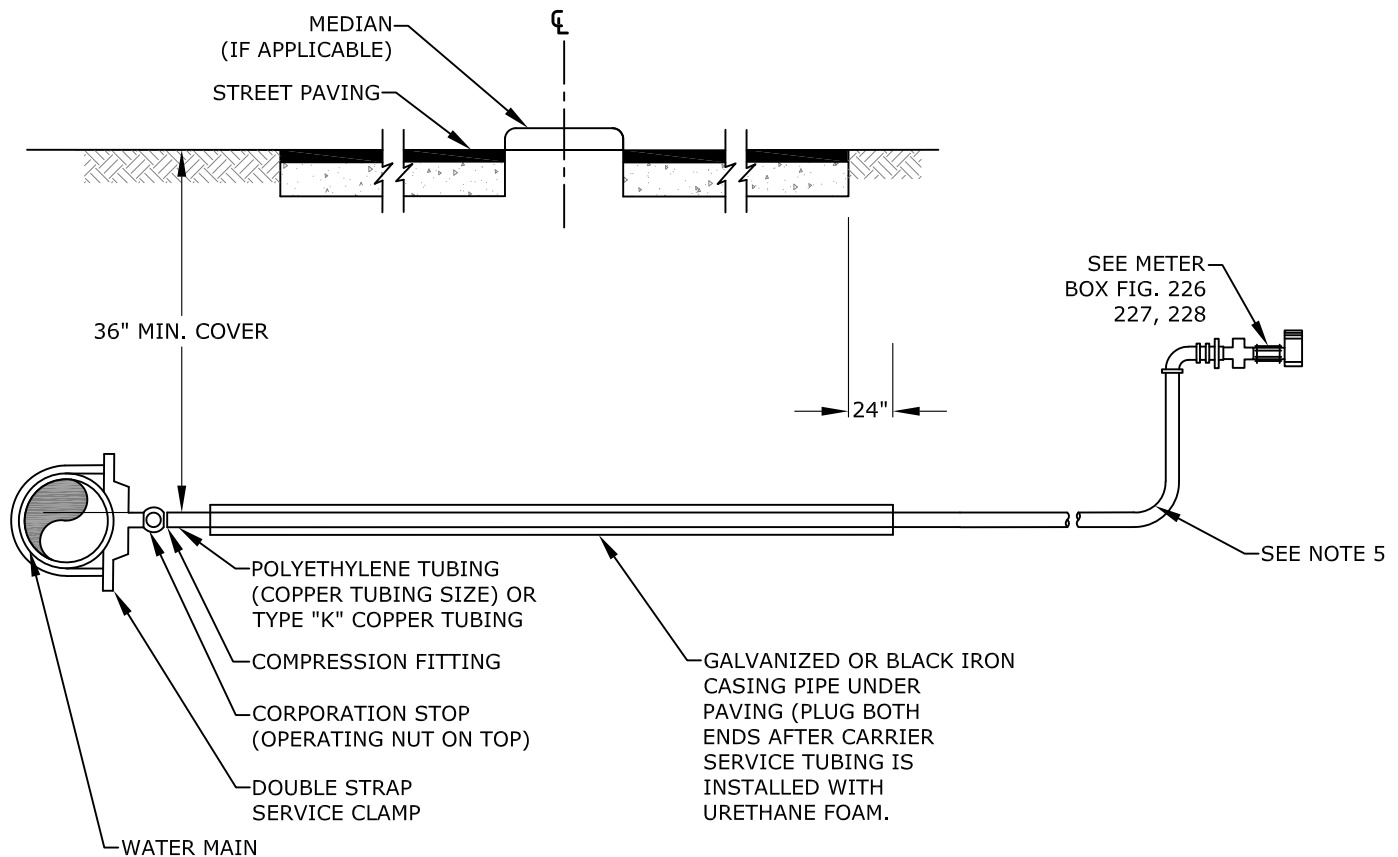

NOTES:

1. SUCCESSIVE TAPS INTO THE WATER MAIN SHALL BE SPACED NOT LESS THAN 18" ON CENTER. NO TAPS SHALL BE CLOSER THAN 18" TO A JOINT.
2. 1" SERVICES REQUIRE A 2" MINIMUM INSIDE DIAMETER CASING PIPE.
3. 2" SERVICES REQUIRE A 3" MINIMUM INSIDE DIAMETER CASING PIPE.
4. ALL CASING PIPE SHALL EXTEND A MINIMUM OF 2' BEYOND THE EDGE OF PAVED STREETS.
5. FOR 1" SERVICE LINES THE MINIMUM RADIUS SHALL BE 14". FOR 2" SERVICE LINES THE MINIMUM RADIUS SHALL BE 21".
6. ALL CASING PIPE ENDS SHALL BE FILED SMOOTH WITH NO BURRS AND SEALED WITH URETHANE FOAM.
7. THE POLYETHYLENE OR COPPER TUBING SHALL BE ONE CONTINUOUS PIECE FROM THE CORPORATION STOP TO THE CHECK VALVE. NO JOINTS WILL BE PERMITTED BETWEEN THESE POINTS.


THIS DETAIL APPLIES ONLY TO COUNTY ARTERIAL AND
COLLECTOR ROADS (70' TO 120' R/W) AND ALL STATE ROAD R/W

REVISED

7/7/2021

**TYPE 2 WATER
SERVICE CONNECTION**

**FIGURE
222**

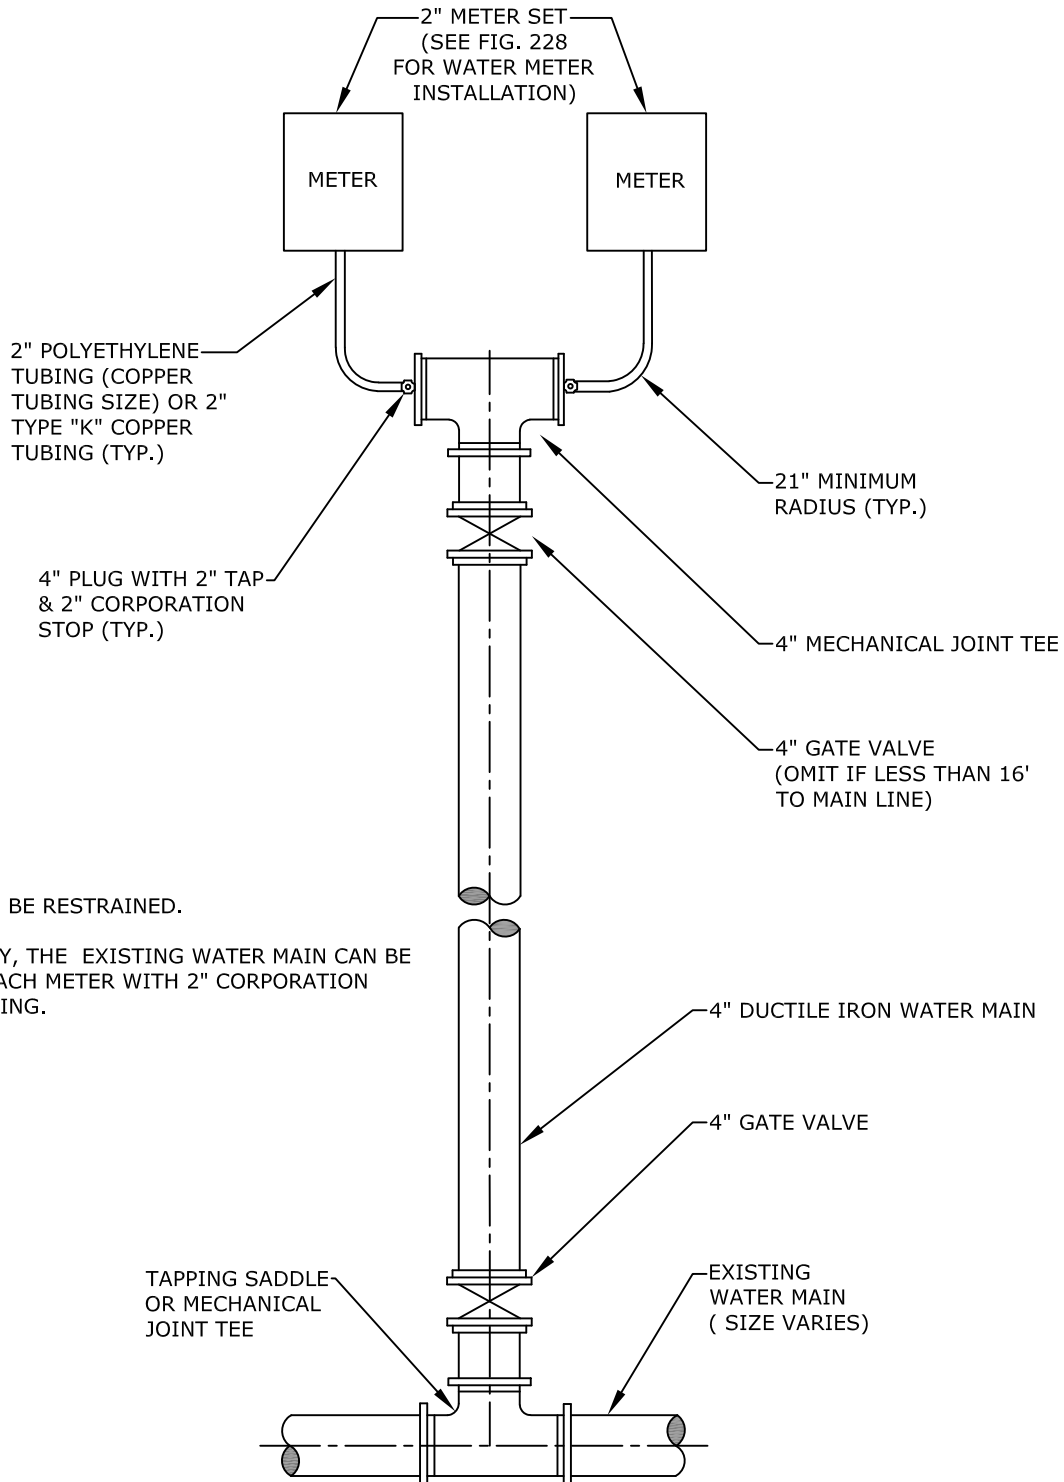

NOTES:


1. ALL JOINTS TO BE RESTRAINED.
2. ALTERNATIVELY, THE EXISTING WATER MAIN CAN BE TAPPED FOR EACH METER WITH 2" CORPORATION STOP AND TUBING.

REVISED

7/7/2021

**METER INSTALLATION
FOR TWO 2" METERS**

**FIGURE
224**

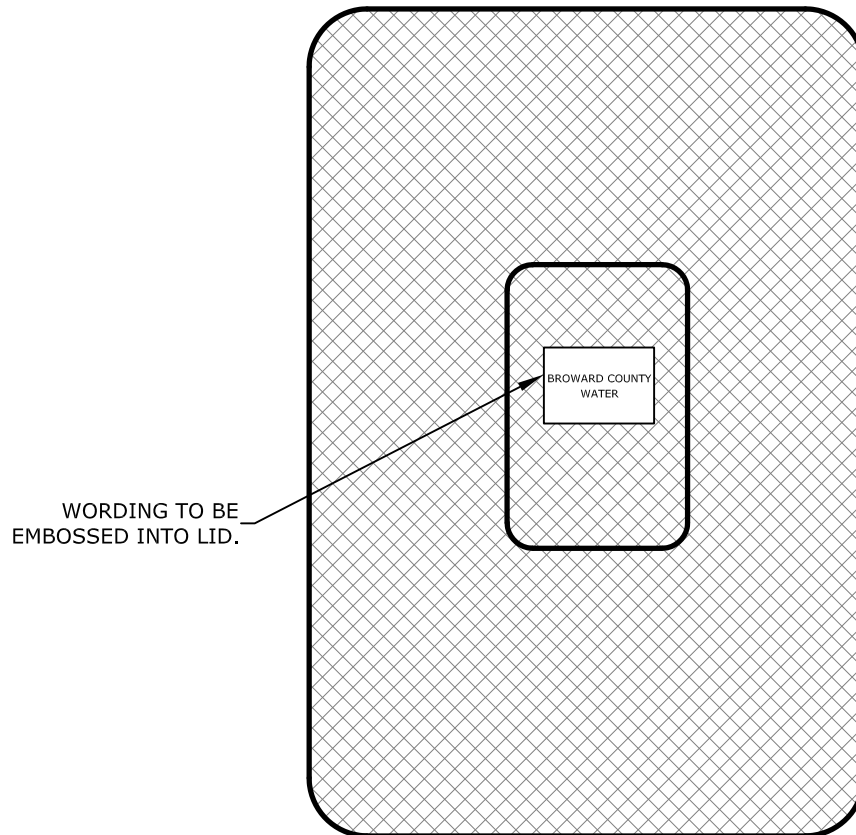


REVISED

7/7/2021

POTABLE WATER METER BOX COVER

FIGURE
225

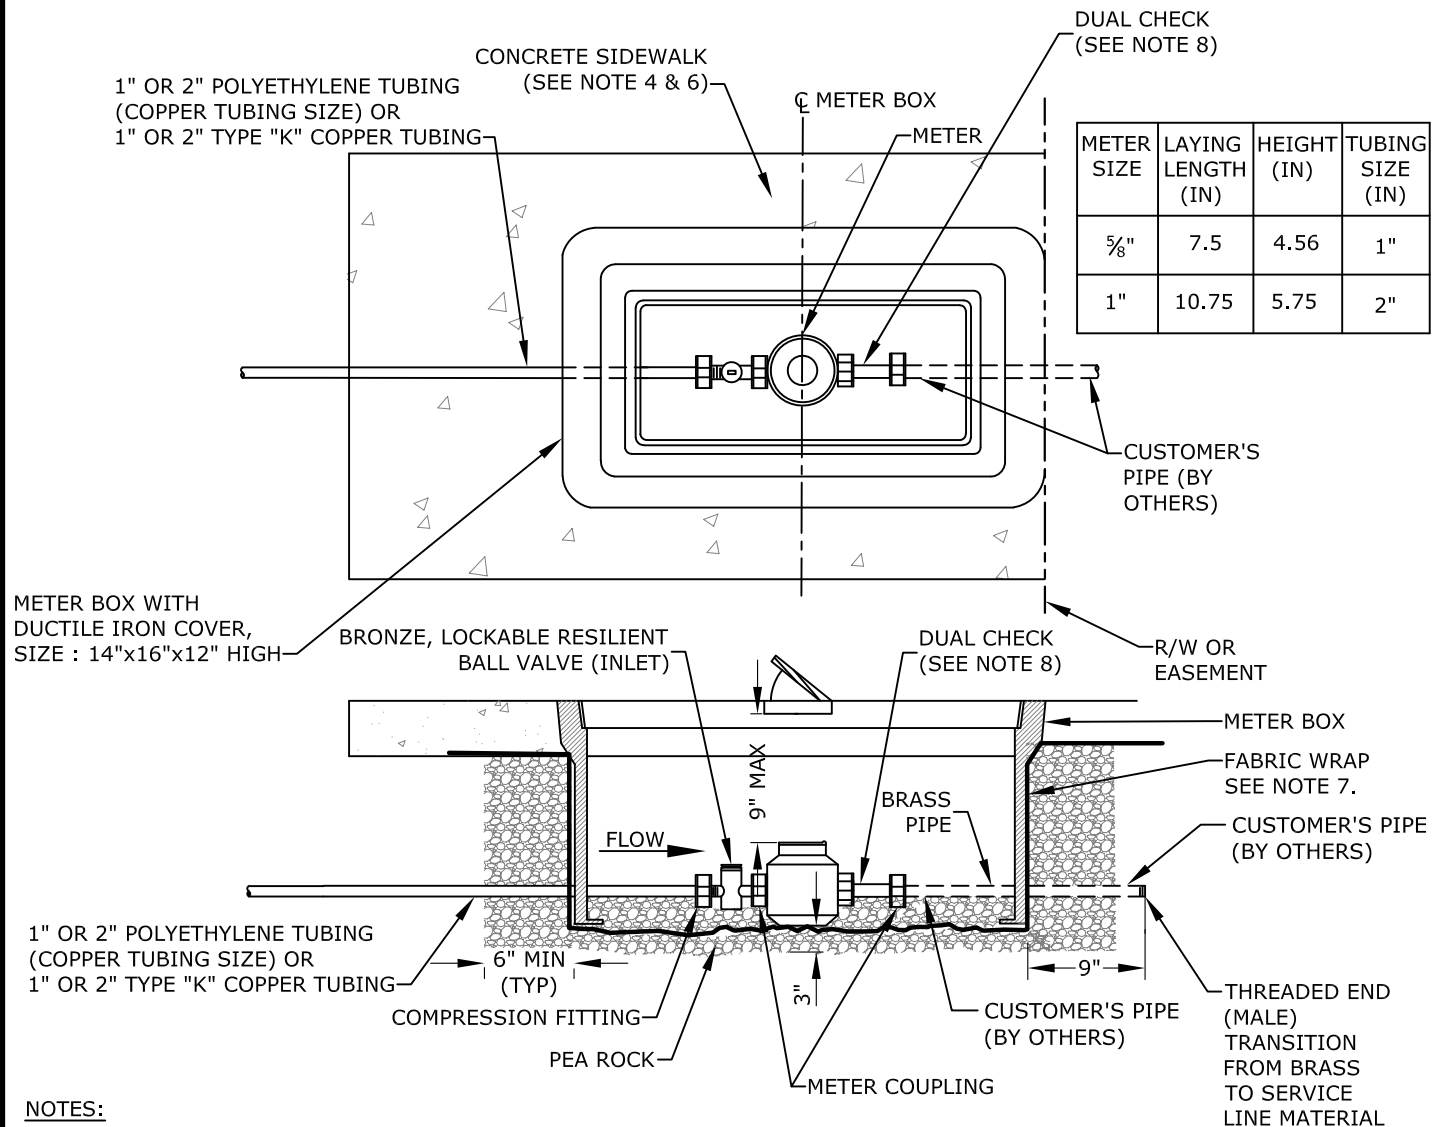

NOTES:


1. ALL STRUCTURES TO BE TRAFFIC BEARING TYPE.
2. CURVE IN SERVICE LINE SHALL BE AS CLOSE TO METER BOX AS PRACTICAL, WITH A MINIMUM RADIUS OF 14\" FOR 1\" TUBING AND 21\" FOR 2\" TUBING. 5/8\" METERS SHALL HAVE A 1\" SERVICE LINE, AND 1\" METERS SHALL HAVE A 2\" SERVICE LINE.
3. ALL METERS WILL BE SUPPLIED AND INSTALLED BY WWS. METER HAS IRON PIPE THREAD MALE CONNECTION ON EACH END.
4. WHEN SIDEWALKS ARE PRESENT, OR PLANNED FOR IN THE R/W, THE BACK EDGE OF THE METER BOX SHALL LINE UP WITH THE BACK EDGE OF THE SIDEWALK.
5. METER SHALL BE CENTERED IN BOX DIRECTLY UNDER THE ACCESS LID. BALL VALVE AND BOTH METER COUPLINGS SHALL BE VISIBLE IN THE METER BOX.
6. WHEN THERE ARE NO SIDEWALKS, CONSTRUCT 6\" WIDE x 6\" THICK CONCRETE COLLAR AT GRADE.
7. AT BOTH PIPE PENETRATIONS THROUGH THE FABRIC WRAP, THE FABRIC SHALL BE PULLED TIGHT AROUND THE PIPE AND SECURED WITH TWO GRADE 316 STAINLESS STEEL HOSE CLAMPS TO PROVIDE A TIGHT SEAL AROUND PIPE.
8. DUAL CHECK ON SINGLE FAMILY HOUSE METERS ONLY. ALL OTHER METERS TO HAVE DOWNSTREAM ABOVE-GROUND BACK FLOW PREVENTER.

REVISED

7/7/2021

**WATER METER INSTALLATION
FOR 5/8\" AND 1\" METERS**

**FIGURE
226**

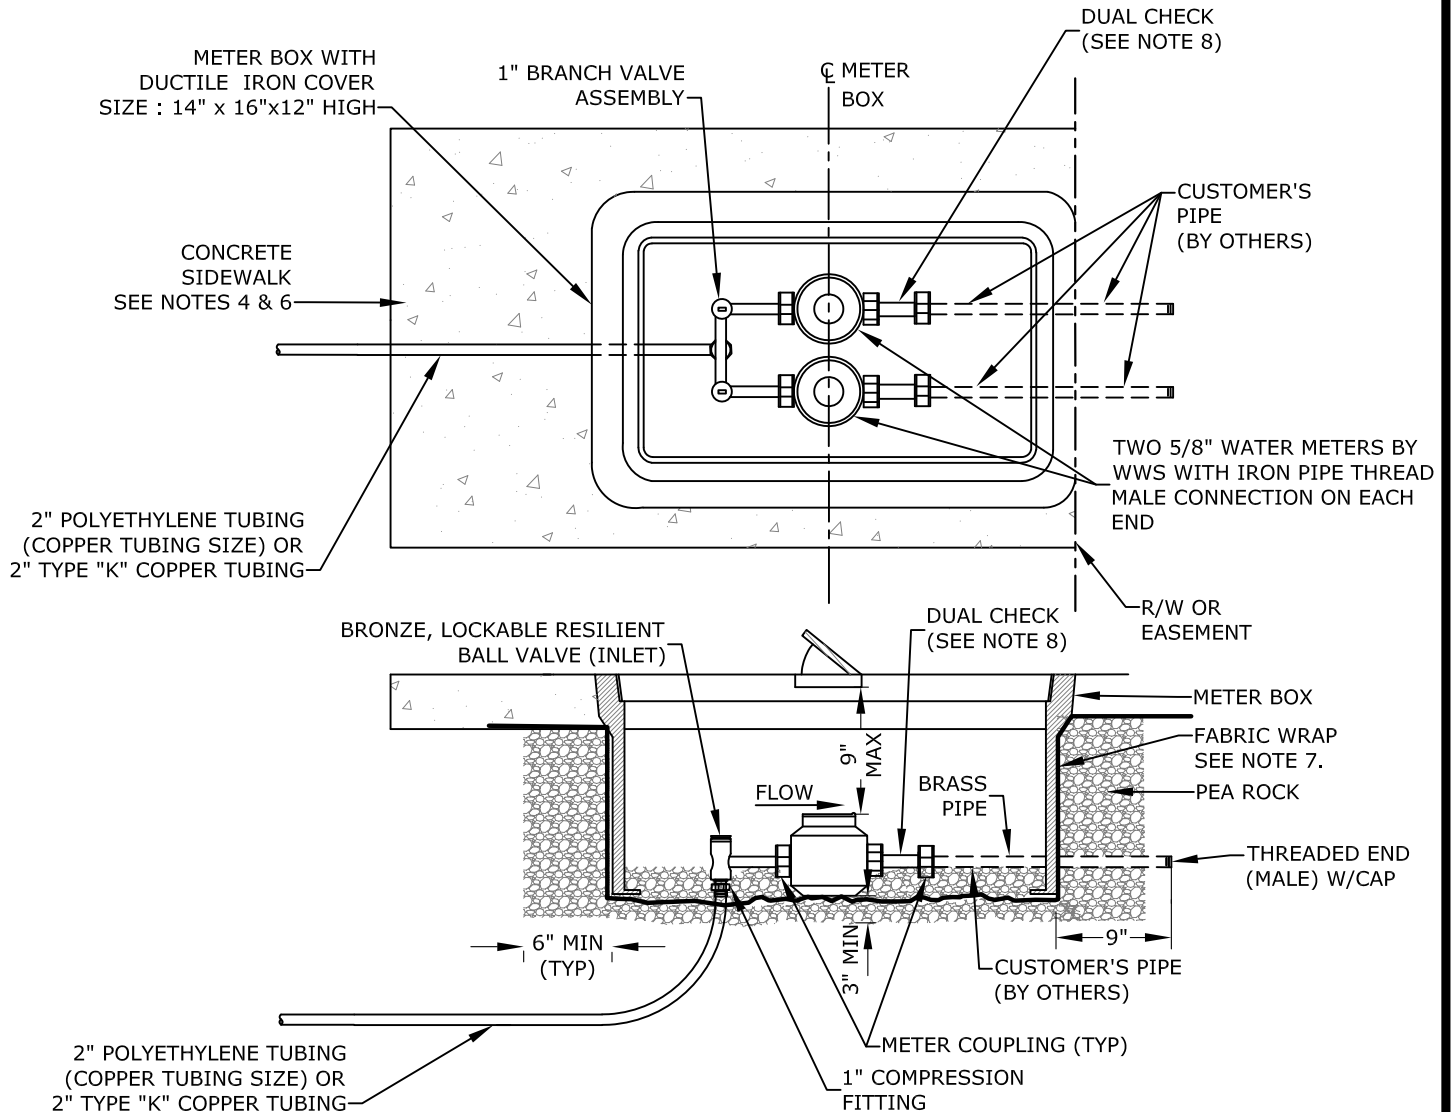


1. ALL STRUCTURES TO BE TRAFFIC BEARING TYPE.
2. CURVE IN SERVICE LINE SHALL BE AS CLOSE TO METER BOX AS PRACTICAL, WITH A MINIMUM RADIUS SHALL BE 21" FOR 2" TUBING.
3. ALL METERS WILL BE SUPPLIED AND INSTALLED BY WWS. METER HAS IRON PIPE THREAD MALE CONNECTION ON EACH END.
4. WHEN SIDEWALKS ARE PRESENT, OR PLANNED FOR IN THE R/W, THE BACK EDGE OF THE METER BOX SHALL LINE UP WITH THE BACK EDGE OF THE SIDEWALK.
5. METER SHALL BE CENTERED IN BOX DIRECTLY UNDER THE ACCESS LID. BALL VALVE AND METER COUPLINGS SHALL BE VISIBLE INSIDE THE METER BOX.
6. WHEN THERE ARE NO SIDEWALKS, CONSTRUCT 6" WIDE x 6" THICK CONCRETE COLLAR AT GRADE.
7. AT BOTH PIPE PENETRATIONS THROUGH THE FABRIC WRAP, THE FABRIC SHALL BE PULLED TIGHT AROUND THE PIPE AND SECURED WITH TWO GRADE 316 STAINLESS STEEL HOSE CLAMPS TO PROVIDE A TIGHT SEAL AROUND PIPE.
8. DUAL CHECK ON SINGLE FAMILY HOUSE METERS ONLY. ALL OTHER METERS TO HAVE DOWNSTREAM ABOVEGROUND BACK FLOW PREVENTER.

REVISED

7/7/2021

**DOUBLE METER INSTALLATION
FOR TWO 5/8" METERS**

**FIGURE
227**

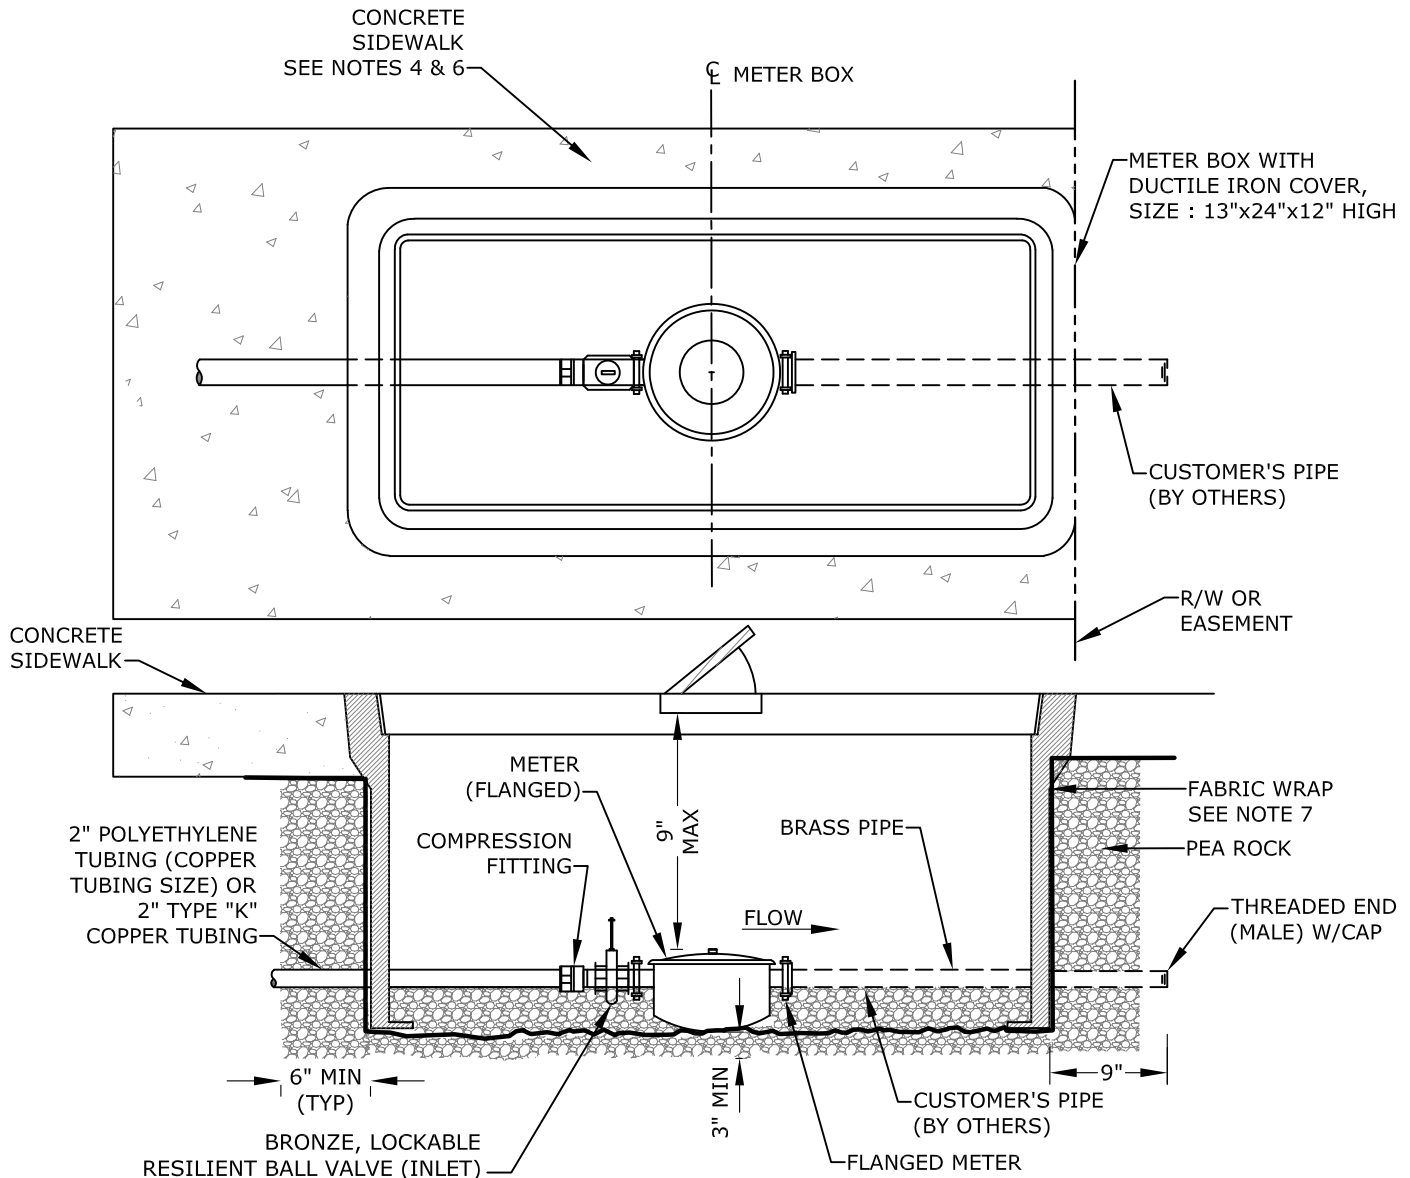

1. ALL STRUCTURES TO BE TRAFFIC BEARING TYPE.
2. CURVE IN SERVICE LINE SHALL BE AS CLOSE TO METER BOX AS PRACTICAL, WITH A MINIMUM RADIUS SHALL BE 21" FOR 2" TUBING.
3. ALL METERS WILL BE SUPPLIED AND INSTALLED BY WWS. METERS ARE FLANGED.
4. WHEN SIDEWALKS ARE PRESENT, OR PLANNED FOR IN THE R/W, THE BACK EDGE OF THE METER BOX SHALL LINE UP WITH THE BACK EDGE OF THE SIDEWALK.
5. METER SHALL BE CENTERED IN BOX DIRECTLY UNDER THE ACCESS LID.
6. WHEN THERE ARE NO SIDEWALKS, CONSTRUCT 6" WIDE x 6" THICK CONCRETE COLLAR AT GRADE.
7. AT BOTH PIPE PENETRATIONS THROUGH THE FABRIC WRAP, THE FABRIC SHALL BE PULLED TIGHT AROUND THE PIPE AND SECURED WITH TWO GRADE 316 STAINLESS STEEL HOSE CLAMPS TO PROVIDE A TIGHT SEAL AROUND PIPE.

METER SIZE	LAYING LENGTH (IN)	HEIGHT (IN)
1 ½"	13	6 ⅞"
2"	17	7 17/32"


REVISED

7/7/2021

**WATER METER INSTALLATION
FOR 1 ½" OR 2" METERS**

**FIGURE
228**

10/17/2021

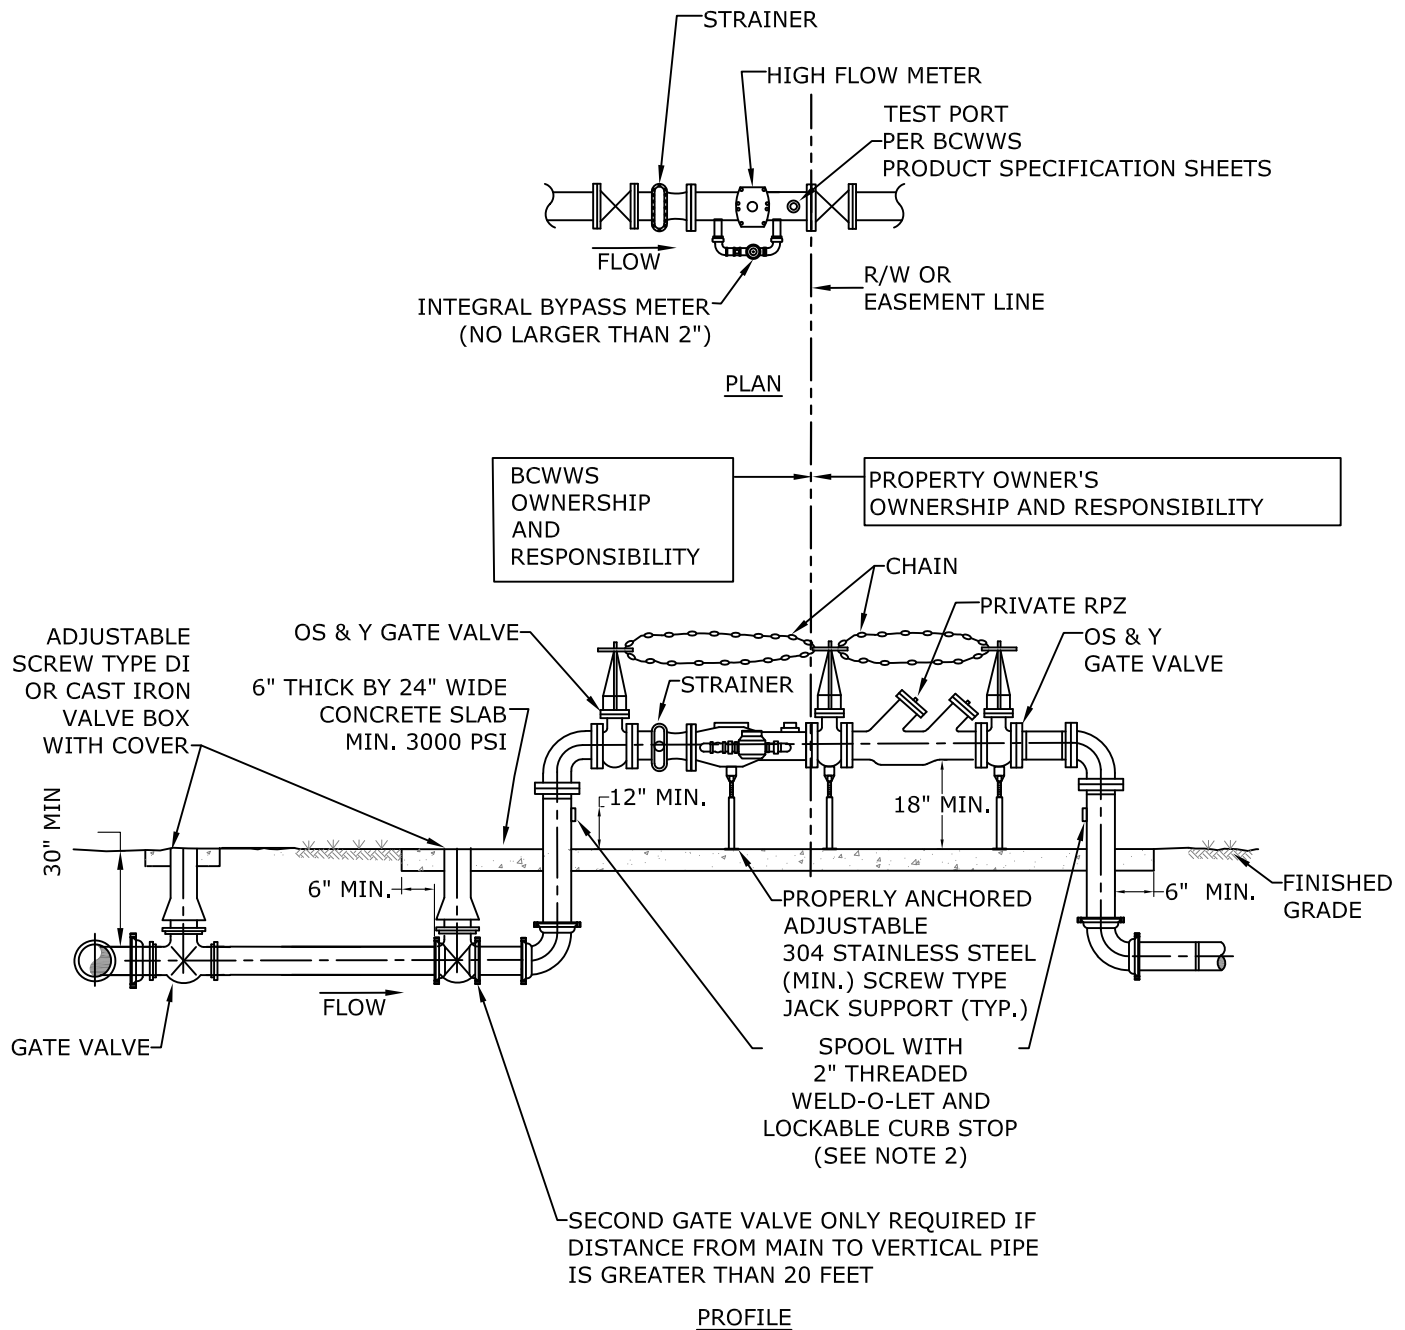


1. ALL ABOVE-GROUND PIPING, FITTINGS, GATE VALVES AND CHECK VALVES AND THE METER ASSEMBLY SHALL BE PAINTED WITH POLYURETHANE COATING (BLUE).
2. CURB STOPS TO FACE EACH OTHER.

REVISED

7/7/2021

3" OR 4" DOMESTIC WATER SERVICE

**FIGURE
234**

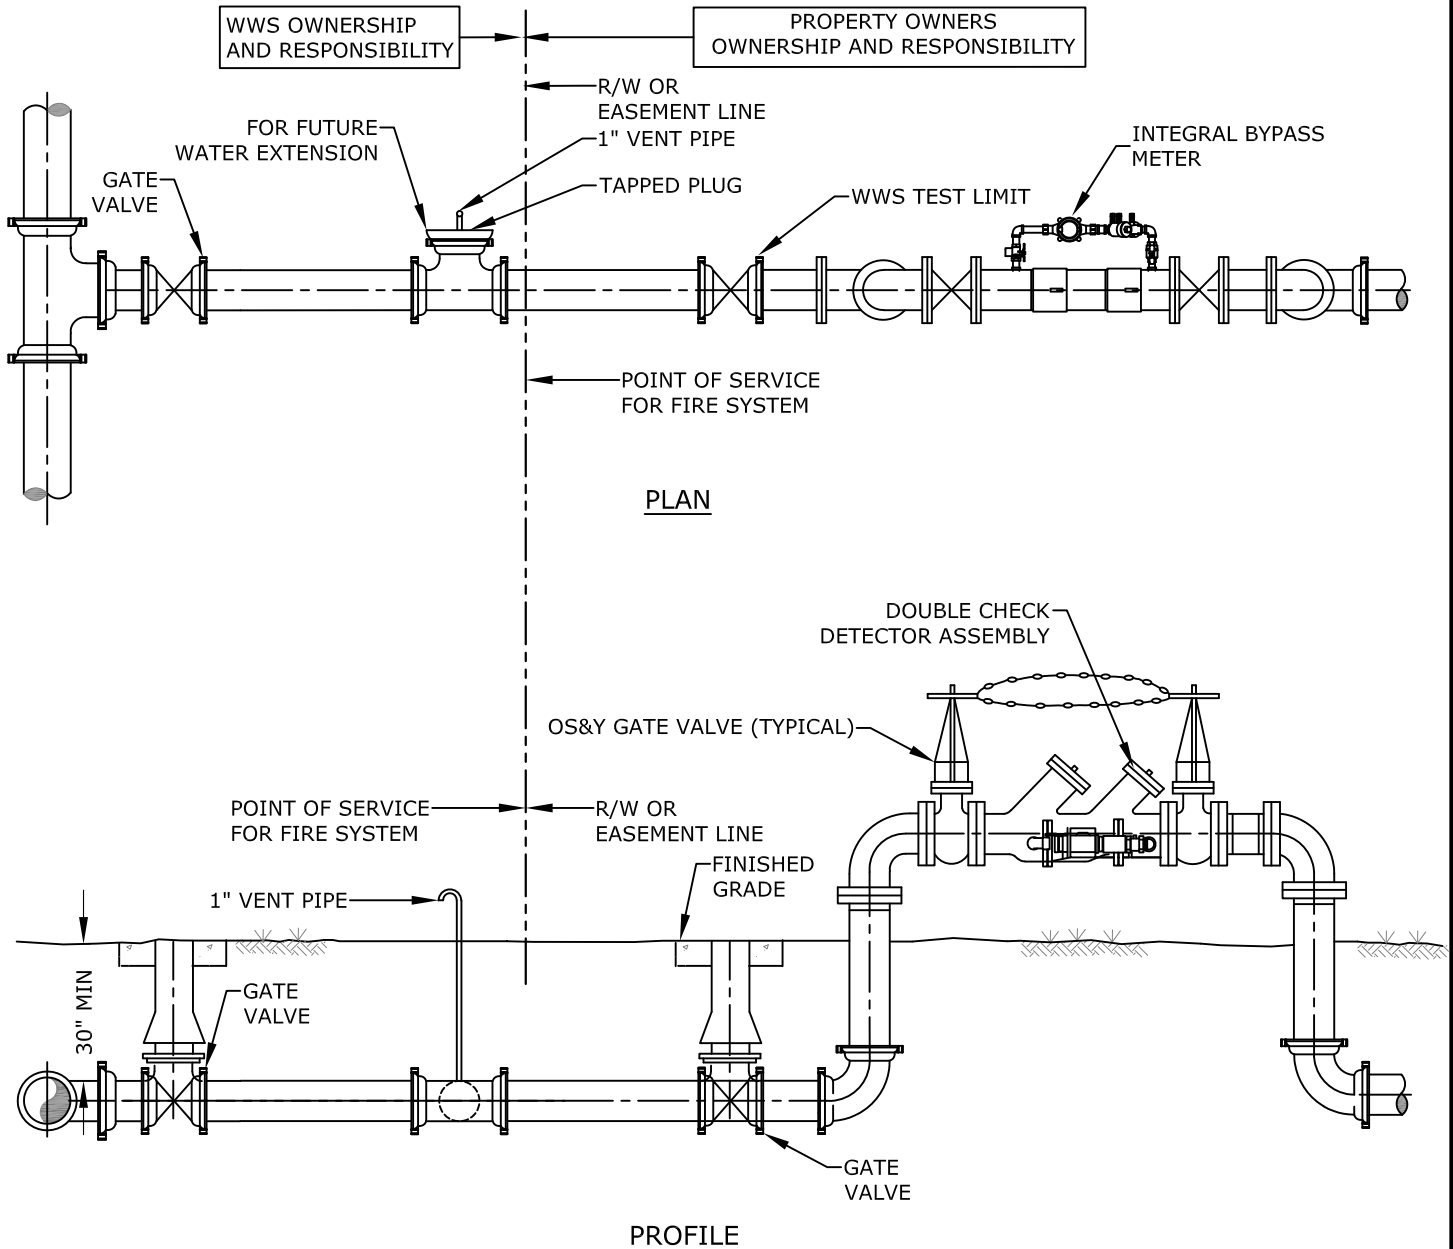

1. THE DOUBLE CHECK DETECTOR ASSEMBLY SHALL BE PRIVATELY OWNED BY PROPERTY OWNER. WWS WILL ONLY MAINTAIN THE BYPASS METER.
2. FIRE SYSTEM TO BE CONSTRUCTED/TESTED IN ACCORDANCE WITH NFPA STDS. & ALL APPLICABLE CODES.
3. 1" VENT PIPE TO BE REMOVED AFTER WWS APPROVAL.
4. INTEGRAL BYPASS METER MUST COME WITH A RED REGISTER CAP METER.
5. PROVIDE RED POLYURETHANE COATING.


DEDICATED FIRE SYSTEM

REVISED

7/7/2021

**TYPE 1
PRIVATE FIRE PROTECTION
4", 6" AND 8" DIAMETER CONNECTION**

**FIGURE
235**

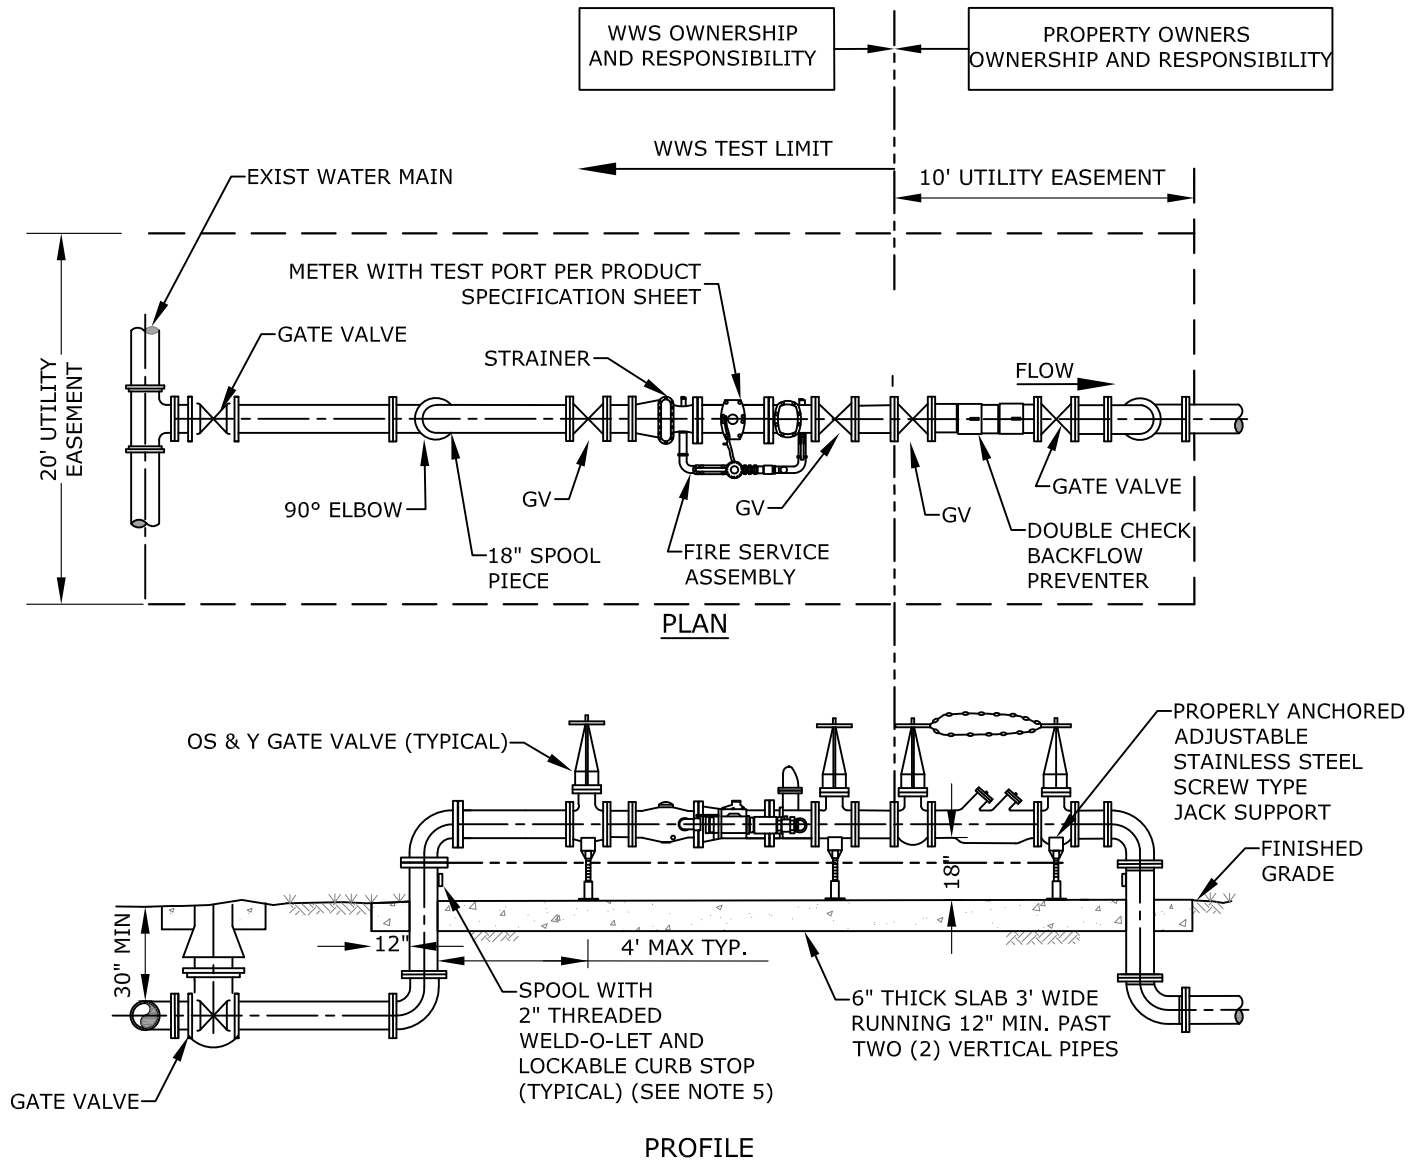

1. THE DOUBLE CHECK VALVE SHALL BE PRIVATELY OWNED BY THE PROPERTY OWNER.
2. EASEMENT SHALL BE PROVIDED IN ACCORDANCE WITH WWS MINIMUM REQUIREMENTS.
3. ALL ABOVE-GROUND PIPE SHALL BE FLANGED, DI (DUCTILE IRON) TYPE.
4. ALL PIPE LEADING FROM WATER MAIN TO FLANGED PIPING SHALL BE D.I. PIPE, RESTRAINED JOINTS.
5. ALL ABOVE-GROUND PIPING, FITTINGS, GATE VALVES AND CHECK VALVES AND THE METER ASSEMBLY SHALL BE PAINTED WITH POLYURETHANE COATING (BLUE).


**COMBINED DOMESTIC WATER SERVICE
AND FIRE PROTECTION**

REVISED

7/7/2021

**TYPE 2 PRIVATE
FIRE PROTECTION
4", 6" AND 8" DIAMETER CONNECTION**

**FIGURE
236**

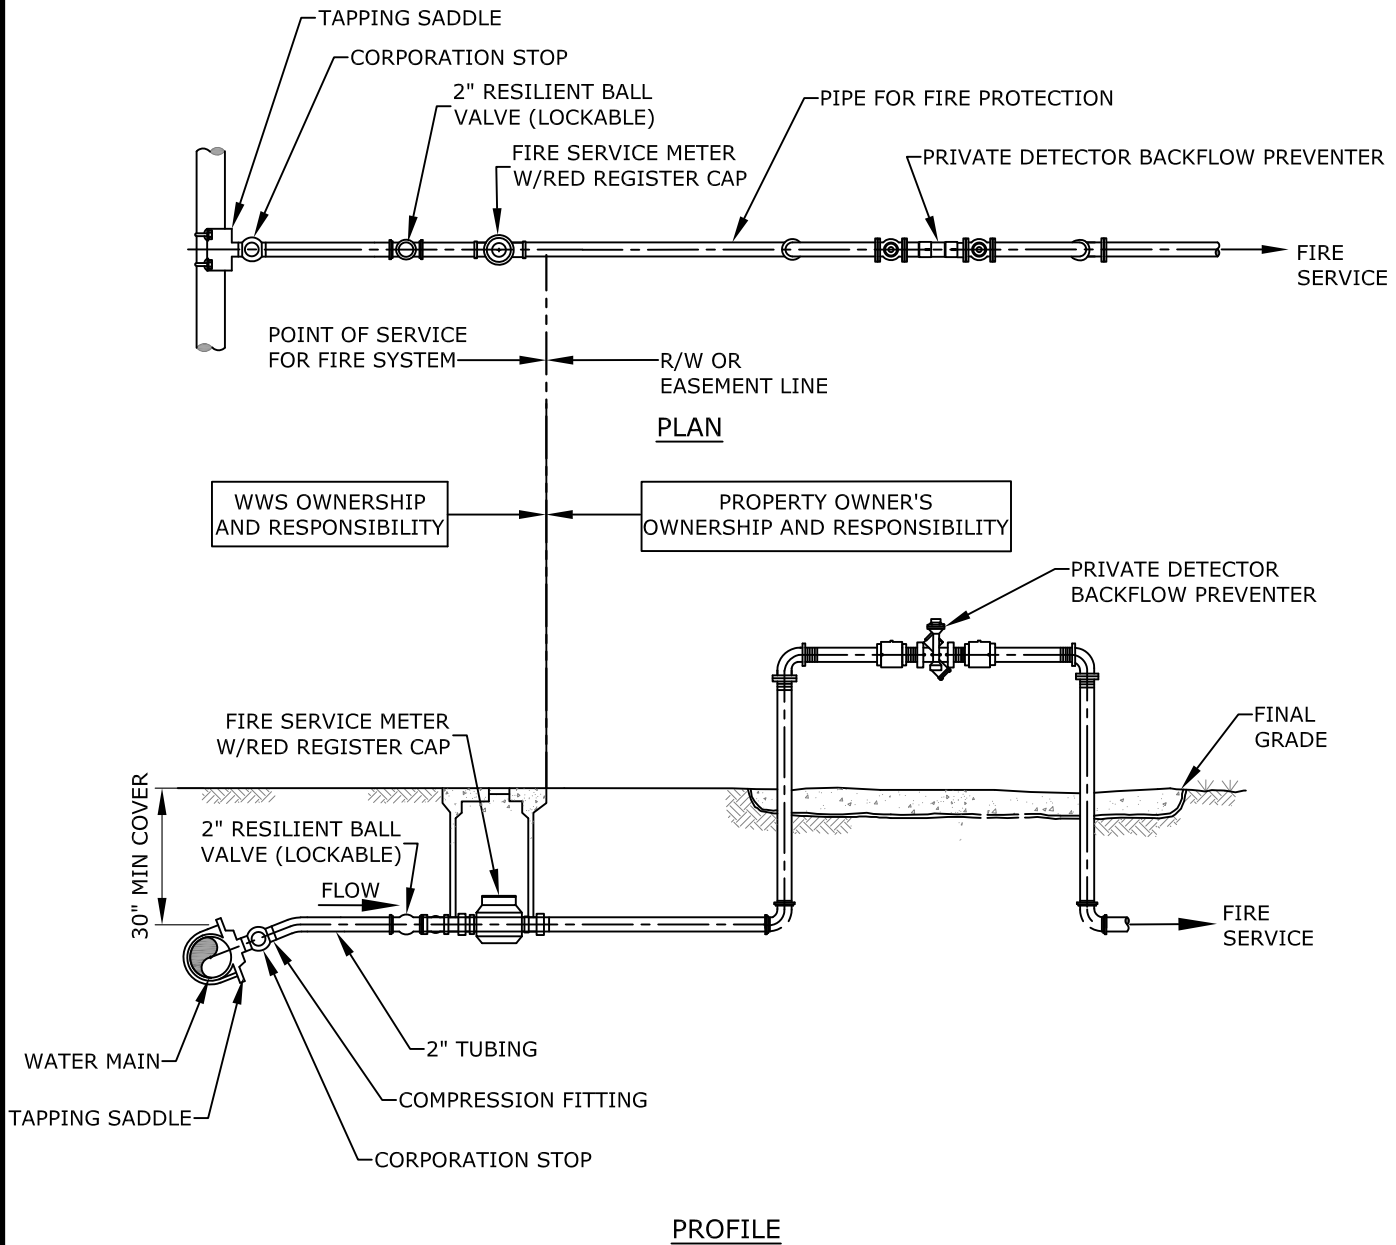


1. THE DOUBLE CHECK VALVE SHALL BE PRIVATELY OWNED BY PROPERTY OWNER.
2. FIRE SYSTEM TO BE CONSTRUCTED/TESTED IN ACCORDANCE WITH NATIONAL FIRE PROTECTION ASSOCIATION STANDARDS AND ALL APPLICABLE CODES.
3. METER BOX AND SERVICE LINE SHALL BE IN ACCORDANCE WITH WWS STANDARD DETAIL FOR WATER METER INSTALLATION AND NATIONAL FIRE PROTECTION STANDARDS AND CODES. USE TYPE "K" COPPER TUBING AND BRASS OR COPPER FITTINGS.
4. METER AND BACKFLOW DEVICE SHALL BE THE SAME SIZE.

REVISED

7/7/2021

**TYPE 3 PRIVATE
FIRE PROTECTION
2\" DIAMETER CONNECTION**

**FIGURE
237**

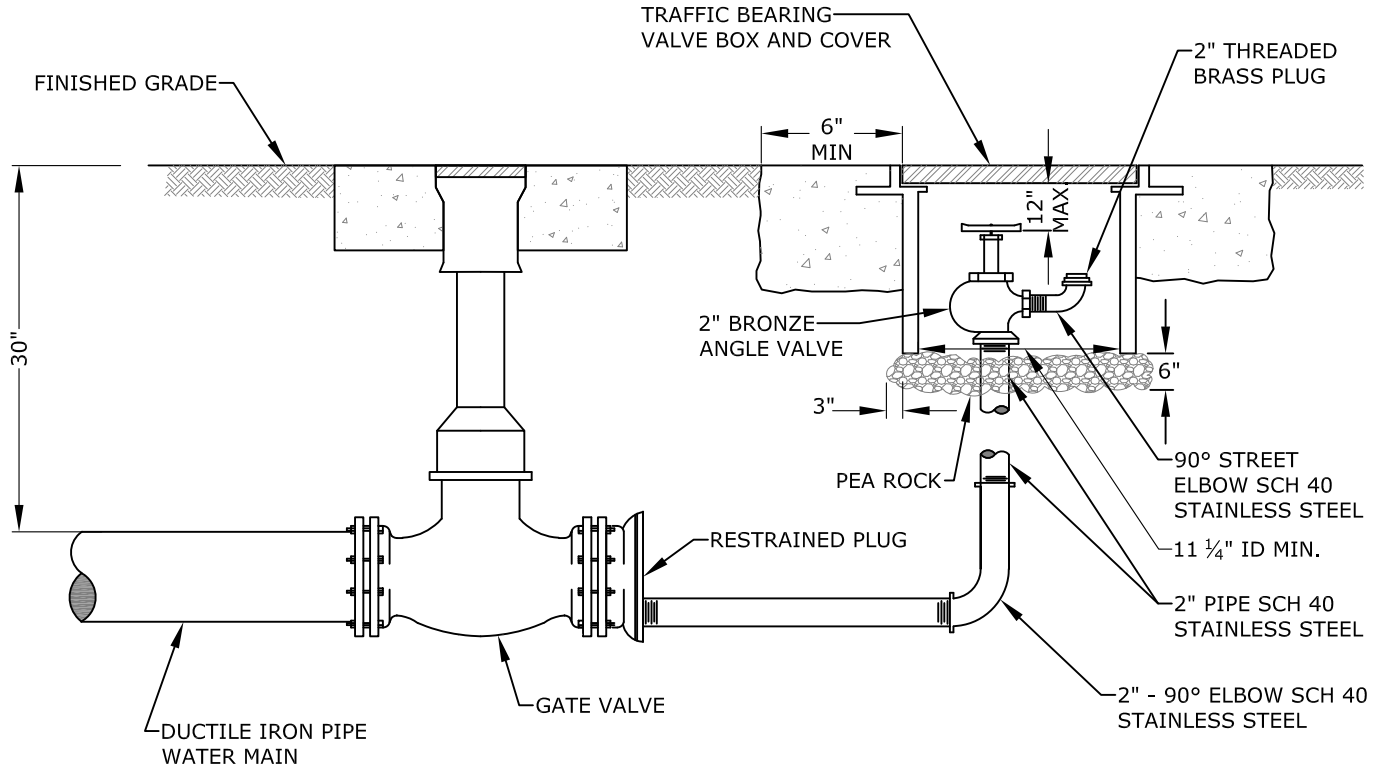

PROFILE


1. 2" TAP IN BOTTOM OF PLUG.
2. USE RESTRAINED JOINT PIPE.
3. IN GRASS AREA USE CONCRETE COLLARS, 6" THICK.

REVISED

7/7/2021

MANUAL BLOW OFF

FIGURE
252

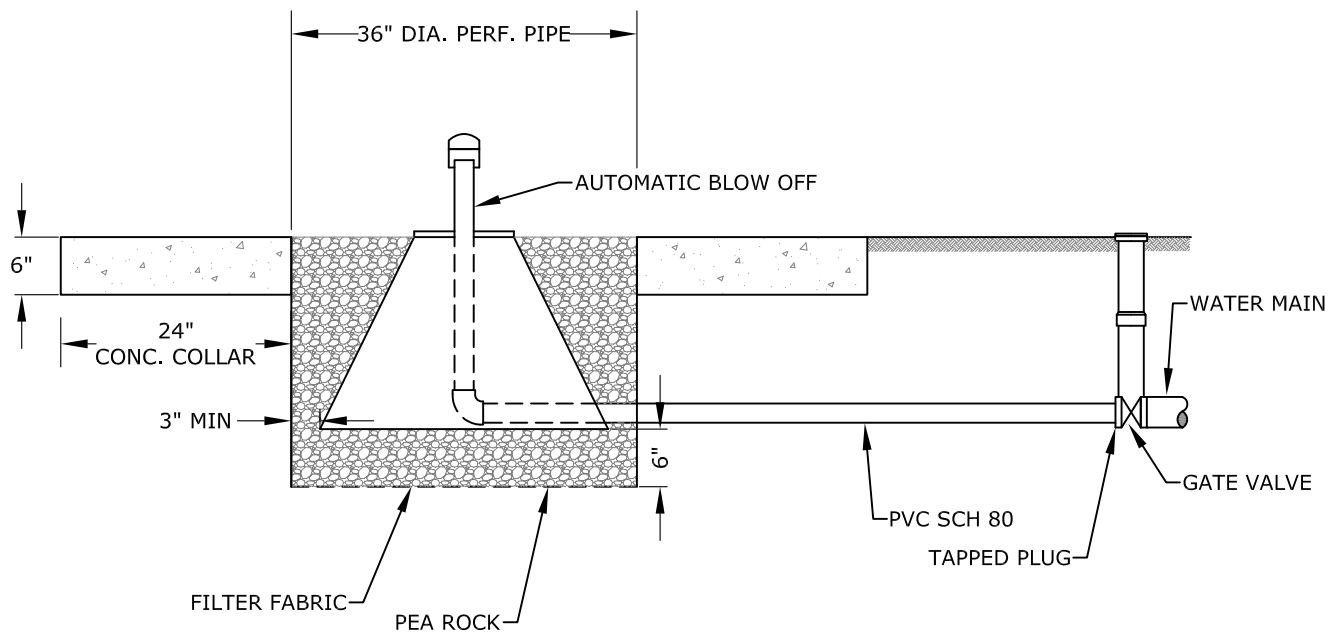


REVISED

7/7/2021

**AUTOMATIC BLOW OFF
PROFILE**

**FIGURE
253**

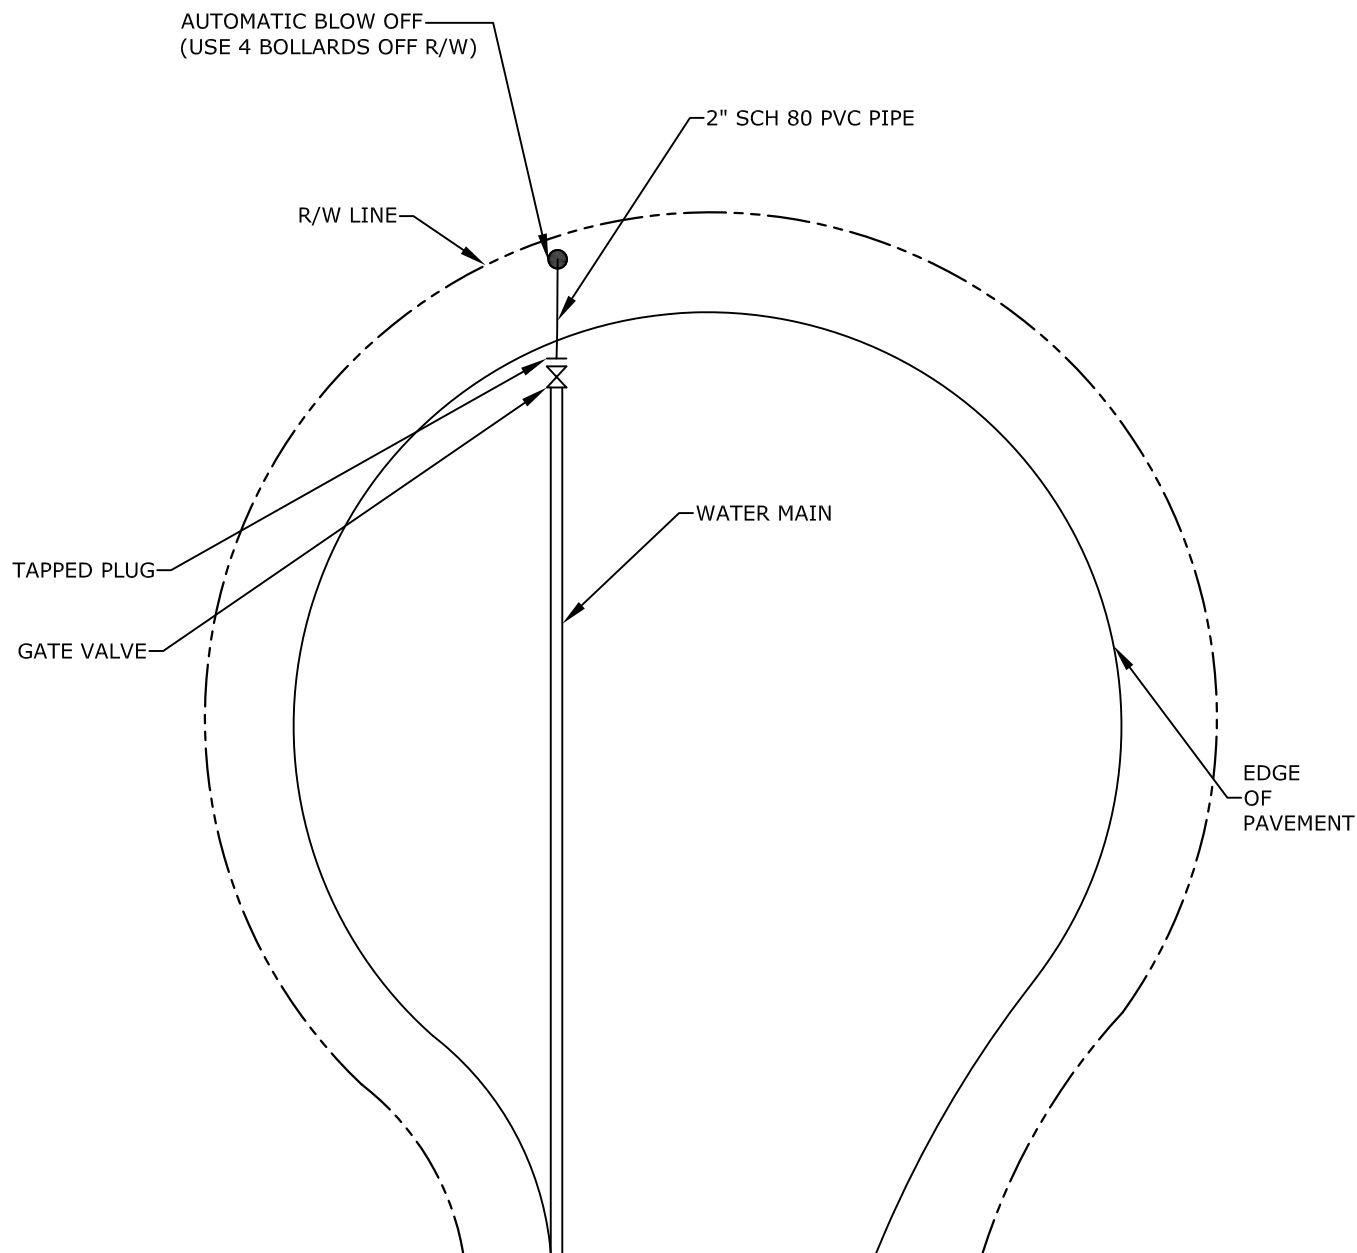


REVISED

7/7/2021

**AUTOMATIC BLOW OFF
PLAN**

**FIGURE
254**

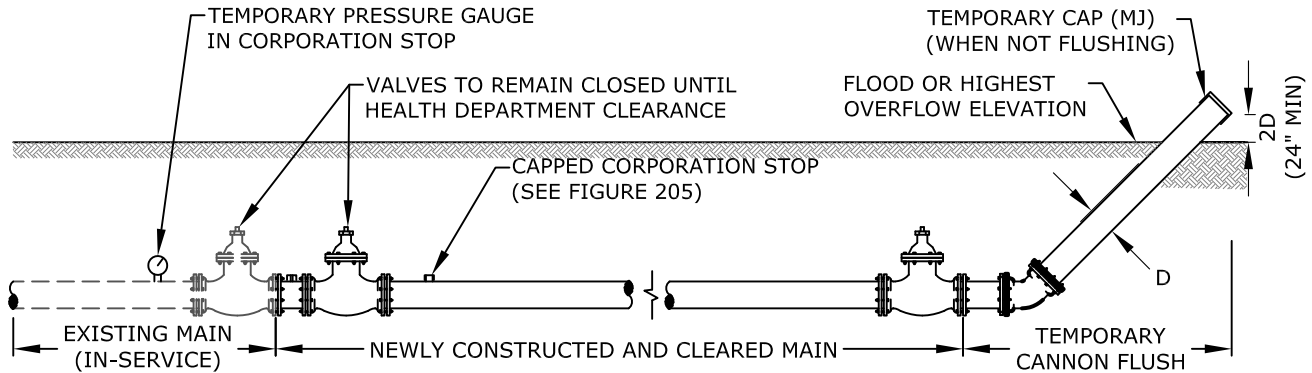

NOTES:


1. UPON COMPLETION OF THE PIPE INSTALLATION FOR ANY SECTION, ALL NEW WATER MAINS SHALL BE CANNON FLUSHED TO REMOVE DIRT AND ANY OTHER FOREIGN MATTER.
2. CANNON FLUSHING OF NEW WATER MAINS SHALL PROCEED ONLY AFTER HEALTH DEPARTMENT CLEARANCE IS RECEIVED.
3. CONTRACTOR IS CAUTIONED THAT GOVERNING AGENCIES OR UTILITIES MAY HAVE REGULATIONS LIMITING OR PROHIBITING DISCHARGE INTO SEWERS, SURFACE WATERS, CANALS, DITCHES AND OTHER CONVEYANCES/RETENTION AREAS. ALL COMPLIANCE WITH GOVERNING AGENCY REQUIREMENTS (INCLUDING PERMITTING, IF REQUIRED) IS THE SOLE RESPONSIBILITY OF THE CONTRACTOR.
4. INSTALL A TEMPORARY 45° BEND AND ASSOCIATED TEMPORARY PIPING AS SHOWN TO DIRECT THE FLUSHING WATER AWAY FROM THE IMMEDIATE WORK AREA AND EXERCISE DUE CARE SO AS TO ENSURE THAT THE WATER USED IN FLUSHING DOES NOT CAUSE A NUISANCE OR INFLECT PROPERTY DAMAGE.
5. CONTRACTOR SHALL INSTALL A TEMPORARY PRESSURE GAUGE AT OR NEAR THE FILL AND FLUSH LOCATION. CONTRACTOR SHALL MONITOR AND MAINTAIN A MINIMUM PRESSURE OF 40 PSI AT ALL TIMES. THE FILL VALVE SHALL BE OPENED AND CLOSED SLOWLY TO AVOID RAPID PRESSURE CHANGES IN THE WATER SYSTEM.
6. BENDS AND PIPING SHALL BE THE SAME SIZE OR LARGER AS THE LINE BEING FLUSHED.
7. ALL PIPING SHALL BE MECHANICALLY RESTRAINED IN ACCORDANCE WITH WWS STANDARDS.
8. FLUSHING LOCATIONS ARE TO BE PROPOSED BY CONTRACTOR AND APPROVED BY ENGINEER OF RECORD.
9. PRIOR TO THE ACTUAL LINE FLUSHING OPERATION THE CONTRACTOR SHALL SCHEDULE INTENDED WATER USE WITH WWS.
10. NO EXISTING VALVES SHALL BE OPERATED, EXCEPT BY AUTHORIZED WWS PERSONNEL.
11. FLUSHING SHALL NOT BE ACCOMPLISHED WITHOUT THE ACTUAL PRESENCE OF THE WWS INSPECTOR.
12. AFTER THE WATER MAIN UNDER CONSTRUCTION HAS BEEN SUCCESSFULLY FLUSHED, THE CONTRACTOR SHALL REMOVE ALL TEMPORARY FACILITIES AND PROCEED WITH THE REMAINING CONSTRUCTION AS SPECIFIED. CLOSE CORPORATION STOPS AND PLUG/CAP WITH BRASS FITTINGS.

REVISED

7/7/2021

**CANNON FLUSHING
FOR NEWLY CONSTRUCTED
WATER MAINS**

**FIGURE
255**

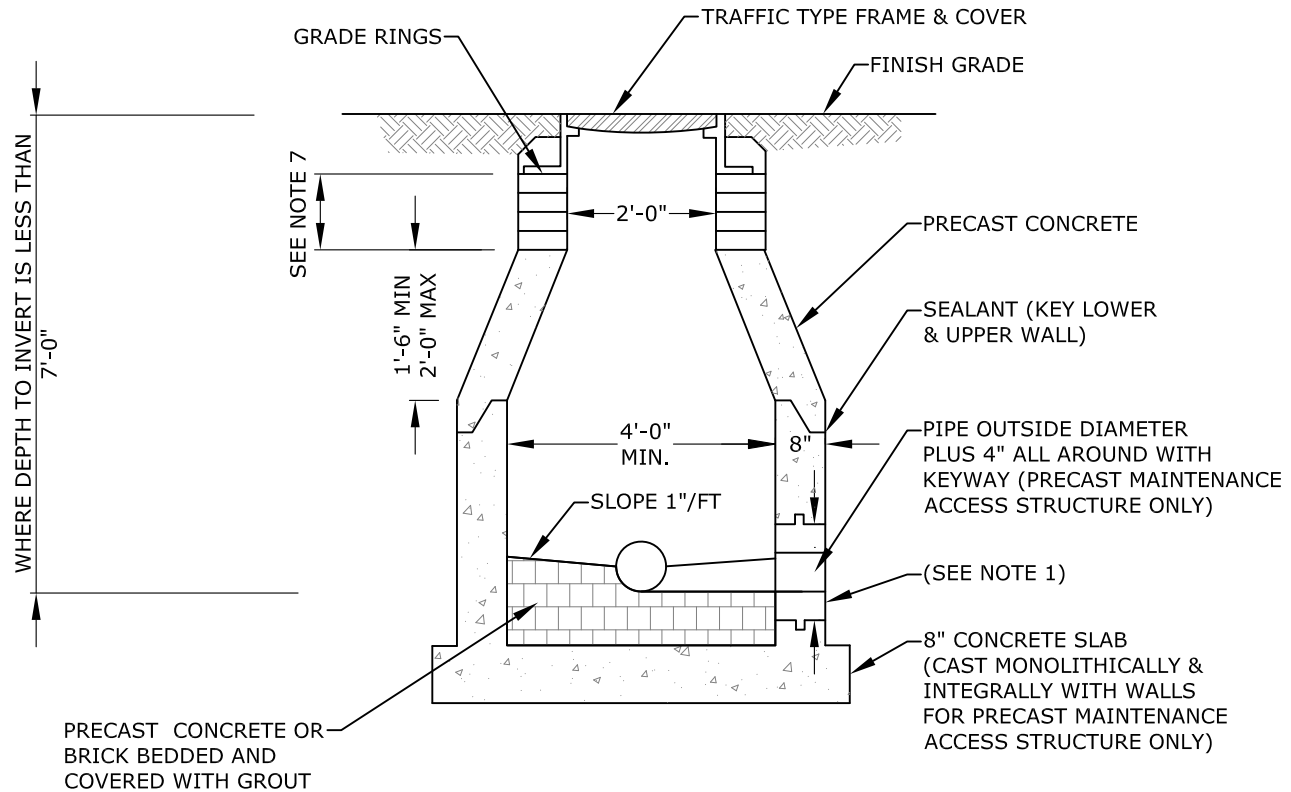


1. MAINTENANCE ACCESS STRUCTURE ADAPTOR COUPLING NEOPRENE BOOT OR APPROVED EQUAL ARE REQUIRED FOR ALL PIPE MATERIAL OR AS APPROVED BY WWS.
2. MAINTENANCE ACCESS STRUCTURE WALLS TO BE SEAL COATED INSIDE AND OUTSIDE WITH 16 MIL. THICKNESS OF COAL TAR EPOXY. THE 1st COAT IS RED AND THE 2nd COAT IS BLACK.
3. LIFT HOLES ARE NOT ALLOWED.
4. ALL OPENINGS SHALL BE SEALED WITH WATERPROOF EXPANDING GROUT. SEE FIG. 322
5. A FLOW CHANNEL SHALL BE CONSTRUCTED INSIDE MAINTENANCE ACCESS STRUCTURE TO DIRECT INFLUENT INTO FLOW STREAM.
6. ALL CONCRETE SHALL BE TYPE II CEMENT, MEETING LATEST ASTM REQUIREMENTS AND PROVIDED WITH LABORATORY CERTIFICATION ON PRECAST STRUCTURES.
7. THE CHIMNEY AREA SHALL BE MINIMUM OF 4" AND A MAXIMUM OF 12" IN HEIGHT. A MINIMUM OF 3 GRADE RINGS SHALL BE INSTALLED. SET IN 2 STRIPS OF BUTYL JOINT SEALANT STRIPS ON EACH SEALING FACE.
8. SET MAINTENANCE ACCESS STRUCTURE FRAME ON 2 STRIPS OF BUTYL JOINT SEALANT STRIPS PLUS A BED OF PORTLAND CEMENT AND SILICA SAND. APPLY MORTAR ON INSIDE AND OUTSIDE BUTYL JOINT SEALANT.
9. APPLY MORTAR COATING TO INSIDE AND OUTSIDE OF CHIMNEY. BRING MORTAR UP AND OVER FRAME. (SEE NOTE 10. BELOW.)
10. IF CONSHIELD ANTI-MICROBIAL AGENT IS USED IN THE CONCRETE OR MORTAR MIX, INTERIOR COATINGS MAY BE ELIMINATED.

REVISED

7/7/2021

**SHALLOW
MAINTENANCE ACCESS STRUCTURE**

**FIGURE
311**

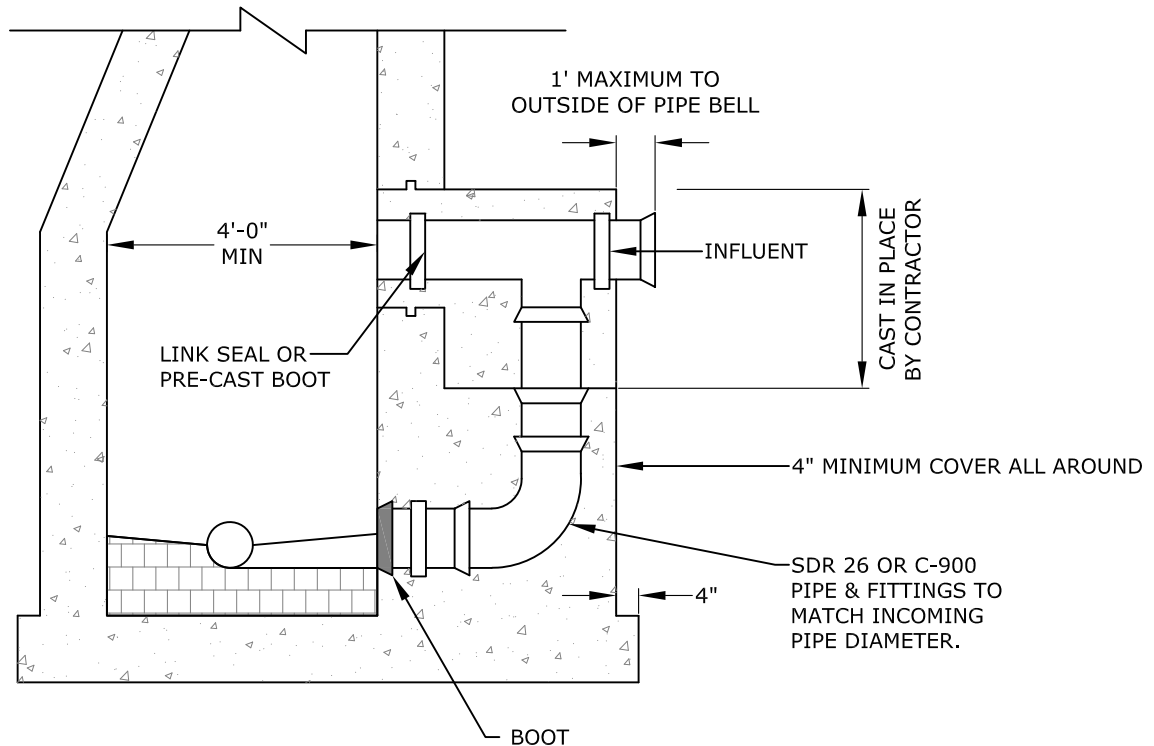


1. THE MANUFACTURER'S PORTION OF THE CONCRETE ENCASEMENT FOR THE DROP CONNECTION SHALL BE POURED INTEGRALLY WITH BOTH THE MAINTENANCE ACCESS STRUCTURE SLAB AND WALL.
2. DROP CONNECTIONS SHALL BE REQUIRED WHENEVER AN INFLUENT SEWER IS LOCATED TWO (2) FEET OR MORE ABOVE THE MAIN INVERT CHANNEL.
3. ALL REQUIREMENTS FOR PRECAST MAINTENANCE ACCESS STRUCTURE WITHOUT DROP CONNECTIONS WILL ALSO APPLY TO PRECAST MAINTENANCE ACCESS STRUCTURE WITH DROP CONNECTIONS. SEE PRECAST MAINTENANCE ACCESS STRUCTURE STANDARD DETAIL FOR OTHER REQUIREMENTS.
4. ALL PIPE TO BE SAME DIAMETER AS INFLUENT SEWER MAIN.
5. APPLY MORTAR COATING TO INSIDE AND OUTSIDE OF CHIMNEY. BRING MORTAR UP AND OVER FRAME. (SEE NOTE 10. BELOW.)
6. IF CONSHIELD ANTI-MICROBIAL AGENT IS USED IN THE CONCRETE OR MORTAR MIX, INTERIOR COATINGS MAY BE ELIMINATED.

REVISED

7/7/2021

**PRECAST
MAINTENANCE ACCESS STRUCTURE
DROP CONNECTION TYPE 1**

**FIGURE
313**

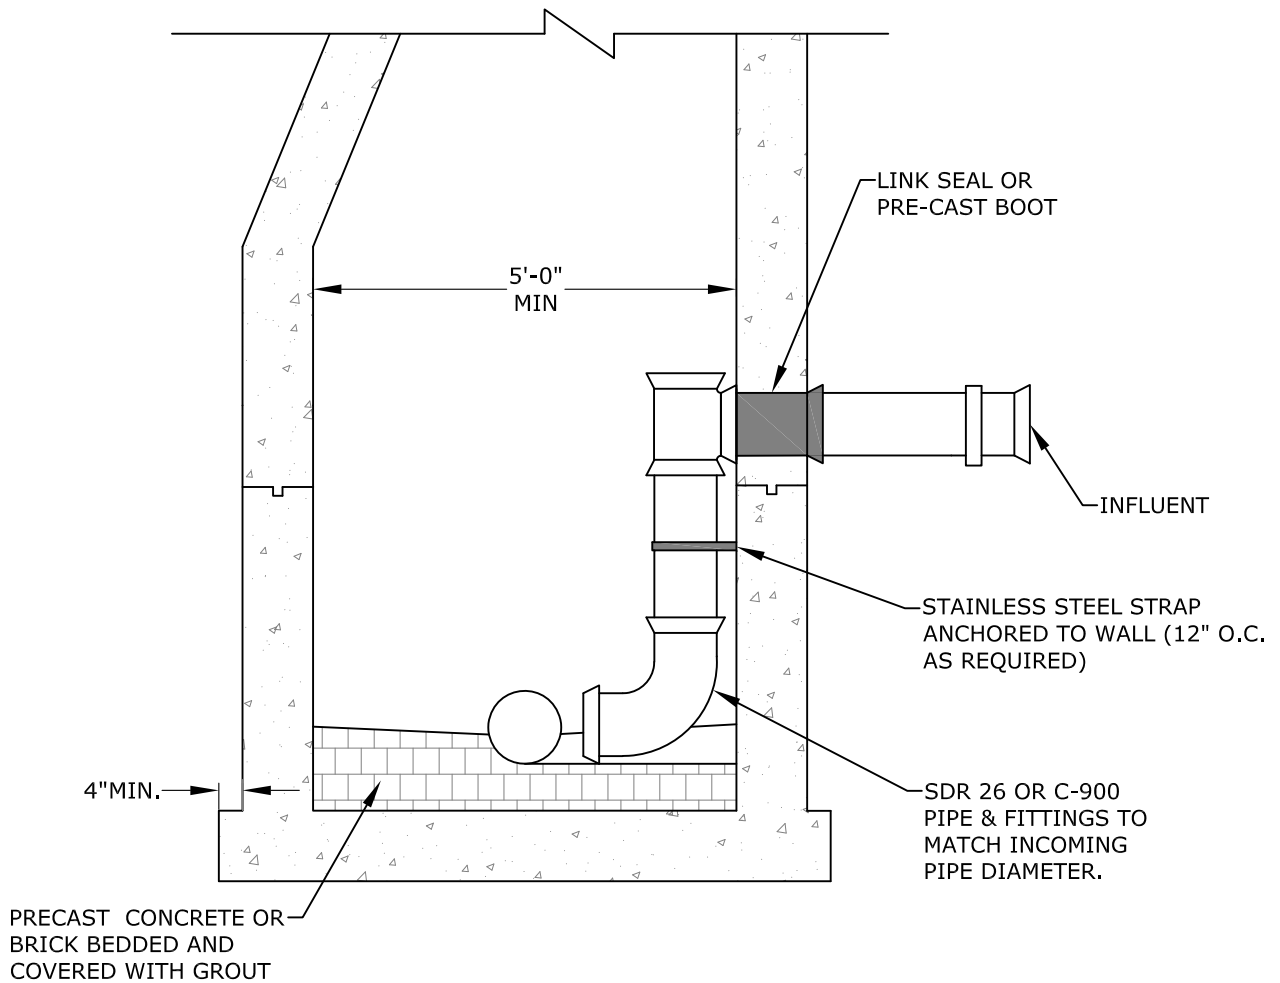


1. THE MANUFACTURER'S PORTION OF THE CONCRETE ENCASEMENT FOR THE DROP CONNECTION SHALL BE POURED INTEGRALLY WITH BOTH THE MAINTENANCE ACCESS STRUCTURE SLAB AND WALL.
2. DROP CONNECTIONS SHALL BE REQUIRED WHENEVER AN INFLUENT SEWER IS LOCATED TWO (2) FEET OR MORE ABOVE THE MAIN INVERT CHANNEL.
3. ALL REQUIREMENTS FOR PRECAST MAINTENANCE ACCESS STRUCTURE WITHOUT DROP CONNECTIONS WILL ALSO APPLY TO PRECAST MAINTENANCE ACCESS STRUCTURE WITH DROP CONNECTIONS. SEE PRECAST MAINTENANCE ACCESS STRUCTURE STANDARD DETAIL FOR OTHER REQUIREMENTS.
4. ALL PIPE TO BE SAME DIAMETER AS INFLUENT SEWER MAIN.
5. APPLY MORTAR COATING TO INSIDE AND OUTSIDE OF CHIMNEY. BRING MORTAR UP AND OVER FRAME. (SEE NOTE 10. BELOW.)
6. IF CONSHIELD ANTI-MICROBIAL AGENT IS USED IN THE CONCRETE OR MORTAR MIX, INTERIOR COATINGS MAY BE ELIMINATED.

REVISED

7/7/2021

**PRECAST
MAINTENANCE ACCESS STRUCTURE
INSIDE DROP CONNECTION TYPE 2**

**FIGURE
313A**

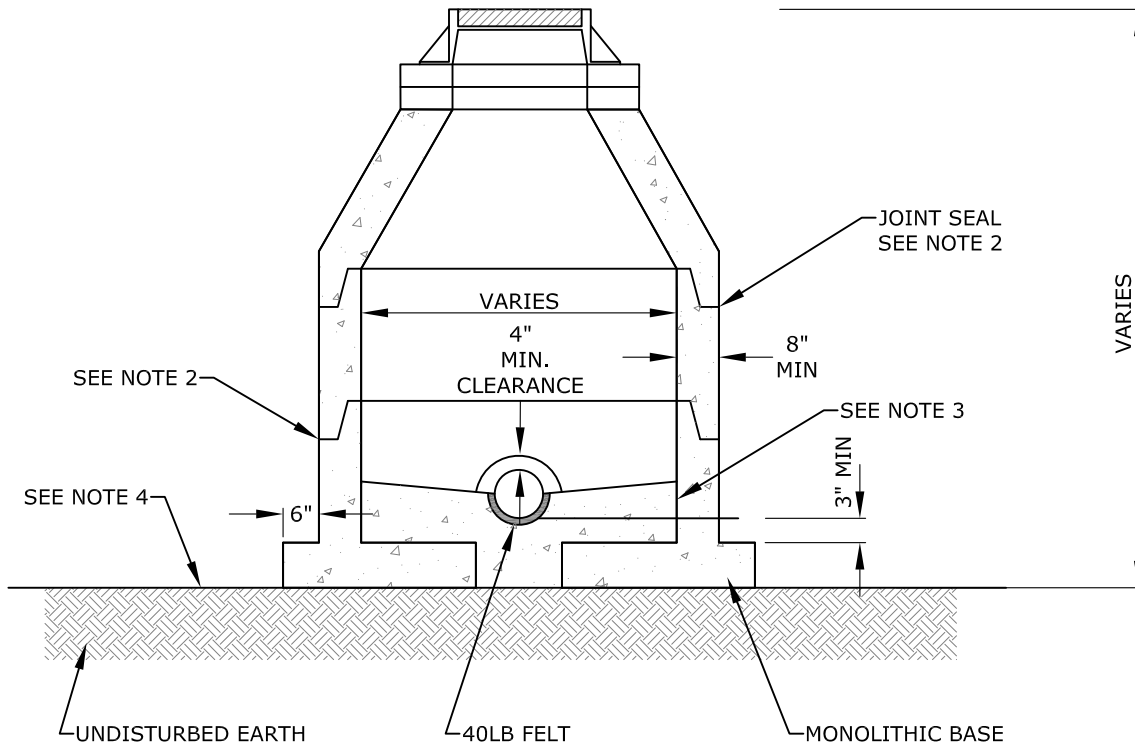


1. SEE FIGURE 315 FOR COVER REQUIREMENTS.
2. "O" RING OR RAM NECK SEAL (KEY LOWER & UPPER WALL).
3. ENTIRE BOTTOM SHALL BE POURED IN PLACE AFTER INSTALLATION OF STRUCTURE. CONCRETE SHALL BE 4,000 PSI, TYPE II. COMPACT BOTTOM OF TRENCH 3' AROUND STRUCTURE TO 100% OF THE MAX DENSITY AS PER AASHTO-T-99.
4. MAINTENANCE ACCESS STRUCTURE WALLS TO BE SEAL COATED INSIDE AND OUTSIDE WITH 16 MIL. THICKNESS OF COAL TAR EPOXY. THE 1ST COAT IS RED AND THE 2ND COAT IS BLACK.
5. APPLY MORTAR COATING TO INSIDE AND OUTSIDE OF CHIMNEY. BRING MORTAR UP AND OVER FRAME. (SEE NOTE 7 BELOW.)
6. IF CONSHIELD ANTI-MICROBIAL AGENT IS USED IN THE CONCRETE OR MORTAR MIX, INTERIOR COATINGS MAY BE ELIMINATED.

REVISED

7/7/2021

**DOGHOUSE
MAINTENANCE ACCESS STRUCTURE
DETAIL**

**FIGURE
314**

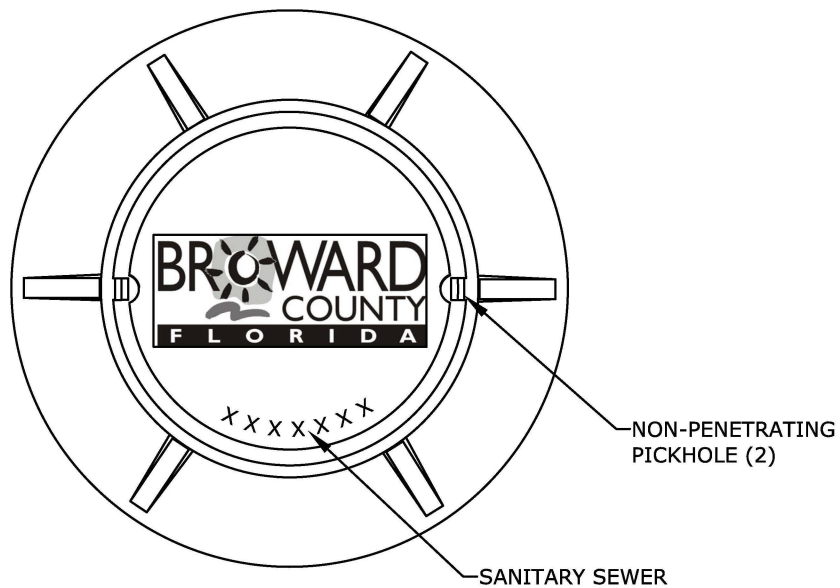


REVISED

7/7/2021

**GRAVITY SEWER
MAINTENANCE ACCESS STRUCTURE
COVER**

**FIGURE
315**

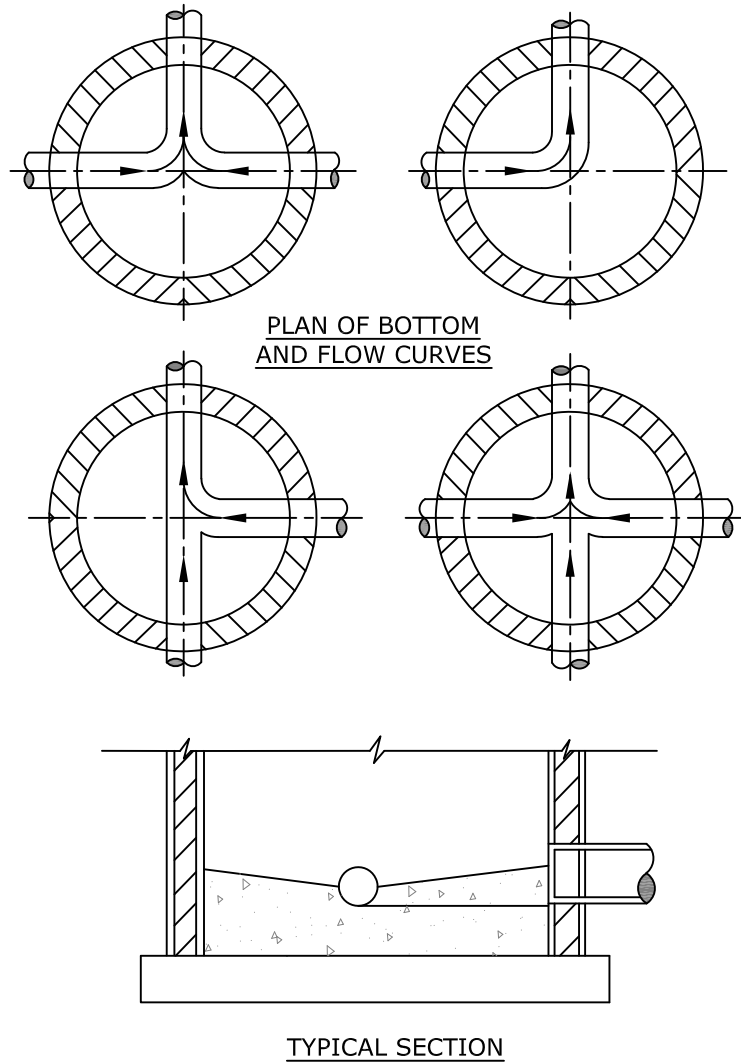


1. PROVIDE SPILLWAY FOR SMOOTH FLOW BETWEEN PIPES WITH DIFFERENT INVERT ELEVATIONS.
2. SLOPE MAINTENANCE ACCESS STRUCTURE SHELF 1"/FT FROM MAINTENANCE ACCESS STRUCTURE WALL TO CHANNEL.
3. INVERT CHANNEL TO BE CONSTRUCTED FOR SMOOTH FLOW WITH NO OBSTRUCTIONS.
4. CHANNEL SHALL BE PRECAST CONCRETE OR FILLED WITH BRICK COVERED WITH 1" OF MORTAR.

REVISED

7/7/2021

INVERT CHANNEL
FLOW DIRECTIONS

FIGURE
318

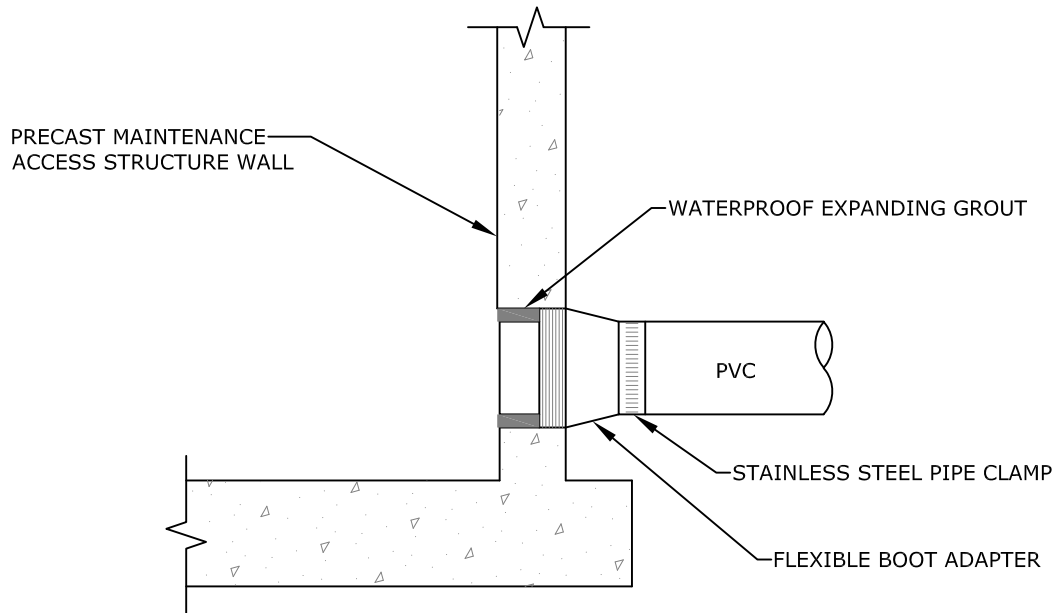

STANDARD PRECAST
MAINTENANCE ACCESS STRUCTURE
PIPE CONNECTION


WWS MAY APPROVE ALTERNATE WATER TIGHT CONNECTION.

REVISED

7/7/2021

MAINTENANCE ACCESS STRUCTURE
CONNECTION DETAIL

FIGURE
322

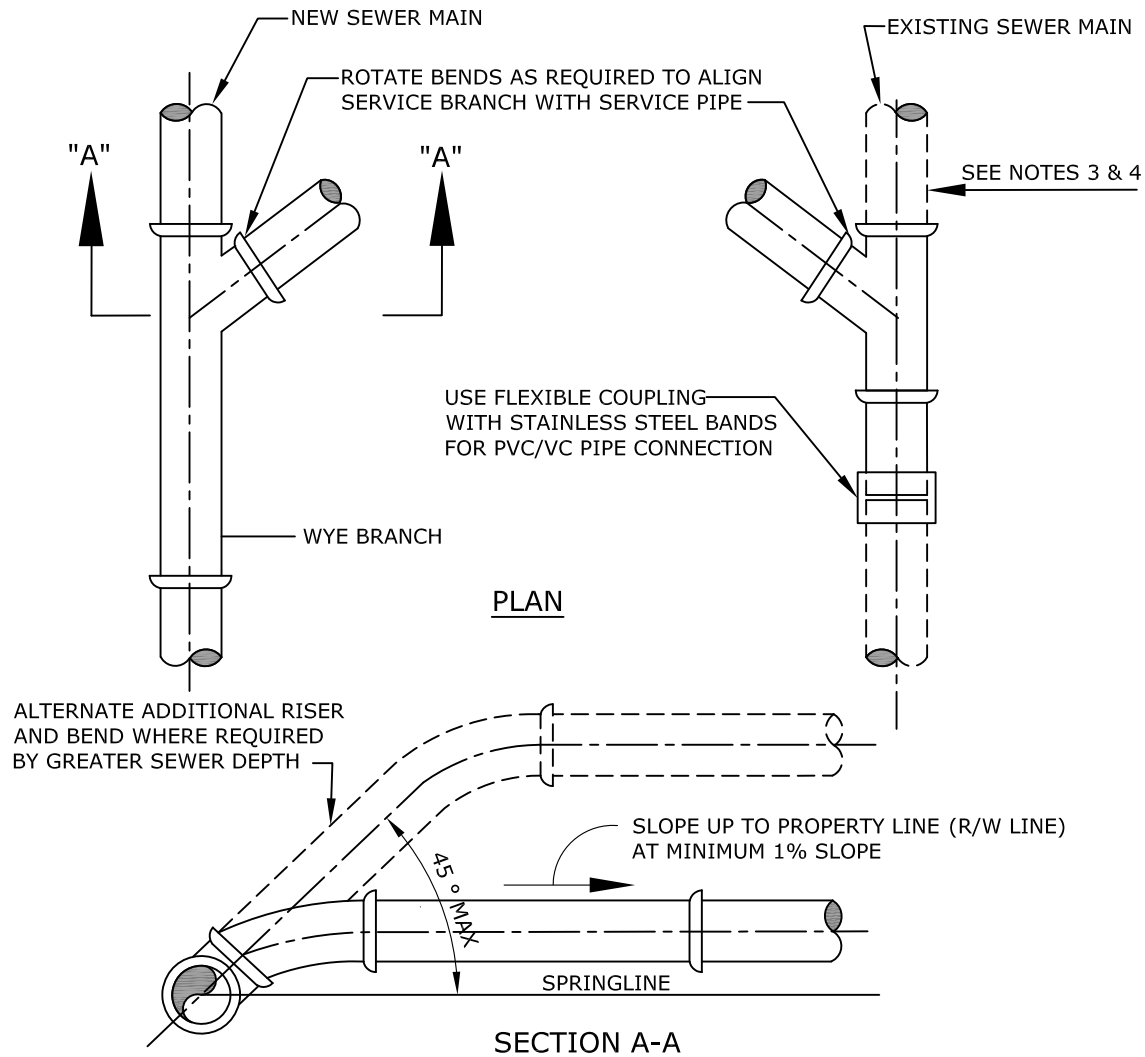


1. SINGLE SERVICE CONNECTIONS SHALL USE 6" SDR 26 PVC PIPE AND FITTINGS.
2. SINGLE SERVICE CONNECTIONS BELOW 12' DEPTH SHALL BE C-900 PVC UNTIL LESS THAN 12 FOOT DEPTH.
2. USE RISER CONNECTIONS WHERE INVERT OF SEWER IS MORE THAN 7'-0" DEEP.
3. WHERE BELL OF WYE AND SPIGOT OF EXISTING MAIN ARE NOT COMPATIBLE, USE A SECOND FLEXIBLE COUPLING.
4. RIGID COUPLINGS MAY BE USED IN LIEU OF FLEXIBLE COUPLINGS.
5. MAINTAIN 36" MINIMUM COVER FROM TOP OF SERVICE TO FINISH GRADE; WHERE NOT TECHNICALLY FEASIBLE CONTACT WWS ENGINEERING.
6. PVC SERVICES SHALL BE INSTALLED IN ACCORDANCE WITH MINIMUM STANDARDS OF THE UNI-BELL HANDBOOK OF PVC PIPE DESIGN AND CONSTRUCTION, LATEST EDITION.

REVISED

7/7/2021

**WYE SEWER
SERVICE CONNECTION**

**FIGURE
331**

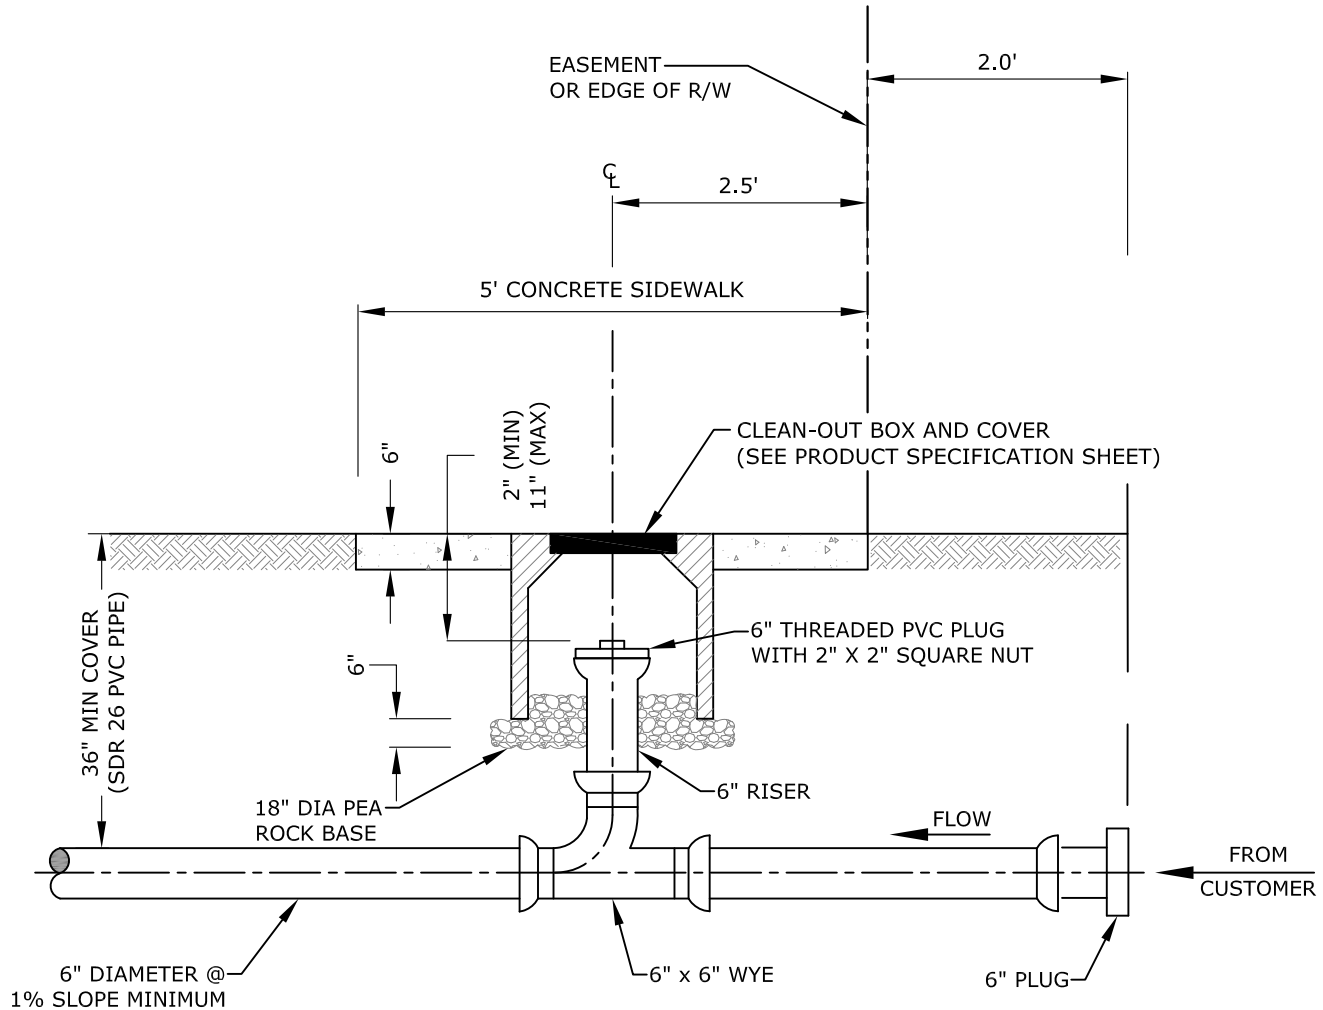


1. THE CLEAN OUT SHALL BE INSTALLED IN THE MIDDLE OF THE SIDEWALK. THIS DIMENSION WILL VARY DEPENDING UPON THE WIDTH OF THE SIDEWALK. 2.5' APPLIES TO 5' SIDEWALK WIDTH. IF SIDEWALKS DO NOT EXIST, THE CLEAN OUT SHALL BE INSTALLED 2.5' FROM THE RIGHT OF WAY LINE.
2. A NEW SECTION OF SIDEWALK SHALL BE POURED AROUND THE CLEAN-OUT BOX WHEN WORKING IN AN AREA WITH EXISTING SIDEWALKS.
3. IN GRASS AREA USE 24"x24" OR 24" DIAMETER CONCRETE COLLAR.

REVISED


7/7/2021

**SEWER SERVICE
CONNECTION AT PROPERTY
LINE OR EASEMENT LINE
PROFILE**

**FIGURE
341**

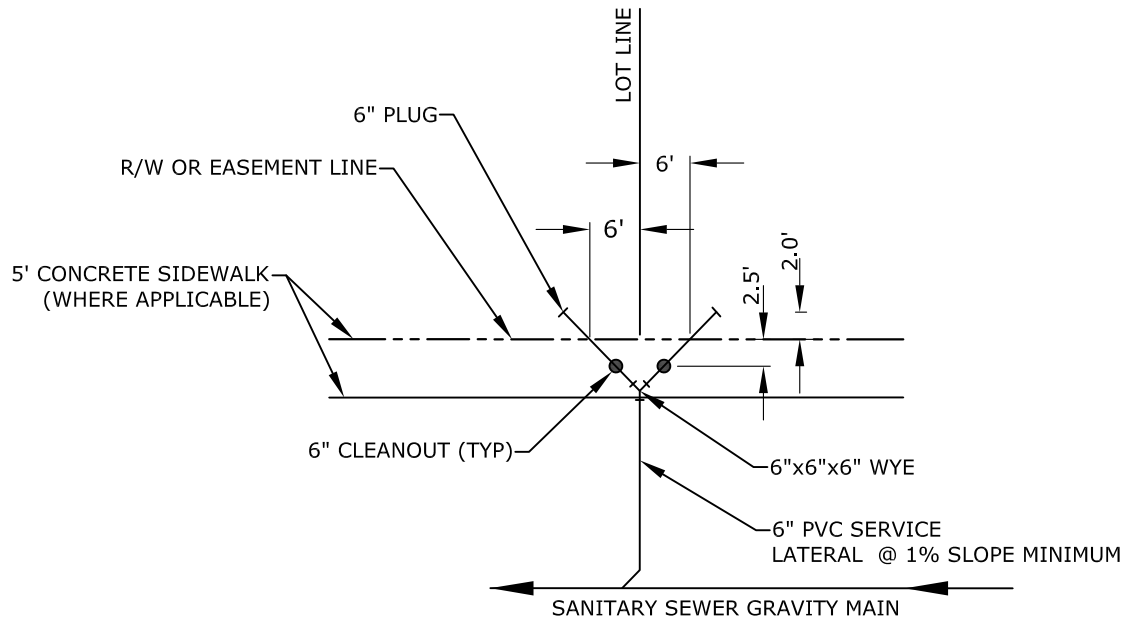

TYPICAL DOUBLE SERVICE LATERAL DETAIL
NTS

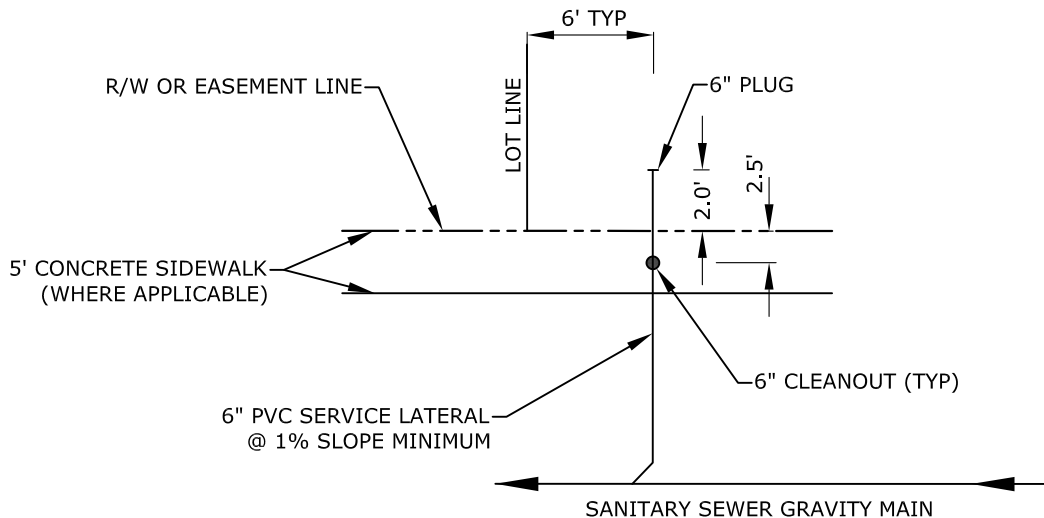


TYPICAL SINGLE SERVICE LATERAL DETAIL
NTS

REVISED

7/7/2021

**SEWER SERVICE
CONNECTION AT PROPERTY
LINE OR EASEMENT LINE
PLAN**

**FIGURE
342**

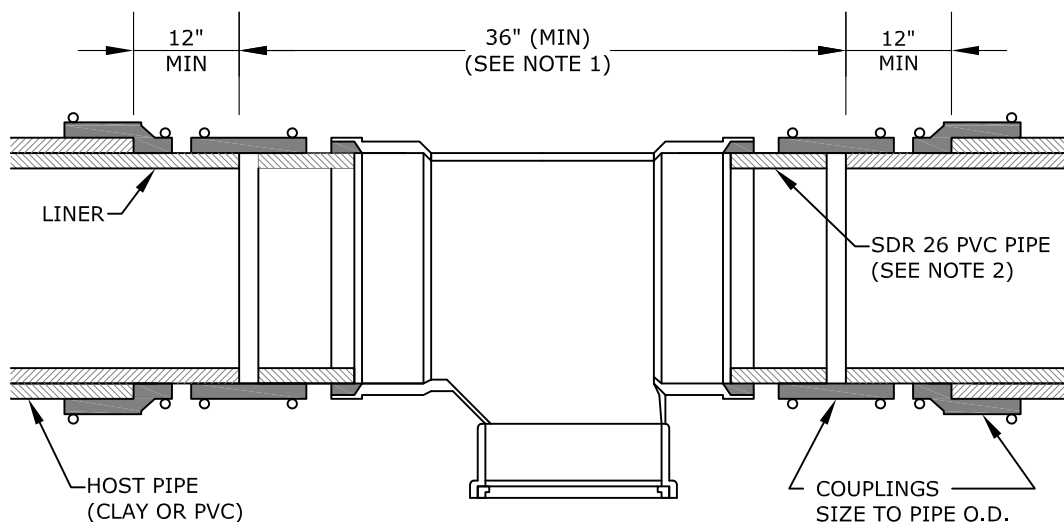


1. FOR MAINS LARGER THAN 8"
THIS DIMENSION SHALL BE
THE FITTING DIAMETER PLUS 24"
2. FOR DEPTHS GREATER THAN
12 FEET, USE C-900 PVC PIPE

REVISED


7/7/2021

**SERVICE CONNECTION ON
LINED GRAVITY SEWER**

**FIGURE
353**

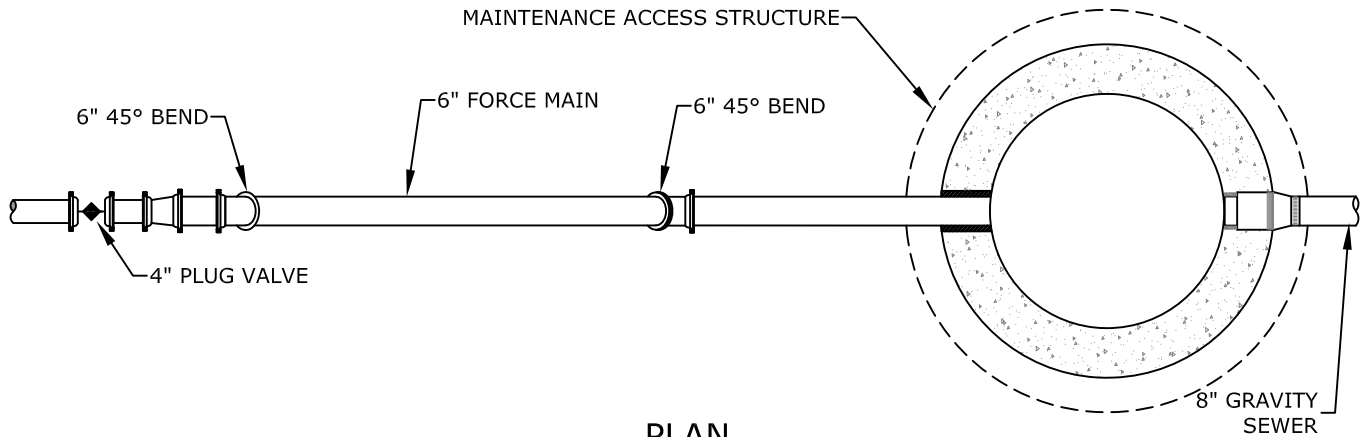

PLAN

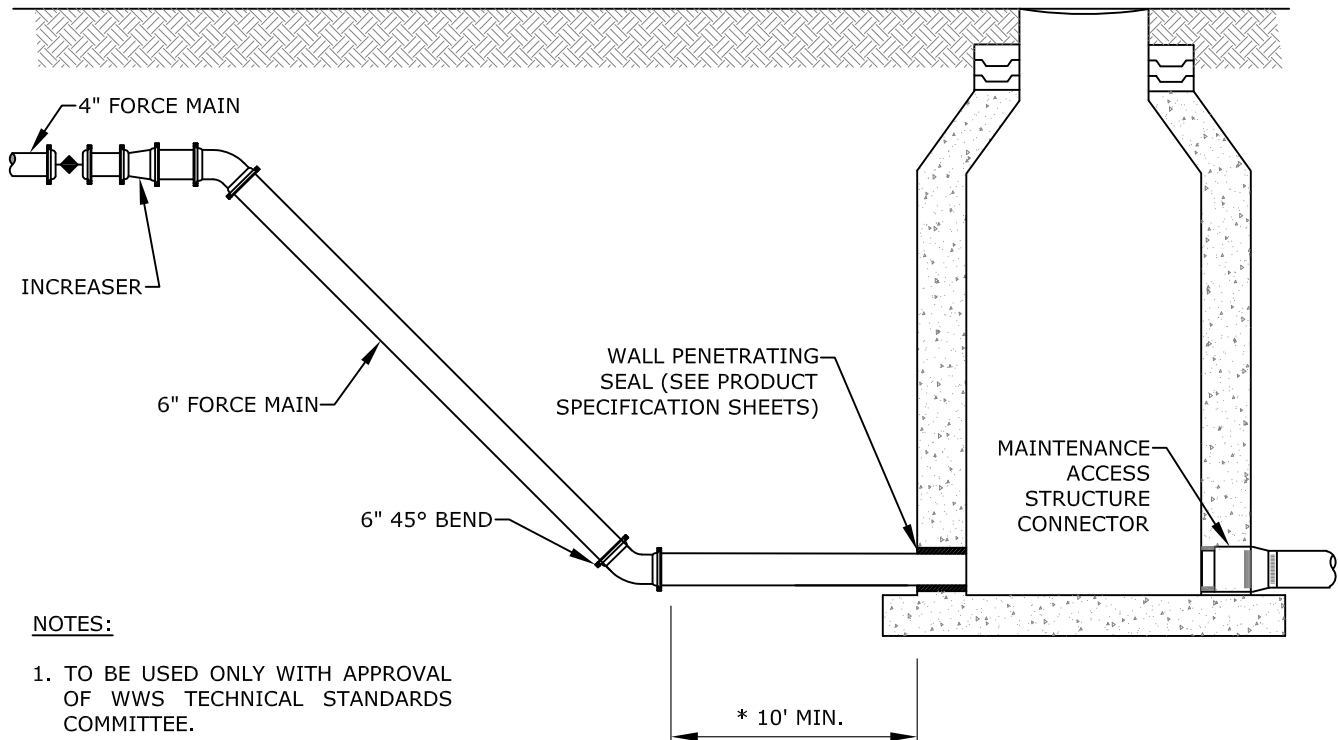

NOTES:

1. TO BE USED ONLY WITH APPROVAL OF WWS TECHNICAL STANDARDS COMMITTEE.
2. INTERIOR OF MAINTENANCE ACCESS STRUCTURE TO BE COATED AS DIRECTED BY WWS.

*INFLUENT SHALL BE PARALLEL WITH EFFLUENT SIDE OF MAINTENANCE ACCESS STRUCTURE FOR A MINIMUM OF 10 FEET FROM MAINTENANCE ACCESS STRUCTURE WALL


PROFILE

REVISED

7/7/2021

**FORCE MAIN CONNECTION
TO GRAVITY SEWER**

**FIGURE
411**

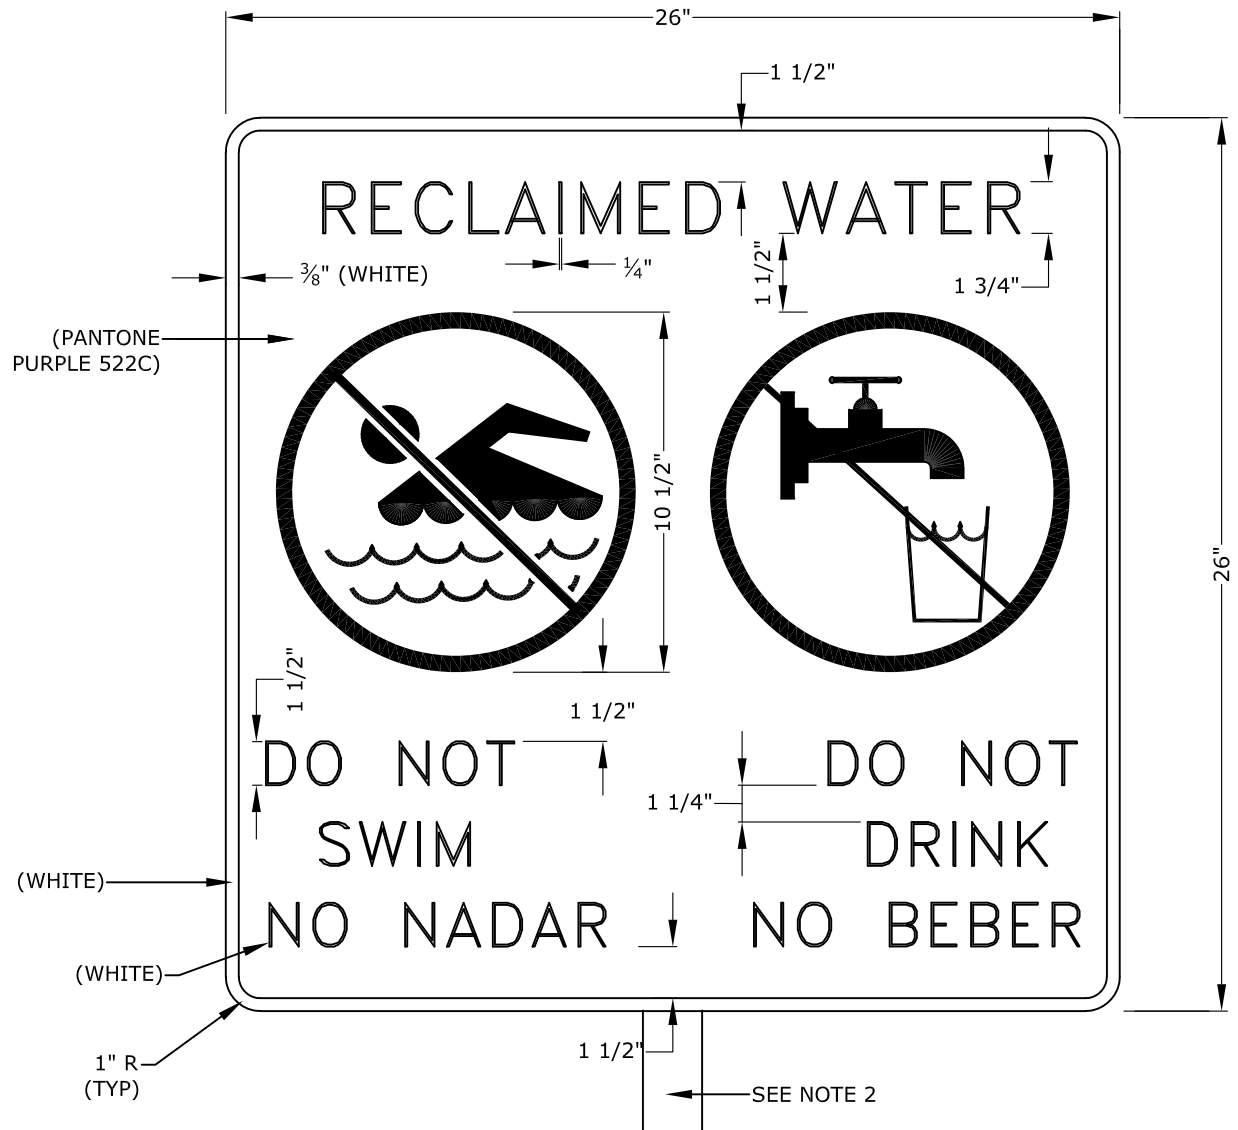


1. SIGN SHALL BE 0.080 GAUGE ALUMINUM WITH ENGINEERING GRADE REFLECTIVE PANTONE PURPLE BACK, AND WHITE TEXT AND GRAPHICS.
2. SIGN SHALL BE ANCHORED WITH A 2" SQUARE GALVANIZED POST.
3. MOUNTING HARDWARE SHALL BE STAINLESS STEEL.
4. HEIGHT OF SIGN WILL DEPEND ON LOCATION AND SURROUNDING LANDSCAPE PLANT TYPES. IN ALL CASES, THE SIGN SHALL BE VISIBLE TO THE PUBLIC.
5. SIGN SHALL BE PLACED BY CONTRACTOR IN ACCORDANCE WITH FAC CHAPTER 62-610 "ACCESS CONTROL AND ADVISORY SIGNS", THE COUNTY APPROVED ENGINEERING PLANS AND/OR AS APPROVED BY WWS.

REVISED

7/7/2021

**TYPE 1
RECLAIMED WATER SIGN**

**FIGURE
505**

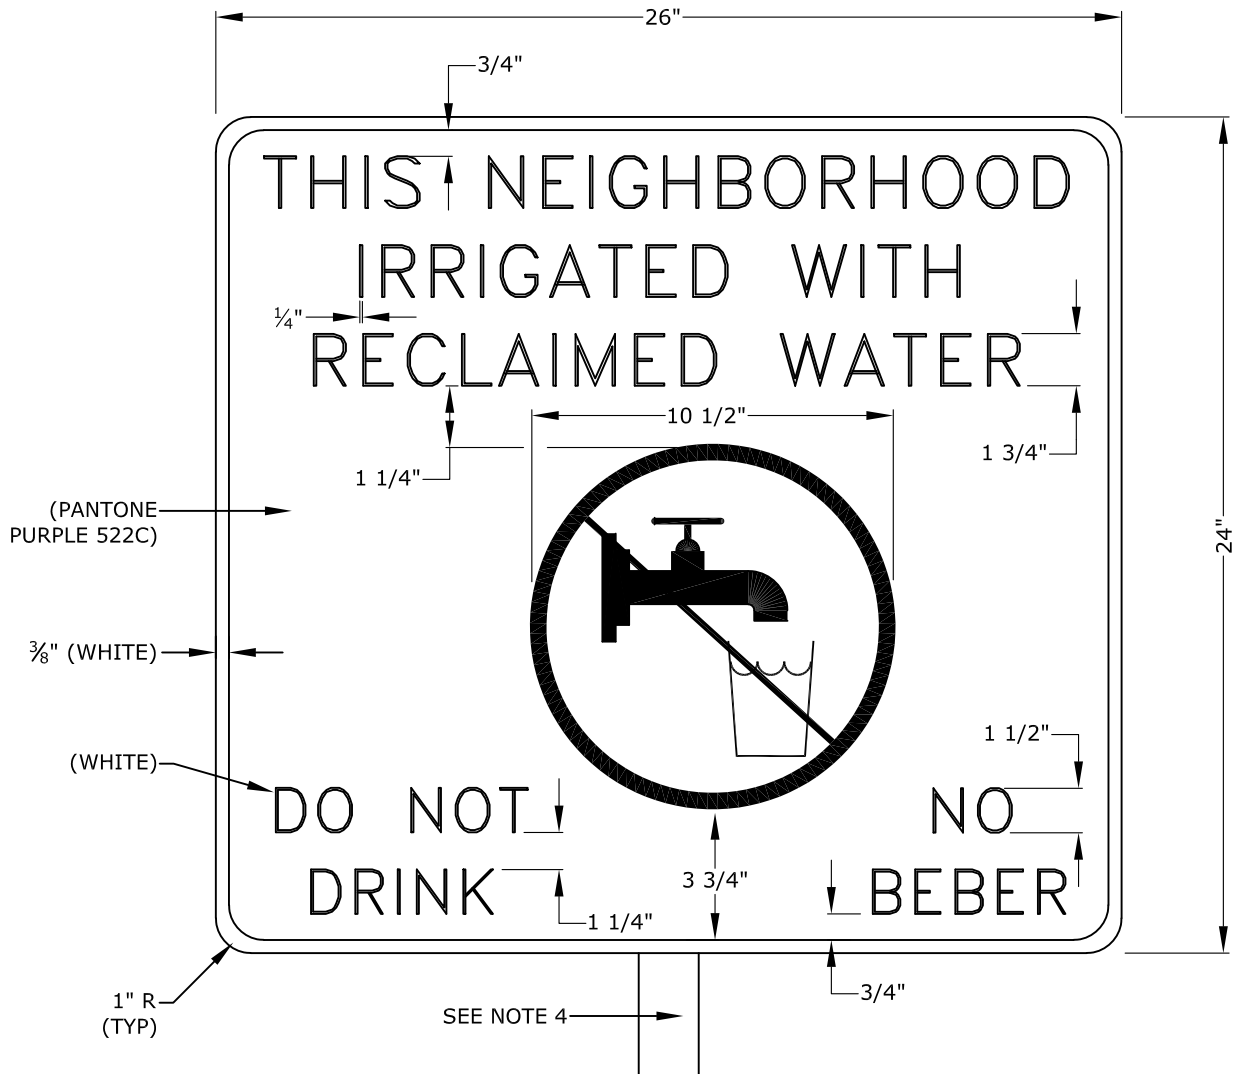


1. FOR COMMERCIAL PROPERTIES THE WORD "NEIGHBORHOOD" SHALL BE REPLACED WITH "AREA".
2. THIS SIGN SHALL BE POSTED AT THE ENTRANCE(S) TO SUBDIVISIONS AND COMMERCIAL PROPERTIES WHERE RECLAIMED WATER IS INSTALLED.
3. SIGN SHALL BE 0.080 GAUGE ALUMINUM WITH ENGINEERING GRADE REFLECTIVE PANTONE PURPLE BACK, AND WHITE TEXT AND GRAPHICS.
4. SIGN SHALL BE ANCHORED WITH A 2" SQUARE SHAPED GALVANIZED POST.
5. MOUNTING HARDWARE SHALL BE STAINLESS STEEL.
6. HEIGHT OF SIGN WILL DEPEND ON LOCATION AND SURROUNDING LANDSCAPE PLANT TYPES. IN ALL CASES, THE SIGN SHALL BE VISIBLE TO THE PUBLIC.
7. SIGNS SHALL BE PLACED BY THE CONTRACTOR IN ACCORDANCE WITH FAC CHAPTER 62-610 "ACCESS CONTROL AND ADVISORY SIGNS", THE COUNTY APPROVED ENGINEERING PLANS AND/OR AS APPROVED BY WWS.

REVISED


7/7/2021

TYPE 2
RECLAIMED WATER SIGN

FIGURE
506

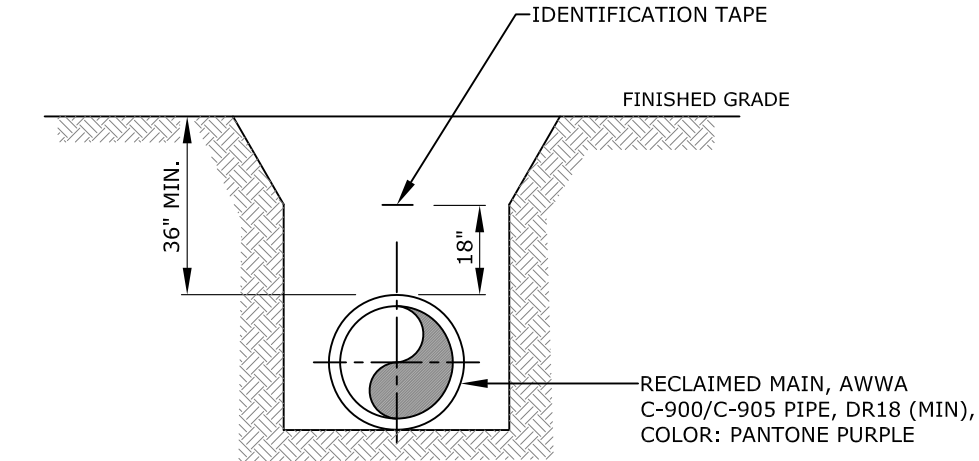

SECTION

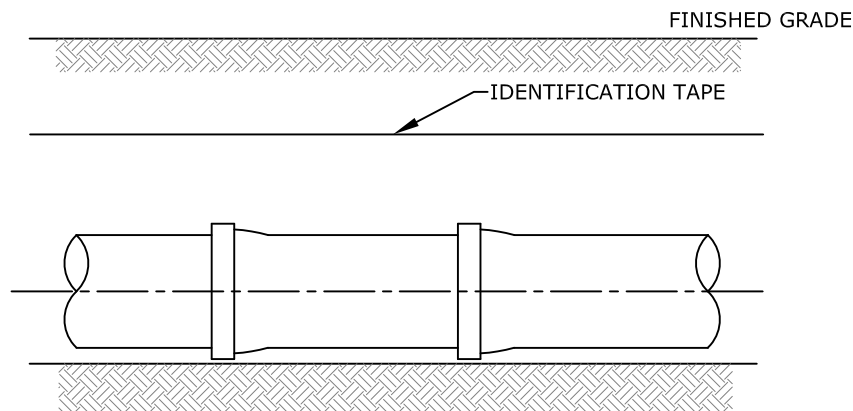

PROFILE


1. DETECTABLE IDENTIFICATION TAPE SHALL BE INSTALLED DIRECTLY OVER CENTERLINE OF THE PIPE AT 18-INCHES ABOVE THE PIPE.
2. METALIZED DETECTOR TAPE SHALL BE ONE LAYER OF METALIZED FOIL LAMINATED BETWEEN TWO LAYERS OF INERT PLASTIC FILM (MINIMUM 5.5 MILS THICKNESS). TAPE SHALL BE PURPLE CONTINUOUSLY MARKED "CAUTION, RECLAIMED LINE BURIED BELOW".

REVISED

7/7/2021

RECLAIMED MAIN INSTALLATION

FIGURE
510

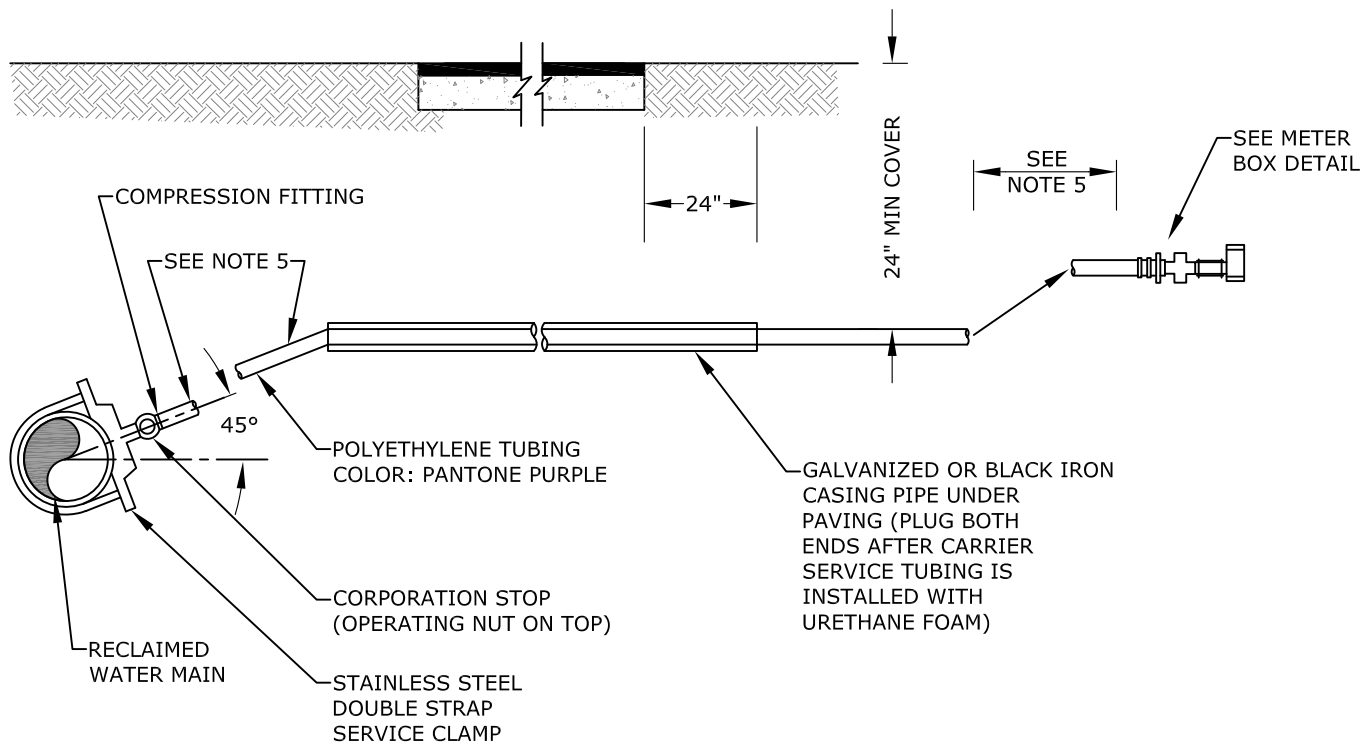


1. SUCCESSIVE TAPS INTO THE RECLAIMED MAIN SHALL BE SPACED NOT LESS THAN 18" ON CENTER. NO TAPS SHALL BE CLOSER THAN 18" TO A JOINT.
2. 1" SERVICES REQUIRE A 2" MINIMUM INSIDE DIAMETER CASING PIPE.
3. 2" SERVICES REQUIRE A 3" MINIMUM INSIDE DIAMETER CASING PIPE.
4. ALL CASING PIPE SHALL EXTEND A MINIMUM OF 2' BEYOND THE EDGE OF PAVEMENT.
5. FOR 1" SERVICE LINES (DR-9) THE MINIMUM RADIUS SHALL BE 14".
FOR 2" SERVICE LINES (DR-9) THE MINIMUM RADIUS SHALL BE 21".
6. ALL CASING PIPE ENDS SHALL BE FILED SMOOTH WITH NO BURRS AND SEALED WITH URETHANE FOAM.
7. THE POLYETHYLENE TUBING SHALL BE ONE CONTINUOUS PIECE FROM THE CORPORATION STOP TO THE METER VALVE. NO JOINTS WILL BE PERMITTED BETWEEN THESE POINTS.

REVISED

7/7/2021

**RECLAIMED WATER
SERVICE CONNECTION**

**FIGURE
521**

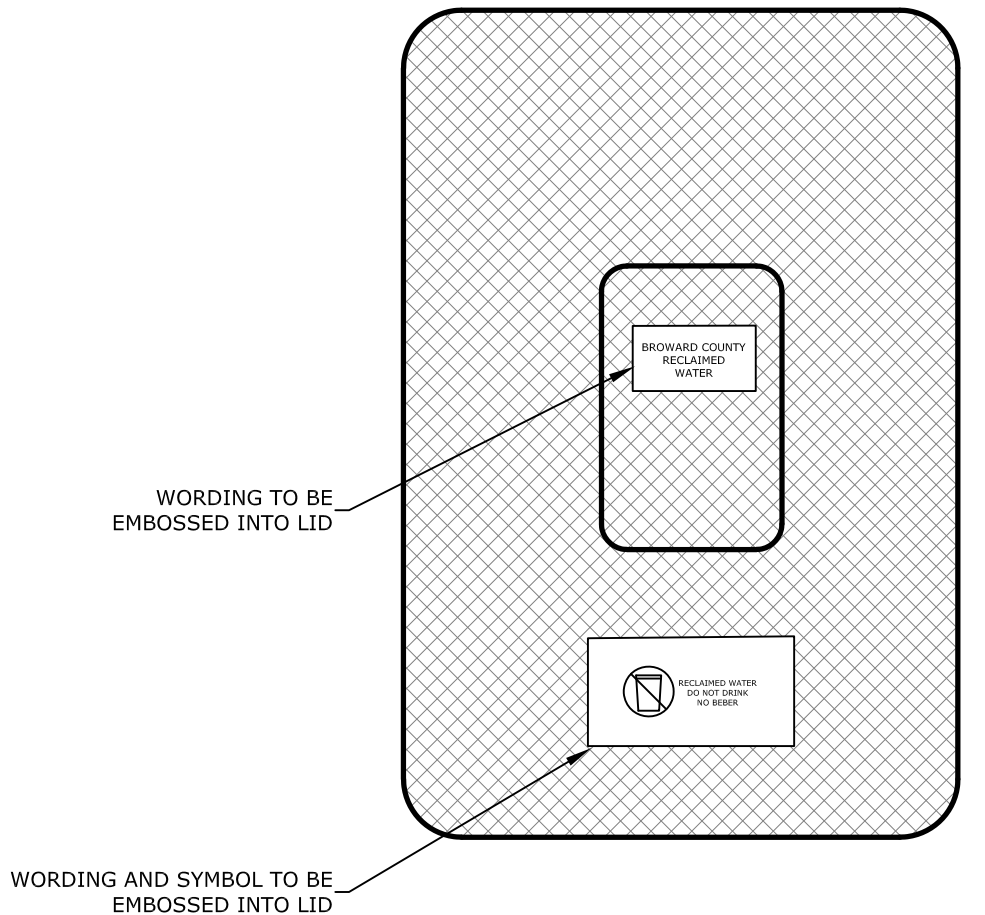


COVER TO BE EPOXY COATED WITH INFUSED PANTONE PURPLE.

REVISED

7/7/2021

RECLAIMED METER BOX COVER

FIGURE
525

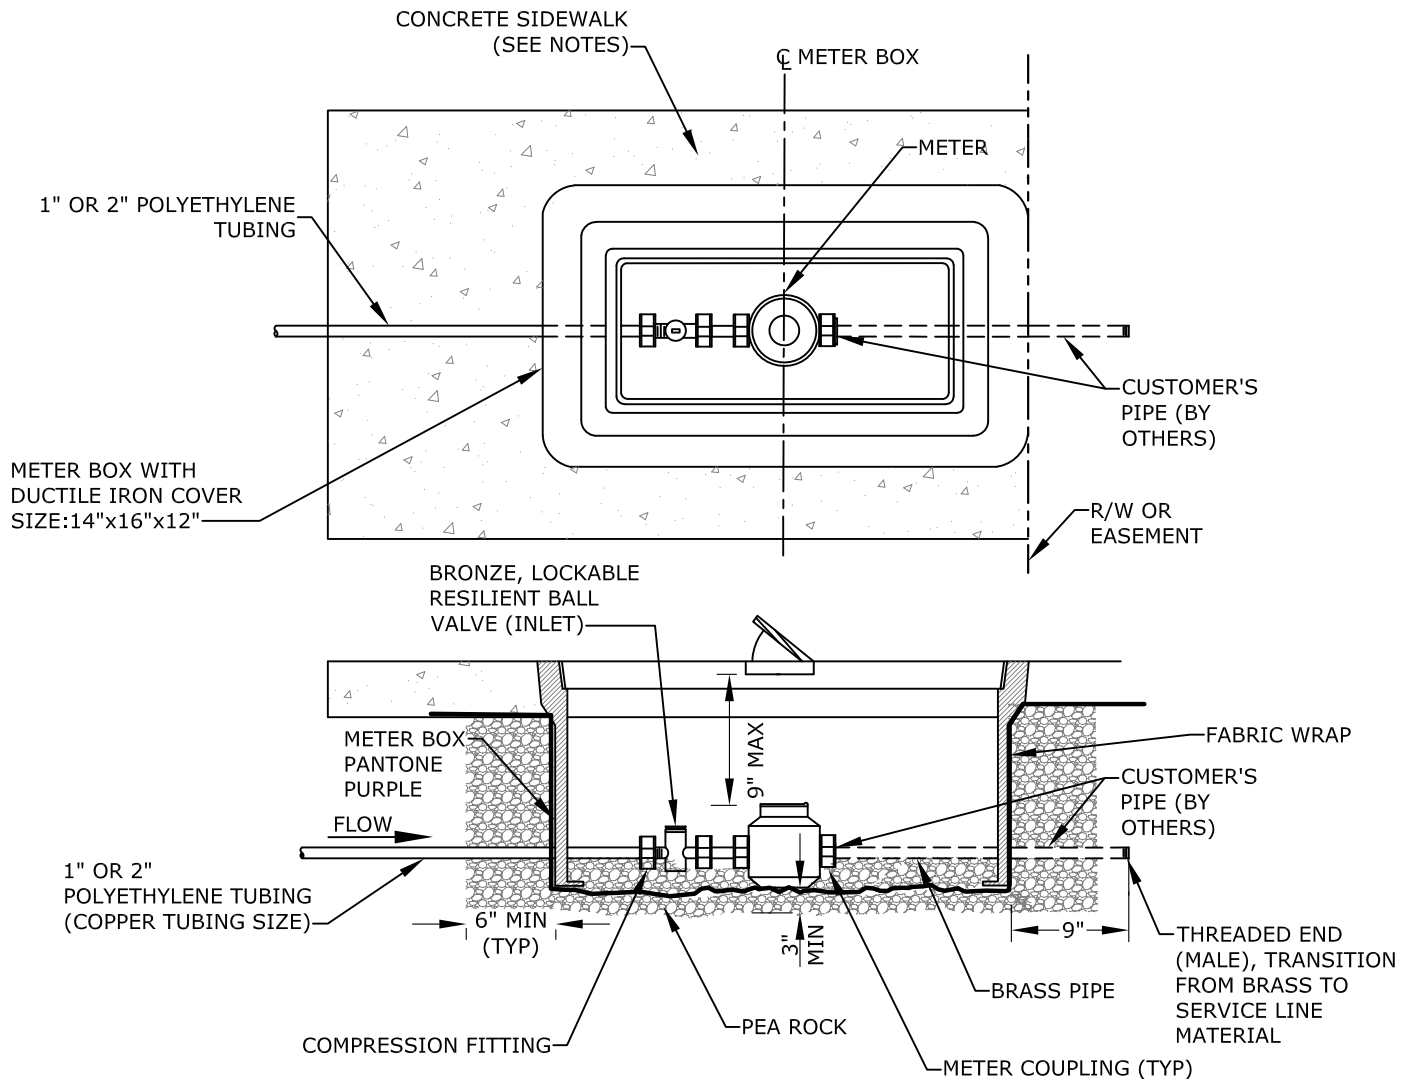

1. ALL STRUCTURES TO BE TRAFFIC BEARING TYPE.
2. CURVE IN SERVICE LINE SHALL BE AS CLOSE TO METER BOX AS PRACTICAL, WITH A MINIMUM RADIUS OF 14" FOR 1" TUBING AND 21" FOR 2" TUBING.
3. ALL METERS WILL BE SUPPLIED AND INSTALLED BY WWS. METER HAS IRON PIPE THREAD MALE CONNECTION ON EACH END.
4. WHEN SIDEWALKS ARE PRESENT, OR PLANNED FOR IN THE R/W, THE BACK EDGE OF THE METER BOX SHALL LINE UP WITH THE BACK EDGE OF THE SIDEWALK
5. METER SHALL BE CENTERED IN BOX DIRECTLY UNDER THE ACCESS LID.
6. WHEN THERE ARE NO SIDEWALKS, CONSTRUCT 6" WIDE x 6" THICK CONCRETE COLLAR AT GRADE.
7. AT BOTH PIPE PENETRATIONS THROUGH THE FABRIC WRAP, THE FABRIC SHALL BE PULLED TIGHT AROUND THE PIPE AND SECURED WITH TWO GRADE 316 STAINLESS STEEL HOSE CLAMPS TO PROVIDE A TIGHT SEAL AROUND PIPE.

METER SIZE	LAYING LENGTH (IN)	HEIGHT (IN)	TUBING SIZE (IN)
5/8"	7.5	4.56	1"
1"	10.75	5.75	2"

REVISED

7/7/2021

**RECLAIMED METER BOX
INSTALLATION**
5/8" OR 1" METERS


**FIGURE
526**

**BROWARD COUNTY
PUBLIC WORKS DEPARTMENT**

PLOTTED: 10/2024

**WATER & WASTEWATER SERVICES
ENGINEERING DIVISION**
2555 WEST COPANS ROAD
POMPAHO BEACH, FL 33069
PHONE NO. 954-831-0745
FAX: 954-831-0925

STANDARD DETAIL

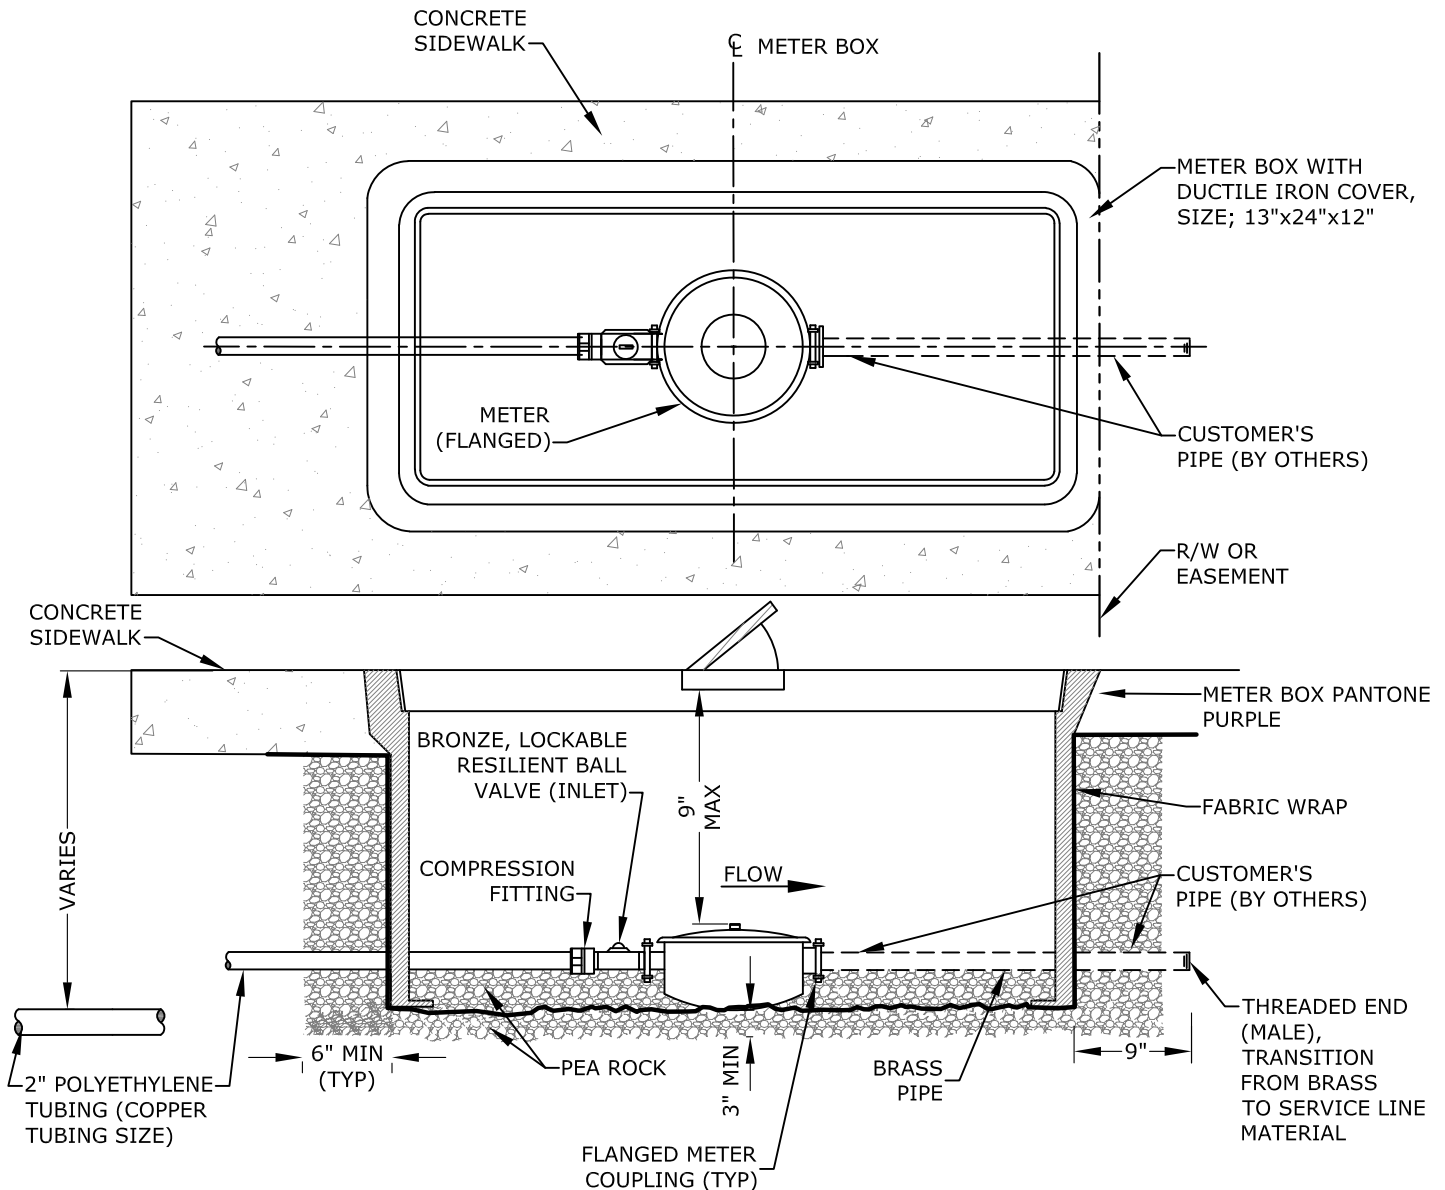

METER SIZE	LAYING LENGTH (IN)	HEIGHT (IN)
1 1/2"	13	6 7/8"
2"	17	7 17/32"



1. ALL STRUCTURES TO BE TRAFFIC BEARING TYPE.
2. CURVE IN SERVICE LINE SHALL BE AS CLOSE TO METER BOX AS PRACTICAL, WITH A MINIMUM RADIUS OF 21" FOR 2" TUBING.
3. ALL METERS WILL BE SUPPLIED AND INSTALLED BY WWS. METER IS FLANGED.
4. WHEN SIDEWALKS ARE PRESENT, OR PLANNED FOR IN THE R/W, THE BACK EDGE OF THE METER BOX SHALL LINE UP WITH THE BACK EDGE OF THE SIDEWALK.
5. METER SHALL BE CENTERED IN BOX DIRECTLY UNDER THE ACCESS LID.
6. WHEN THERE ARE NO SIDEWALKS, CONSTRUCT 6" WIDE x 6" THICK CONCRETE COLLAR AT GRADE.
7. AT BOTH PIPE PENETRATIONS THROUGH THE FABRIC WRAP, THE FABRIC SHALL BE PULLED TIGHT AROUND THE PIPE AND SECURED WITH TWO GRADE 316 STAINLESS STEEL HOSE CLAMPS TO PROVIDE A TIGHT SEAL AROUND THE PIPE.

REVISED

7/7/2021

**RECLAIMED METER BOX FOR
1 1/2" OR 2" METER**

**FIGURE
527**

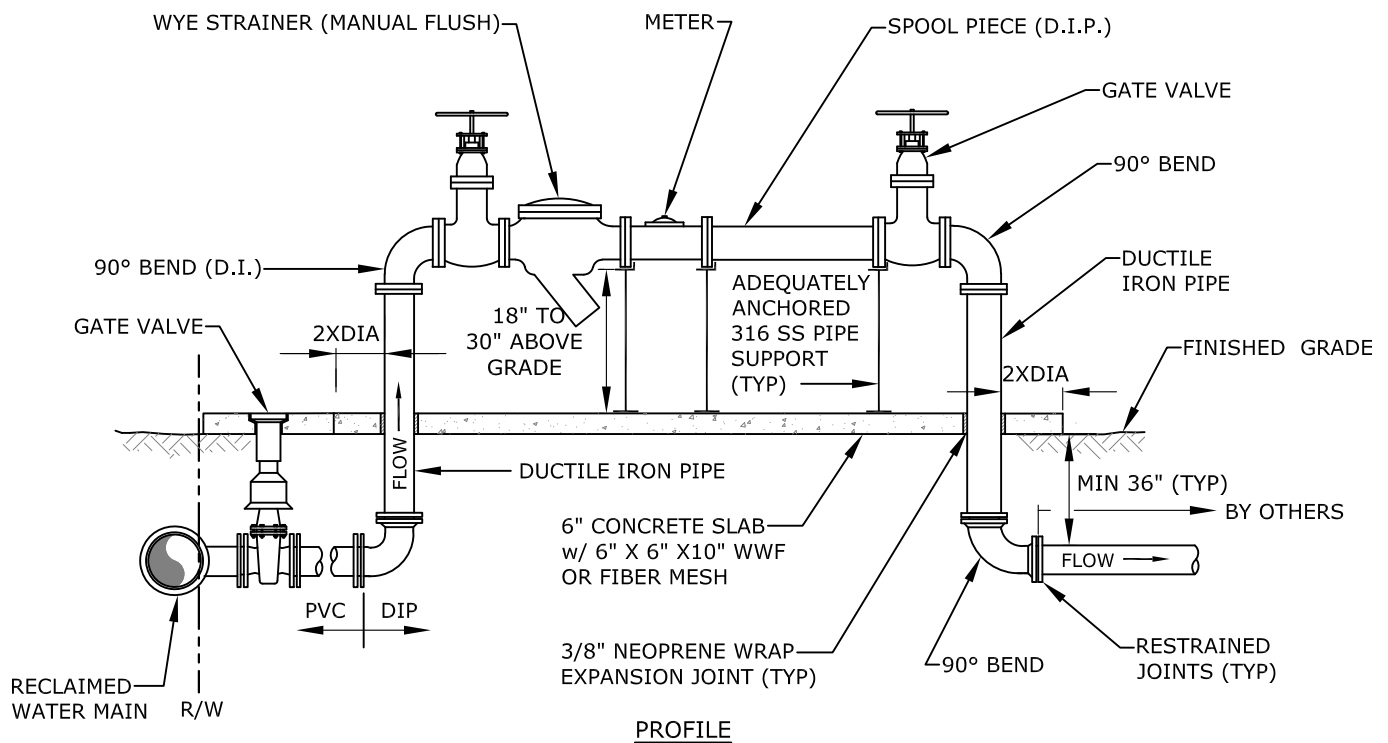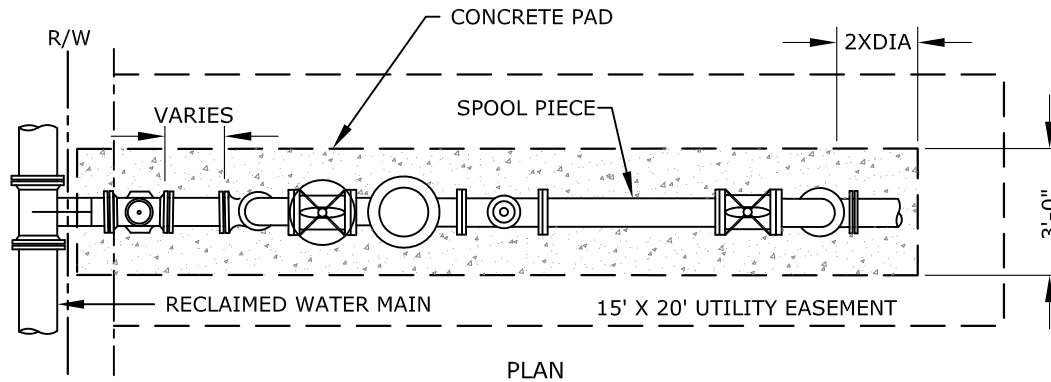


1. ALL PIPES AND FITTINGS ABOVE GRADE SHALL HAVE FLANGED ENDS.
2. ALL PIPES AND FITTINGS BELOW GRADE SHALL BE MECHANICAL RESTRAINED JOINT ENDS.
3. INSTALLATION SHALL COMPLY WITH ALL REQUIREMENTS OF FAC CHAPTER 62-610.
4. PIPING AND APPURTENANCES SHALL BE PAINTED PANTONE PURPLE 522C. PIPE SHALL BE COLORED WITH PANTONE PURPLE 522C USING LIGHT STABLE COLORANTS.

REVISED

7/7/2021

**RECLAIMED WATER
MASTER METER ASSEMBLY
(4" AND LARGER)**

**FIGURE
528**

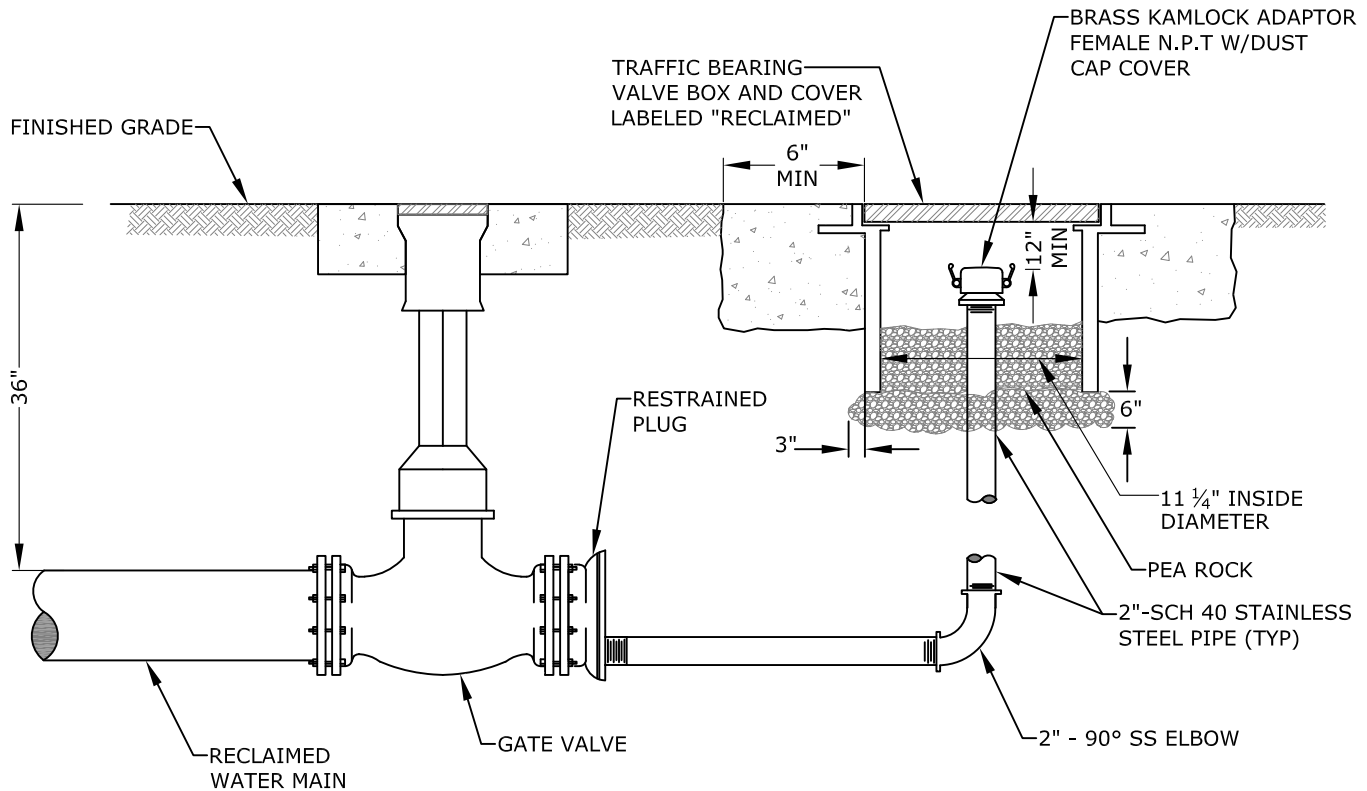

PROFILE

1. 2" TAP IN BOTTOM OF PLUG.
2. USE RESTRAINED JOINT PIPE.
3. IN GRASS AREA USE CONCRETE COLLARS, 6" THICK.
4. PIPE AND VALVE BOX SHALL BE EPOXY COATED WITH PANTONE PURPLE.

REVISED

7/7/2021

RECLAIMED WATER
MANUAL BLOW OFF

FIGURE
552